VICINITY MAP

IFB#6-2014/2015 GULF COAST STATE COLLEGE PHASE 1 CAMPUS IMPROVEMENTS

PANAMA CITY, FLORIDA

— PAVER WALKWAY (6) - 4'-0" POLY VINYL CURVED EXPANDED METAL (1) PIECE BENCH WITH BACK- MODEL BAWBMODERNPSM BY WEBCOAT PRODUCTS 1-800-426-5924 -MONUMENT SIGN- 72" WIDE X 8" DEEP (MIN.) X 84" HGT. (SEE SPECIFICATIONS) -PICK-UP/DROP OFF AREA-**ENLARGED SITE PLAN** 1":*80*'

DESIGN CODES

2010 ED 2010 ED 2010 ED 2008 ED 2010 ED 2006 ED
2004 ED

PROJECT SUMMARY NOTES

- 1. THE SCOPE OF WORK INDICATED ON THESE DRAWINGS IS FOR DEMOLITION OF EXISTING PARKING LOT AND CONSTRUCTION OF A NEW PARKING LOT TO INCLUDE, BUT NOT NECESSARILY LIMITED TO, THE FOLLOWING:
 - A. SITE WORK, TO INCLUDE; GRADING, UTILITY CONNECTIONS, INSTALLATION OF NEW WALKWAY, STORM WATER AND PARKING SPACE. (SITE DESIGN BY OTHERS)
 B. NEW LANDSCAPING AND IRRIGATION.
 - C. NEW LIGHT POLES
- 2. G.C. SHALL FIELD VERIFY ALL SIZES AND FIELD CONDITIONS PRIOR TO BEGINNING WORK.

3. THE ARCHITECT/OWNER RESERVES THE RIGHT

TO REJECT ITEMS INCORPORATED INTO THE WORK WHICH FAILED TO MEET THE SPECIFIED MINIMUM REQUIREMENTS. THE ARCHITECT/OWNER FURTHER RESERVES THE RIGHT AND WITHOUT PREJUDICE FOR OTHER RECOURSE SO THAT THE ARCHITECT/OWNER MAY MAKE ACCEPTABLE ANY NON—COMPLIANT ITEMS SUBJECT TO AN ADJUSTMENT IN THE CONTRACT AMOUNT AS APPROVED BY THE OWNER.

INDEX OF DRAWINGS

GENERAL AO OO COV

A0.00 COVER SHEET / DRAWINGS INDEX / VICINITY MAP

MLGENERAL NOTES

2 OVERALL SITE PLAN
3 PROJECT LIMITS
4 DEMOLITION AND EROSION CONTROL PLAN
5 OVERALL SITE UTILITY PLAN

SITE UTILITY PLAN
SITE UTILITY PLAN

C8 SITE PAVING PLAN
C9 OVERALL SITE GRADING PLAN
C10 SITE GRADING PLAN

C11 SITE GRADING PLAN
C12 SITE GEOMETRY PLAN
C13 SITE GEOMETRY PLAN

C14 OVERALL SIGNAGE AND STRIPING PLAN C15 SIGNAGE AND STRIPING PLAN

C16 SIGNAGE AND STRIPING PLAN
C17 STORMWATER POLLUTION PREVENTION PLAN
C18 STORMWATER POLLUTION PREVENTION PLAN DETAILS

C19 MISCELLANEOUS DETAILS C20 MISCELLANEOUS DETAILS

LANDSCAPE

L1.0 LANDSCAPE PLAN L2.0 LANDSCAPE PLAN

L3.0 LANDSCAPE PLAN
L4.0 IRRIGATION PLAN

L5.0 IRRIGATION PLAN L6.0 IRRIGATION PLAN

ELECTRICAL

E1 ELECTRICAL LEGENDS
E2 ELECTRICAL DEMOLITION PLAN

NEW WORK ELECTRICAL LIGHTING PLAN
NEW WORK CCTV INFRASTRUCTURE PLAN

5 LANGUAGE ARTS ELECTRICAL WORK PLAN 6 ELECTRICAL DETAILS

ELECTRICAL RISER AND CONCRETE POLE FOUNDATION DETAIL

FLORIDA
ARCHITECTS
LICENSE #AA0002730
648 Florida Avenue
Panama City, Fl. 32401

P 850/257-5400

Principal in Charge
Joseph J. Sorci
Project Number:
4166-2
Date Issued:
5-7-2015

Checked By

COAST STATE COLLEGE
PHASE 1 CAMPUS

GULF

TITLE SHEET, INDEX OF DRAWINGS, ENLARGED SITE PLAN

BID DOCUMENTS

Sheet Number A0.00

GENERAL NOTES:

- 1. THE BENCHMARK DATUM USED FOR THE PLANS IS NAVD88.
- ANY PUBLIC LAND CORNER OR MONUMENT THAT PERPETUATES BAY COUNTY RIGHT OF WAY WITHIN THE PROJECT LIMITS IS TO BE PROTECTED BY THE CONTRACTOR. IF A MONUMENT IS IN DANGER OF BEING DESTROYED THE CONTRACTOR IS TO ENSURE THAT IT IS PROPERLY REFERENCED AND RESET PRIOR TO PROJECT COMPLETION. THE MONUMENTS SET SHALL MEET MINIMUM TECHNICAL STANDARDS AS DEFINED IN 61G17, F.A.C. AND CURRENT BAY COUNTY SURVEYING STANDARDS.
- 3. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH FDOT 2013 DESIGN STANDARDS AND STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, UNLESS OTHERWISE STATED OR SHOWN IN THE PLANS.
- 4. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE CITY OF PANAMA CITY STANDARDS AND SPECIFICATIONS, UNLESS APPROVED BY THE CITY OF PANAMA CITY.
- 5. THE CONTRACTOR SHALL NOT BRING ANY HAZARDOUS MATERIALS ONTO THE PROJECT. SHOULD THE CONTRACTOR REQUIRE SUCH MATERIALS FOR PERFORMING THE CONTRACTED WORK, THE CONTRACTOR SHALL REQUEST, IN WRITING, WRITTEN PERMISSION FROM THE PROJECT ADMINISTRATOR. THE CONTRACTOR SHALL PROVIDE THE PROJECT ADMINISTRATOR WITH A COPY OF THE MATERIAL SAFETY DATA SHEET (MSDS) FOR EACH HAZARDOUS MATERIAL PROPOSED FOR USE. THE CONSTRUCTION PROJECT ADMINSTRATOR SHALL COORDINATE WITH THE ENGINEER OF RECORD PRIOR TO ISSUING WRITTEN APPROVAL TO THE CONTRACTOR. SINCE STATE LAW DOES NOT TREAT PETROLEUM PRODUCTS THAT ARE PROPERLY CONTAINERIZED AND INTENDED FOR EQUIPMENT USE AS A HAZARDOUS MATERIAL, SUCH PRODUCTS DO NOT NEED A MSDS SUBMITTAL.
- ANY KNOWN OR SUSPECTED HAZARDOUS MATERIAL FOUND ON THE PROJECT SHALL IMMEDIATELY BE REPORTED TO THE CONSTRUCTION PROJECT ADMINISTRATOR WHO SHALL DIRECT THE CONTRACTOR TO PROTECT THE AREA OF KNOWN OR SUSPECTED CONTAMINATION FROM FURTHER ACCESS. THE CONSTRUCTION PROJECT ADMINISTRATOR IS TO NOTIFY THE PROJECT MANAGER OF DISCOVERY. THE PROJECT MANAGER WILL ARRANGE AN INVESTIGATION, IDENTIFICATION AND REMEDIATION OF THE HAZARDOUS MATERIAL. THE CONTRACTOR SHALL NOT RETURN TO THE AREA OF CONTAMINATION UNTIL APPROVAL IS PROVIDED BY THE CONSTRUCTION PROJECT ADMINISTRATOR.
- 7. THE CONTRACTOR SHALL NOTIFY UTILITY OWNERS THROUGH SUNSHINE ONE CALL OF FLORIDA, INC. TWO BUSINESS DAYS IN ADVANCE OF BEGINNING CONSTRUCTION ON THE JOB SITE. CALL 1-800-432-4770 AND 811 (NATIONWIDE TOLL FREE UTILITY LOCATE). THE LOCATION OF THE UTILITIES SHOWN ON THE PLANS ARE APPROXIMATE ONLY. THE EXACT LOCATION SHALL BE DETERMINED BY THE CONTRACTOR DURING CONSTRUCTION.
- 8. INFORMATION SHOWN ON THE PLANS CONCERNING THE TYPE AND LOCATION OF UNDERGROUND AND OVERHEAD UTILITIES IS BASED ON DATA PROVIDED BY UTILITY OWNERS, AVAILABLE RECORDS, AND FIELD SURVEYS. THE PLANS MAY NOT SHOW ALL UTILITIES WITHIN PROJECT LIMITS, EITHER ACTIVE OR PLACED OUT-OF-SERVICE, OR THAT SAID UTILITIES ARE ACTUALLY IN THE HORIZONTAL OR VERTICAL POSITIONS SHOWN IN THE PLANS. DETERMINE THE TYPE AND LOCATION OF ALL UTILITIES TO ESTABLISH THEIR LOCATIONS AND TO AVOID DAMAGE TO UNDERGROUND UTILITIES.
- 9. UTILITY ADJUSTMENTS ARE TO BE PERFORMED BY THE UTILITY OWNERS UNLESS OTHERWISE NOTED.
- 10. SWEEPING SHALL OCCUR DAILY OR AFTER SUCH EVENTS AS CAUSE TRACKING ONTO STREET.
- 11. ALL PROPOSED GROUND ELEVATIONS ARE FINISHED SOD ELEVATIONS. FINISH EARTHWORK GRADING SHALL BE 0.2 FEET BELOW ELEVATIONS SHOWN TO ALLOW FOR SOD THICKNESS.
- 12. SODDING INCLUDES MAINTAINING SLOPES AND SOD UNTIL COMPLETION AND ACCEPTANCE OF TOTAL PROJECT OR GROWTH IS ESTABLISHED, WHICHEVER COMES LAST. UNTIL THEN, ALL EROSION, SILTATION AND MAINTENANCE OF GRADES IS THE RESPONSIBILITY OF THE CONTRACTOR.
- 13. WHERE EXCAVATIONS ARE IN CLOSE PROXIMITY OF TREES NOT SHOWN AS BEING REMOVED, THE CONTRACTOR SHALL USE EXTREME CARE IN NOT DAMAGING THE ROOT SYSTEM. NO EQUIPMENT, SUPPLIES, OR VEHICLES SHALL BE STORED OR PARKED WITHIN THE DRIP LINE OF TREES TO REMAIN AND BE PRESERVED. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO INFORM ALL EMPLOYEES AND SUBCONTRACTORS OF THIS REQUIREMENT AND TO ENFORCE SAME.
- 14. PROPOSED CONSTRUCTION SHALL COMPLY WITH THE AMERICANS WITH DISABILITIES ACT (ADA), THE ADA COMPLIANCE HANDBOOK, LATEST EDITION, AND THE FLORIDA ACCESSIBILITY CODE. SIDEWALK CONSTRUCTION AND EXPANSION JOINT SPACING SHALL BE IN ACCORDANCE WITH FDOT DESIGN STANDARD INDEX 310.
- 15. ALL INLETS SHALL BE PROTECTED AS PER FDEP BEST MANAGEMENT PRACTICES, AND THE FDEP/FDOT EROSION AND SEDIMENT CONTROL HANDBOOK.
- 16. THE CONTRACTOR SHALL PROTECT ALL GRASSED AREAS FROM DISCARDED CONCRETE AND EXCESS MATERIALS. ALL DISCARDED CONCRETE AND EXCESS MATERIALS SHALL BE REMOVED FROM THE RIGHT-OF-WAY (OR JOB SITE) ON A DAILY BASIS.
- 17. THE CONTRACTOR SHALL DISPOSE OF ALL DEBRIS UPON COMPLETION OF THE PROJECT.
- 18. THE EROSION CONTROL PLAN SHALL BE IN ACCORDANCE WITH THE FDOT/FDEP EROSION & SEDIMENT CONTROL HANDBOOK.
- 19. ALL FILL MATERIAL SHALL BE SELECT FILL AS DEFINED BY FDOT DESIGN STANDARD INDEX 505.
- 20. DEWATERING: SHOULD LOWERING OF GROUNDWATER BE NECESSARY FOR THE INSTALLATION OF CONCRETE STRUCTURES, OR TO PREVENT LATERAL MOVEMENT OF CONCRETE ALREADY PLACED, SUCH LOWERING SHALL BE ACCOMPLISHED BY MEANS OF A WELL POINT SYSTEM OR OTHER APPROVED MEANS, AT CONTRACTOR'S EXPENSE. COMPREHENSIVE PLANS FOR DEWATERING OPERATIONS, IF USED, SHALL BE SUBMITTED BY THE CONTRACTOR PRIOR TO INSTALLATION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL PERMITTING ASSOCIATED WITH DEWATERING.
- 21. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ACQUIRING NPDES PERMIT.
- 22. THE CONTRACTOR SHALL REPAIR OR REPLACE ANY METERS, VALVES, SERVICE LATERALS, FIRE HYDRANTS, MAINS, WATER, WASTEWATER, OR GAS FACILITIES DAMAGED DURING CONSTRUCTION AT NO ADDITIONAL COST.
- 23. ALL PROPOSED INLETS SHALL HAVE 18" SUMP BOTTOMS ,OPEN BOTTOMS SHALL NOT BE ALLOWED IN AREAS WHERE HIGH GROUNDWATER EXISTS.
- 24. ALL DEMOLISHED MATERIALS SHALL BE REMOVED FROM SITE AND DISPOSED OF IN A LEGAL MANNER.
- 25. CONTRACTOR SHALL PROVIDE (5) SIGNED AND SEALED AS-BUILT SURVEYS PREPARED BY A REGISTERED FLORIDA SURVEYOR. A DIGITAL (AUTOCAD) FILE SHALL ALSO BE PROVIDED.

UTILITY GENERAL NOTES:

- 1. ALL MAINS SHALL BE INSTALLED ACCORDING TO ENGINEERING PLANS AND SPECIFICATIONS
- 2. ALL VALVES AND MATERIALS SHALL COMPLY WITH AWWA (AMERICAN WATER WORKS ASSOCIATION) STANDARDS, LATEST
- 3. ALL MAIN LINE VALVES SHALL BE RESILIENT SEATED GATE VALVES.
- 4. THE CONTRACTOR WILL BE REQUIRED TO REMOVE & REPLACE ITEMS ENCOUNTERED IN THE FIELD, ie SIGNS, FENCING,
- 5. MAINS SHALL HAVE A MINIMUM OF 36" COVER UNLESS APPROVED BY ENGINEER.
- 6. CONTRACTOR IS TO FURNISH "AS BUILT PLANS" INDICATING LOCATIONS OF ALL FITTINGS, VALVES, AND DEAD END RUNS WITH THREE (3) PHYSICAL FEATURES (LOT CORNERS, TREES, ETC.).
- 7. ALL WATER MAINS SHALL BE DISINFECTED IN ACCORDANCE WITH AWWA C651. PRESSURE TESTING SHALL BE IN ACCORDANCE WITH AWWA C600
- 8. CONTRACTOR SHALL NOTIFY AND COORDINATE WITH ENGINEER 48 HOURS PRIOR TO PRESSURE TESTING, DISINFECTION, AND BACTERIOLOGICAL TESTING. PRESSURE TESTING SHALL BE VALVE TO VALVE. CONTRACTOR SHALL USE 2" AIR RELEASE VALVE PORTS OR SHALL TAP THE WATER MAIN WITH A 1" TAPPING SADDLE
- 9. BASE AND BACKFILL MATERIALS SHALL BE EITHER OF THE SAME TYPE AND COMPOSITION AS THE MATERIALS REMOVED, OR OF EQUAL OR GREATER STRUCTURAL ADEQUACY. MATERIALS CONTAMINATED WITH DELETERIOUS SUBSTANCES DURING EXCAVATION SHALL NOT BE USED FOR FILL
- 10. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL FITTINGS, TAPS, EQUIPMENT AS REQUIRED FOR FLUSHING SYSTEM, PRESSURE TESTING, DISINFECTION, AND BACTERIOLOGICAL TESTING.
- 11. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT LOCATION OF EXISTING UTILITIES, AND TO DETERMINE IF OTHER UTILITIES WILL BE ENCOUNTERED DURING THE COURSE OF THE WORK, AND TAKE WHATEVER STEP NECESSARY TO PROVIDE FOR THEIR PROTECTION.
- 12. UTILITIES SHOW ON THE PLAN MAY NOT BE ACCURATE AND ALL UTILITIES MAY NOT BE SHOWN.
- 13. THE CONTRACTOR SHALL NOTIFY ALL UTILITY OWNERS 48 HOURS PRIOR TO COMMENCING CONSTRUCTION AND SHALL VERIFY LOCATION OF ALL UTILITIES PRIOR TO EXCAVATION.
- 14. ALL VALVE BOXES SHALL BE INSTALLED PER DETAIL SHOWN. PRE-CAST VALVE PADS SHALL NOT BE USED. ALL VALVE BOX RISERS SHALL BE DUCTILE IRON, NOT PVC.
- 15. ALL PAVEMENT SHALL BE CUT AND PATCHED IN ACCORDANCE WITH ENGINEERING PLANS AND SPECIFICATIONS.
- 16. ALL CONCRETE ENCASED DUCTILE IRON SHALL BE WRAPPED WITH A PLASTIC MATERIAL AND TAPED TOGETHER BEFORE CONCRETE IS PLACED AROUND THE PIPE.
- 17. WHERE THERE IS LESS THAN 12" CLEARANCE BETWEEN PVC/DI PIPE AND OTHER PIPE OR SPECIFIED AREAS, THE PIPE SHALL BE ENCASED WITH 6" THICKNESS AROUND THE PIPE AND 6' CLEARANCE EACH WAY IN THE AXIAL DIRECTION.
- 18. THE CONTRACTOR SHALL REMOVE AND REPLACE, TO THEIR ORIGINAL NATURE, ALL DISTURBED MATERIALS OR OBJECTS WITHIN THE PATH OF THE NEW UTILITIES AS NECESSARY. ALL REPLACED MATERIALS SHALL BE EQUAL OR BETTER AND SHALL BE APPROVED BY THE ENGINEER. THIS INCLUDES ALL LANDSCAPING WITHIN THE RIGHT OF WAY IN THE PATH OF
- 19. THE CONTRACTOR SHALL VISIT THE SITE PRIOR TO BIDDING. THE SURVEY MAY NOT SHOW ALL OBJECTS WITHIN THE PATH OF THE NEW UTILITIES. IF OBJECTS ARE NOT SHOWN ON THE SURVEY, THE CONTRACTOR SHALL NOTIFY THE ENGINEER WITHIN 7 DAYS PRIOR TO THE BID DATE. CONTRACTOR WILL BE RESPONSIBLE FOR REPLACEMENT OF ALL OBJECTS NOT
- 20. ALL CONSTRUCTION AREAS NEAR WETLANDS ARE TO BE MONITORED CLOSELY FOR EROSION. SILT FENCE AND HAY BALES SHALL BE USED IN THESE AREAS. CONTRACTOR SHALL FOLLOW ALL THE FDEP/COE DREDGE AND FILL PERMIT REQUIREMENTS IF APPLICABLE. SEE SPECIFICATIONS.
- 21. ALL SPOIL MATERIAL SHALL BE PLACED ON THE UPLAND SIDE OF ANY SLOPED CONSTRUCTION AREA.
- 22. THE CONTRACTOR SHALL TAKE WHATEVER STEPS NECESSARY TO PREVENT EROSION INTO NEARBY WETLANDS.
- 23. THE CONTRACTOR SHALL USE RESTRAINED JOINT PIPE FOR ALL BENDS, TEES, VALVES, AND TRANSITION FITTINGS.
- 24. INSULATED 12 GA. LOCATING WIRE SHALL BE INSTALLED ON TOP OF ALL NON-METALIC PIPE. WHICH INCLUDES SERVICE CONNECTIONS. ALL LOCATING WIRE SHALL BE CONNECTED AND SHALL TERMINATE IN VALVE BOXES AND METER BOXES AS SHOWN IN THE DETAILS.
- 25. ALL PIPE SHALL BE INSTALLED IN DRY CONDITIONS. WELL POINTING MAY BE REQUIRED AT THE DIRECTION OF THE ENGINEER. WELL POINTS OR SOCK PIPE MAY BE USED.
- 26. THE FLUSHING VELOCITY SHALL BE A MINIMUM OF 3 FEET PER SECOND FOR 3 TIMES THE PIPE VOLUME. THE OWNER WILL PAY FOR THE FIRST FLUSH AND PRESSURE TEST WATER. THE CONTRACTOR WILL PAY FOR ANY WATER FOR ADDITIONAL REPAIRS, FLUSHING, AND TESTING. THE CONTRACTOR SHALL PROVIDE ALL TEMPORARY ABOVE GROUND OUTLETS AND VALVES FOR FLUSHING THE PIPES ON THIS PROJECT.
- 27. CONTRACTOR SHALL FOLLOW ALL OSHA REQUIREMENTS FOR CONSTRUCTION.
- 28. THE CONTRACTOR SHALL FOLLOW ALL CONDITIONS OF THE PERMIT REQUIREMENTS. SEE SPECIFICATIONS FOR COPY OF
- 29. ALL DISTURBED AREAS SHALL BE SODDED.
- 30. A ONE FOOT STRIP OF SOD SHALL BE INSTALLED ON THE EDGE OF ALL ASPHALT OVERLAY AREAS AND AROUND ALL ABOVE GROUND CONCRETE STRUCTURES INCLUDING BUT NOT LIMITED TO VALVE PADS, BLOW OFF VAULTS, AND AIR RELEASE
- 31. CONTRACTOR SHALL PROVIDE ALL FITTINGS, SLEEVES AND TRANSITION ADAPTERS AS NECESSARY TO COMPLETE THIS PROJECT.
- 32. CONTRACTOR SHALL COMPLETE RESTORATION WITHIN 2 WEEKS OF SUCCESSFUL PIPE PRESSURE TESTING AT ANY GIVEN LOCATION. TEST SHALL BE PERFORMED VALVE TO VALVE WITHIN ONE WEEK OF COMPLETING THAT SECTION. PRESSURE TESTING SHALL TAKE PLACE EVERY 2 WEEKS DURING CONSTRUCTION FOR ANY PIPE INSTALLED IN THAT PERIOD.

UTILITY CONTACTS:

<u>OWNER</u>	<u>CONTACT</u>	<u>PHONE</u>
BAY COUNTY TRAFFIC	BOB EDMUNDS	850-248-8760
CITY OF PANAMA CITY	MATT STANDLEY	850-872-3191
KNOLOGY HOLDINGS	STEVE THOMAS	850-215-2138
COMCAST CABLE	JEFFERY SMITH	850-770-8056
SOUTHERN LIGHT	ANDRO BRAMBLETT	251-662-1170
GULF POWER	KENNY DOUGLAS	850-505-5567
AT&T	NANCY SPENCE	770-918-5424
AT&T DISTRIBUTION	DANNEY WATSON	334-850-7761
TECO GAS	ROLAND MOORE	850-914-6129

EROSION AND SEDIMENT CONTROL NOTES:

CONSTRUCTION:

- CONTRACTOR SHALL STAGE AND TIME CONSTRUCTION TO MINIMIZE THE SIZE OF EXPOSED SOIL AREAS AND THE TIME BETWEEN EXPOSING THE SOIL AREA AND FINISHING THE SOIL AREA.
- 2. AS SOON AS GRADING IS COMPLETE IN AN AREA, THE CONTRACTOR WILL STABILIZE THE SOIL. FOR LONG, NARROW AREAS, THE CONTRACTOR SHALL STABILIZE CONTINUOUSLY DURING GRADING OPERATIONS. ROUGH GRADED AREAS SHOULD BE STABILIZED WITH TEMPORARY EROSION CONTROL IF FINAL GRADING AND STABILIZATION WILL NOT BE PERFORMED WITHIN FIVE (5) DAYS. FAILURE TO STABILIZE EXPOSED SOIL AREAS IN A TIMELY MANNER AFTER GRADING MAY BE CONSIDERED A VIOLATION OF CHAPTERS 17-3, 17-12. AND/OR 17/25, FLORIDA ADMINISTRATIVE CODE, BY THE FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION (FDEP) AND SUBJECT TO CORRECTIVE ACTION, PURSUANT TO SECTION 403.121- 403.161 FLORIDA STATUTES.
- 3. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR PERFORMING A TASK TO PROVIDE EROSION CONTROL UNLESS ANOTHER PARTY HAS BEEN PREVIOUSLY SPECIFIED AS RESPONSIBLE FOR THE EROSION CONTROL ASSOCIATED WITH THAT TASK. IN THE EVENT ANOTHER PARTY IS RESPONSIBLE FOR EROSION CONTROL, THE CONTRACTOR SHALL STILL BE RESPONSIBLE FOR COORDINATION WITH THE PARTY RESPONSIBLE. IN THE EVENT THAT DAMAGE TO THE CONSTRUCTED ITEM RESULTS ARE DUE TO LACK OF EROSION CONTROL, THE CONTRACTOR SHALL REPAIR OR REPLACE THE ITEM AT NO CHARGE TO THE OWNER.
- 4. TEMPORARY EROSION CONTROL SHALL CONSIST OF TEMPORARY GRASS TEMPORARY MULCH, TEMPORARY SOD, ARTIFICIAL COVERINGS, BALED HAY OR STRAW, SILT FENCES, AND TURBIDITY BARRIERS. TEMPORARY EROSION CONTROL SHALL BE IN ACCORDANCE WITH SECTION 104 OF THE FLORIDA DEPARTMENT OF TRANSPORTATION (FDOT) STANDARD SPECIFICATIONS.
- 5. PERMANENT EROSION CONTROL SHALL CONSIST OF SEED, SEED AND MULCH, HYDRO-SEEDING, SOD, AND/OR ARTIFICIAL COVERINGS. PERMANENT EROSION CONTROL SHALL BE IN ACCORDANCE WITH SECTIONS 570 AND 575 OF THE FDOT STANDARD SPECIFICATIONS. SEED OR GRASS TYPE SHALL MATCH EXISTING OR BE AS SPECIFIED BY OWNER UNLESS NOTED
- 6. GRASS BY SEEDING SHALL BE IN ACCORDANCE WITH SECTIONS 104, 570, 981, 982, AND 983 OF FDOT STANDARD SPECIFICATIONS. THIS SHALL BE USED ONLY IN AREAS SUBJECT TO LIGHT EROSION SUCH AS FLAT AREAS.
- 7. GRASS BY HYDRO-SEEDING SHALL BE IN ACCORDANCE WITH SECTIONS 104. 570, 981, 982, AND 983 OF FDOT STANDARD SPECIFICATIONS. HYDRO-SEEDING MAY BE USED FOR FLAT AREAS AND SIDE SLOPES WHICH DO NOT EXCEED 2:1. DRAINAGE DITCHES OR LARGE SWALES MUST HAVE ADDITIONAL PROTECTION BESIDES HYDRO-SEEDING.
- 8. GRASS AND MULCH SHALL BE IN ACCORDANCE WITH SECTIONS 104, 570, 981, 982, AND 983 OF FDOT STANDARD SPECIFICATIONS. GRASS AND MULCH MAY BE USED IN ALL AREAS EXCEPT LARGE SWALES OR DITCHES. MULCH SHALL BE ANCHORED IN ACCORDANCE WITH SECTION 570. SOLID SOD SHALL BE IN ACCORDANCE WITH SECTIONS 104, 575, 981, 982, AND 983 OF FDOT STANDARD SPECIFICATIONS. SOD MAY BE USED IN ALL AREAS FOR SIDE SLOPES LESS THAN 2:1. SOD SHOULD NOT BE USED ON SLOPES GREATER THAN 1:2 (V:H). EROSION CONTROL BLANKETS WITH GRASSING OR OTHER SLOPE STABILIZATION TECHNIQUES SHOULD BE USED ON SLOPES GREATER THAN 1:2. SOD SHALL BE STAGGERED SO AS TO AVOID A CONTINUOUS SEAM. IN AREAS WITH SLOPES 3:1 OR STEEPER, EACH PIECE OF SOD SHALL BE PEGGED WITH SOD PEGS. IN DIFFICULT SOIL CONDITIONS WITH STEEP SLOPES, IT MAY NECESSARY TO COVER SOD WITH ARTIFICIAL COVERINGS SUCH AS JUTE MESH UNTIL SOD BECOMES ESTABLISHED.
- 9. TEMPORARY EROSION CONTROL BY ARTIFICIAL COVERINGS SHALL CONSIST OF STRAW BLANKETS, COCONUT FIBER BLANKETS, POLYESTER BLANKETS, JUTE MESH, AND DRAINAGE FABRICS. MATERIALS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. SEEDING SHALL BE INCLUDED IF MATERIAL REQUIRES VEGETATION TO FUNCTION PROPERLY.
- 10. THE CONTRACTOR IS TO PROVIDE EROSION CONTROL/ SEDIMENTATION BARRIER (HAY BALES, SILT FENCE, TURBIDITY BARRIER, OR AS SPECIFIED IN THE CONSTRUCTION DRAWINGS) TO PREVENT SILTATION OF ADJACENT PROPERTY, STREETS, STORM SEWERS, WATERWAYS, AND WETLAND OR JURISDICTIONAL AREAS. IF, IN THE OPINION OF THE ENGINEER, AND/OR REGULATORY AUTHORITIES, EXCESSIVE QUANTITIES OF MATERIAL ARE TRANSPORTED OFFSITE BY EROSION OR STORM WATER RUNOFF, THE CONTRACTOR SHALL IMPROVE CONDITIONS TO THE SATISFACTION OF THE ENGINEER AND/OR AUTHORITIES IN NO CASE SHALL CONSTRUCTION COMMENCE PRIOR TO INSTALLATION OF EROSION CONTROL/SEDIMENTATION
- 11. CONTRACTOR SHALL PLACE STRAW, MULCH, OR OTHER SUITABLE MATERIAL ON GROUND IN AREAS WHERE CONSTRUCTION-RELATED TRAFFIC IS TO ENTER AND EXIT SITE.
- 12. IF WIND EROSION BECOMES SIGNIFICANT DURING CONSTRUCTION, THE CONTRACTOR SHALL STABILIZE THE AREA USING SPRINKLING IRRIGATION OR OTHER ACCEPTABLE METHODS.

MAINTENANCE:

- 13. THE CONTRACTOR SHALL PROVIDE ROUTINE MAINTENANCE OF PERMANENT AND TEMPORARY EROSION CONTROL FEATURES. UNTIL THE PROJECT IS COMPLETED AND ACCEPTED. THEN MAINTENANCE SHALL BE IN ACCORDANCE WITH SECTION 104 OF THE FLORIDA DEPARTMENT OF TRANSPORTATION (FDOT) STANDARD SPECIFICATIONS OR BAY COUNTY SPECIFICATIONS.
- 14. SILT FENCES AND TURBIDITY BARRIERS SHALL BE CHECKED DAILY FOR EFFECTIVENESS, BREACHES, AND ROUTINE MAINTENANCE.

PAVING, GRADING, AND EARTH WORK NOTES:

CONSTRUCTION:

- 1. ALL AREAS DISTURBED BY CONSTRUCTION ACTIVITIES SHALL BE SEEDED, MULCHED, SODDED, STABILIZED, OR PLANTED WITH OTHER APPROVED LANDSCAPE MATERIAL, WITHIN FIVE (5) DAYS AFTER CONSTRUCTION.
- 2. ALL WASTE MATERIAL SHALL BE DISPOSED OF OFFSITE IN ACCORDANCE WITH APPLICABLE REGULATIONS.
- 3. PROPOSED SPOT ELEVATIONS REPRESENT PAVEMENT OR GROUND SURFACE GRADE UNLESS OTHERWISE NOTED ON DRAWINGS.
- 4. CONTRACTOR TO PROVIDE 1/2" TO 1" BITUMINOUS EXPANSION JOINT MATERIAL WITH SEALER AT ABUTMENT OF CONCRETE AND OTHER MATERIALS (BUILDINGS, OTHER POURED CONCRETE, ETC.) EXCEPT ASPHALT.
- 5. CONTRACTOR SHALL TRIM, TACK AND MATCH EXISTING PAVEMENT AT LOCATIONS WHERE NEW PAVEMENT ABUTS.
- 6. TESTING SHALL BE IN GENERAL CONFORMANCE WITH THE FDOT SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION, LATEST EDITION. SELECTION AND CONTRACTING WITH THE TESTING FIRMS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE AND SCHEDULE ALL TESTS, AND PROVIDE TO THE ENGINEER OF RECORD.
- 7. ALL POTHOLES WITHIN THE LIMITS OF PROJECT SHALL BE FILLED WITH ASPHALT AND COMPACTED PRIOR TO RESURFACING.
- 8. TOP SOIL SHALL BE PLACED IN AREAS WHERE SOD IS PROPOSED, PRIOR TO INSTALLATION OF SOD.

SIGNING AND MARKING NOTES:

- 1. FOR SIGN DETAILS, USE THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES PUBLISHED BY THE US DEPARTMENT OF TRANSPORTATION, FEDERAL HIGHWAY ADMINISTRATION, 2009.
- 2. ALL SIGNAGE AND WHEEL STOPS SHALL BE REMOVED AND STOCKPILED ON SITE. CONTRACTOR SHALL COORDINATE STOCKPILE LOCATION WITH PROJECT ADMINISTRATOR.
- 3. THE SIGN LOCATIONS ARE APPROXIMATE AND MAY REQUIRE FIELD ADJUSTMENT AS DIRECTED BY THE PROJECT ADMINISTRATOR.
- 4. SIGNING AND PAVEMENT MARKINGS SHALL BE PLACED IN ACCORDANCE WITH CURRENT MUTCD, AMERICANS WITH DISABILITIES ACT, FDOT DESIGN STANDARDS (CURRENT EDITION), AND THE PLANS.
- 5. THE PAVEMENT MARKINGS AT ALL EXISTING/PROPOSED INTERFACE LOCATIONS SHALL MATCH IN TERMS OF ALIGNMENT AND COLOR.
- 6. ALL FINAL PROPOSED STRIPING AND MESSAGES SHALL BE THERMOPLASTIC. TEMPORARY STRIPING SHALL BE PAINT.



648 Florida Avenue Panama City, Fl. 32401

> JONATHAN SKLARSKI FL. P.E. 67361

P 850/257-5400

Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued 5-7-2015 Drawn By: Checked By Revisions:




7 S OAS S PHA

(7)

GU

BID DOCUMENTS

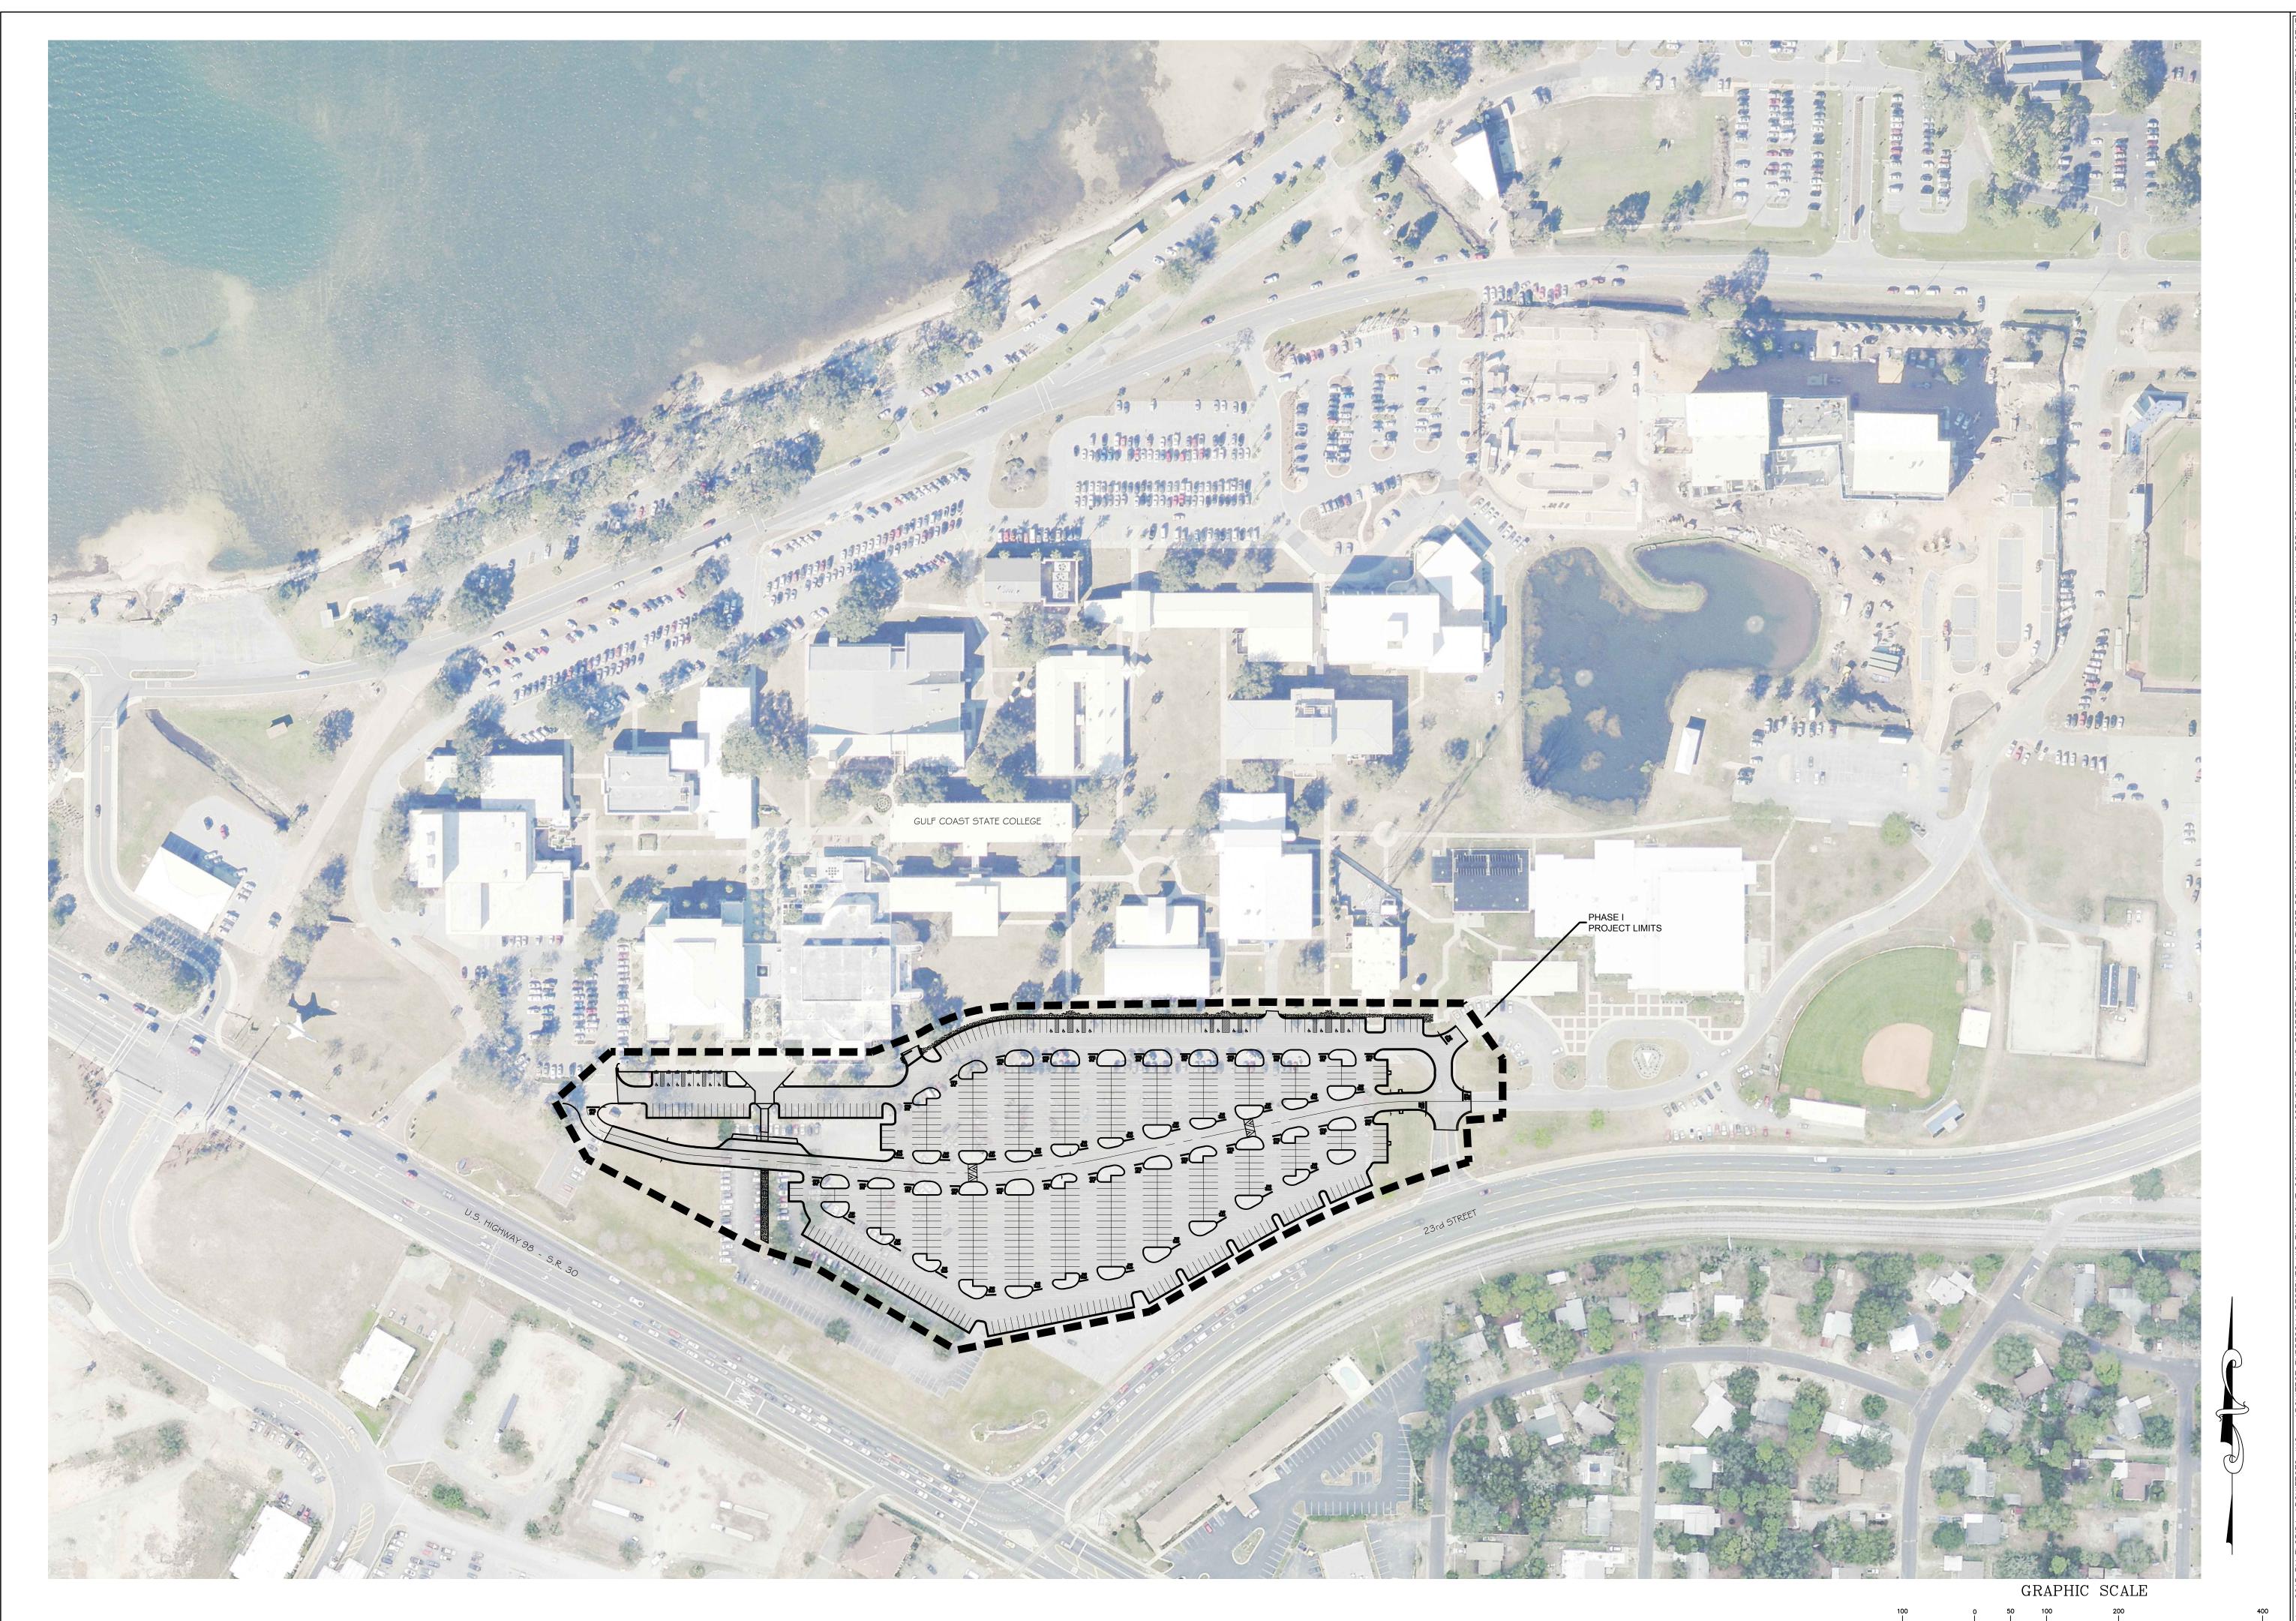

FLORIDA
ARCHITECTS
UCENSE #AA0002730
648 Florida Avenue
Panama City, Fl. 32401
P 850/257-5400

JONATHAN SKLARSKI FL. P.E. 67361

Principal in Charge
Joseph J. Sorci
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
BWR
Checked By:
J.S.
Revisions:

REBLE-RISH, INC


GULF COAST STATE COLLEGE
PHASE 1 CAMPUS

ALL SITE PLAN

BID DOCUMENTS

Sheet Number

(IN FEET)

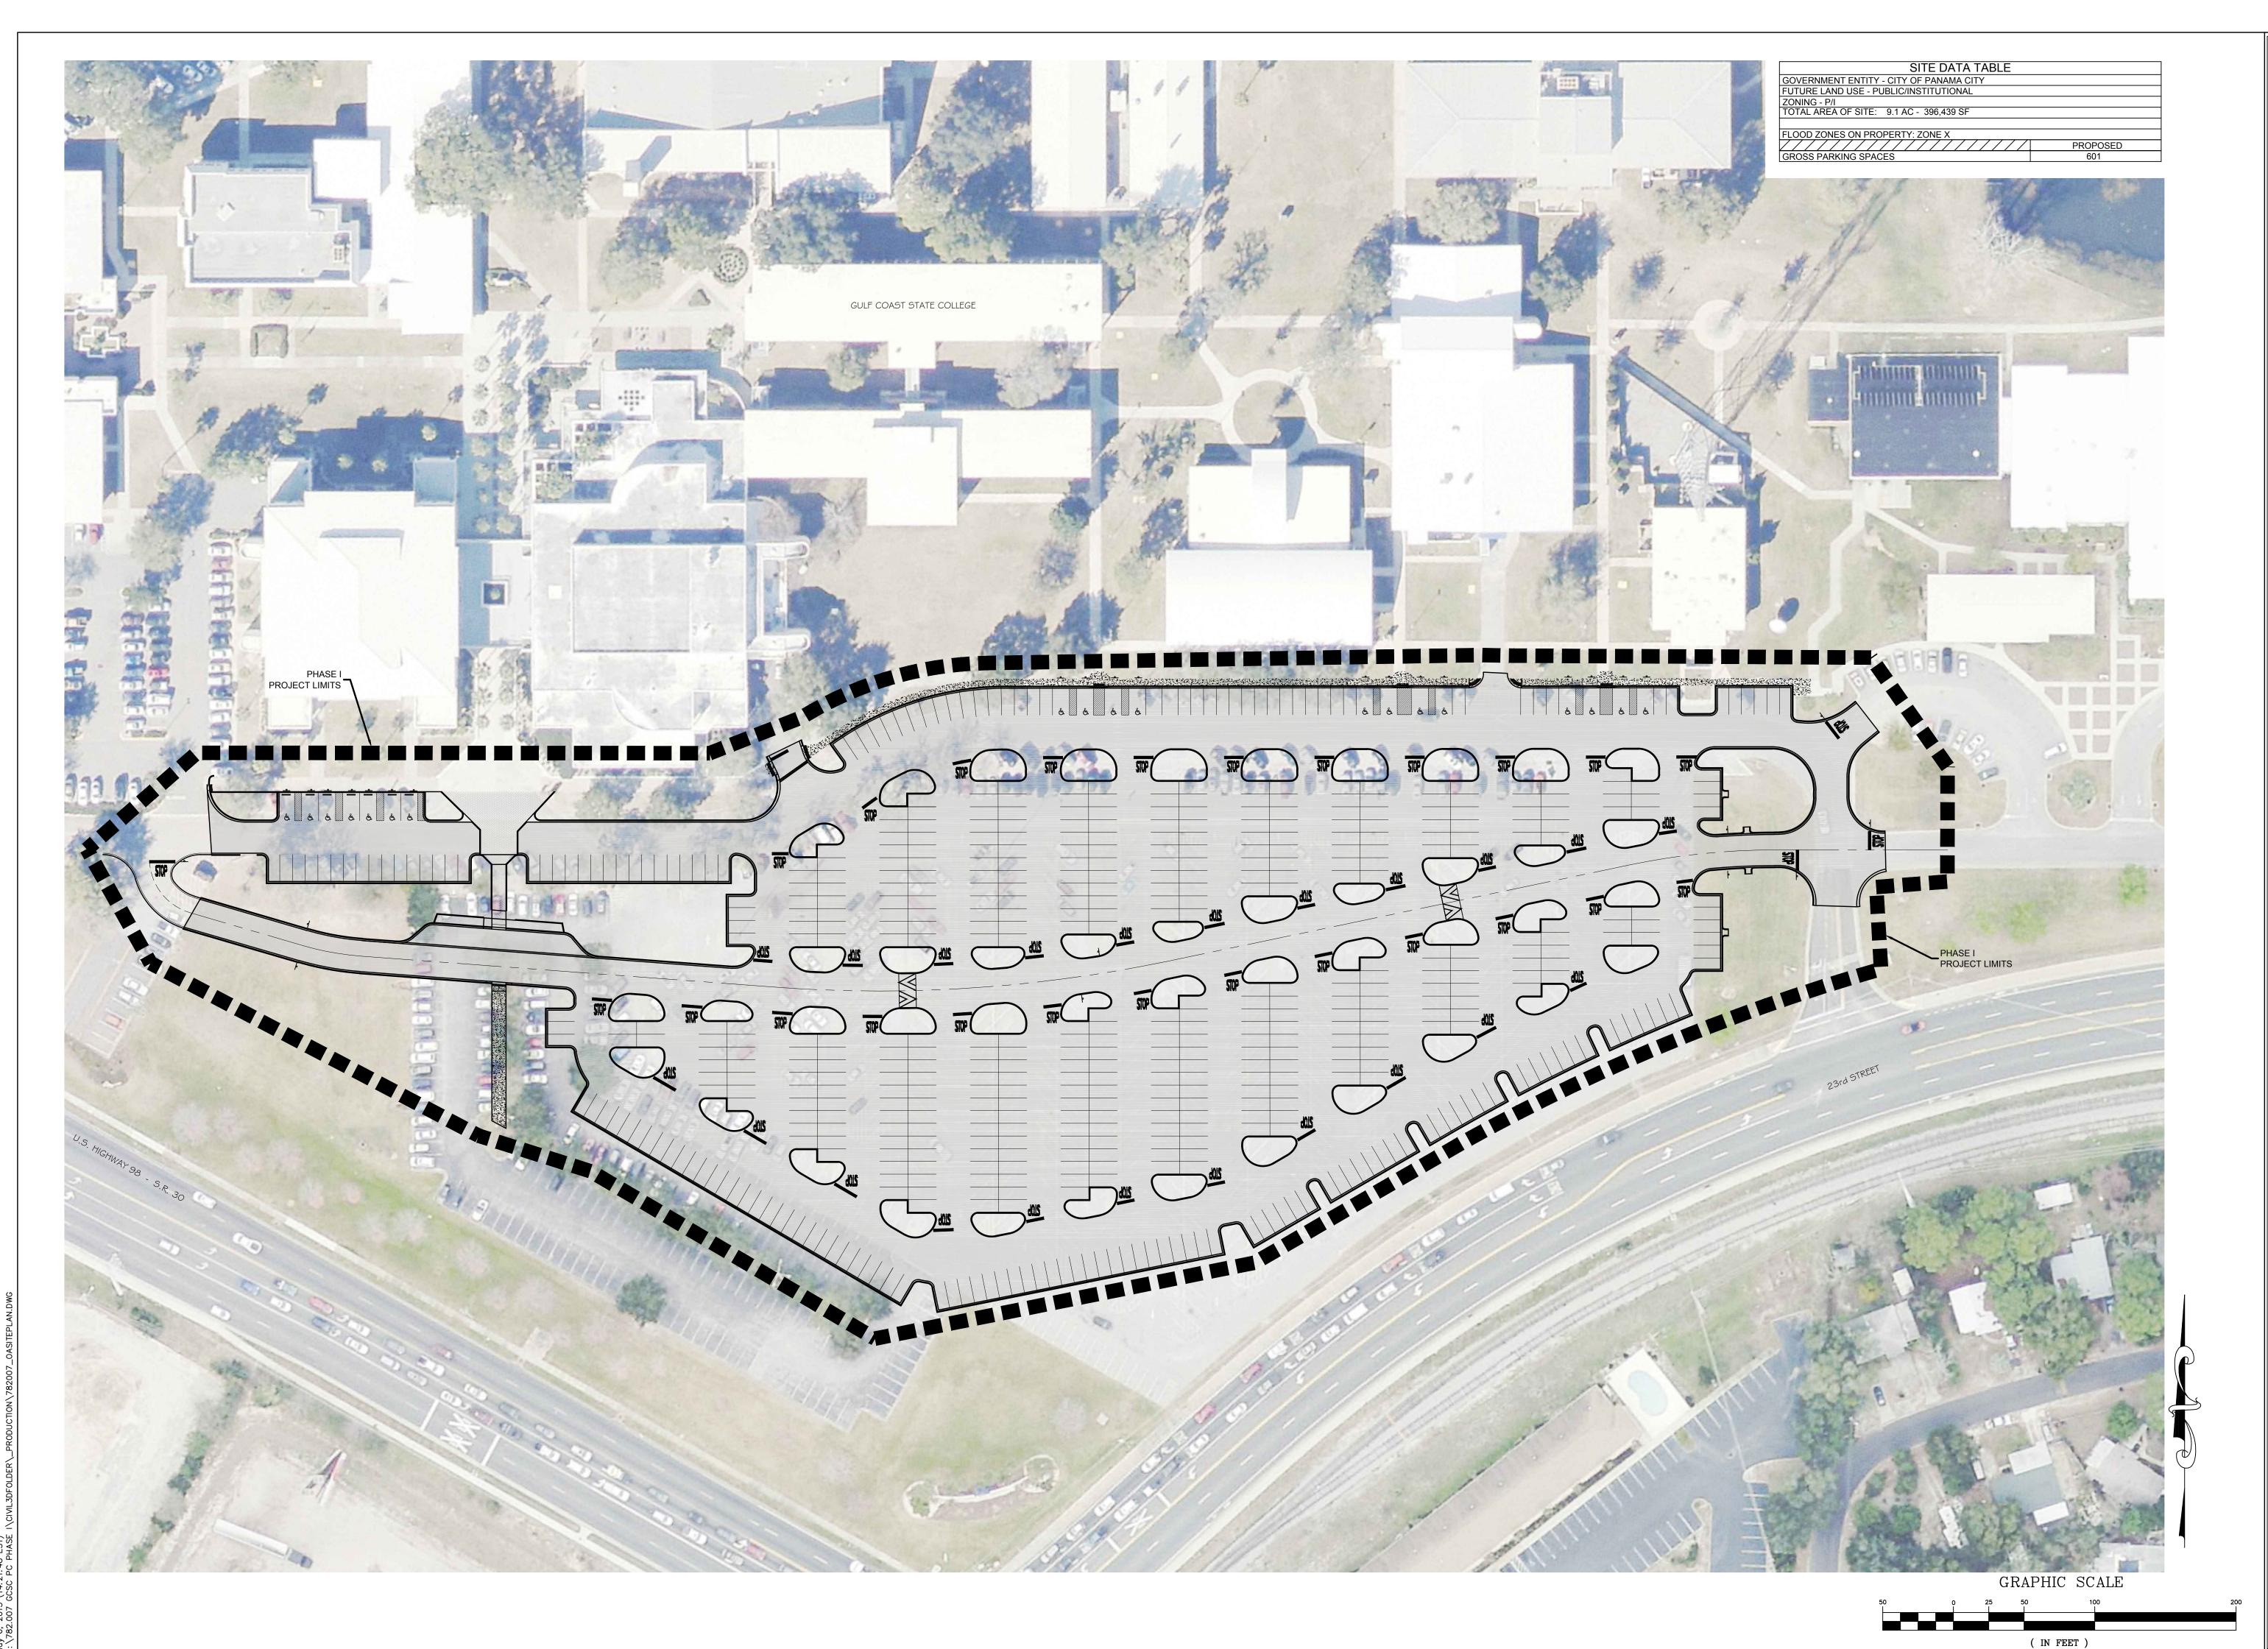

F L O R I D A ARCHITECTS LICENSE #AA0002730 648 Florida Avenue

Panama City, Fl. 32401 P 850/257-5400

JONATHAN SKLARSKI FL. P.E. 67361

Principal in Charge
Joseph J. Sorci
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
BWR
Checked By:
J.S.
Revisions:


REBLE-RISH, INC

GULF COAST STATE COLLEGE PHASE 1 CAMPUS

PROJECT LIMITS

BID DOCUMENTS

Sheet Number

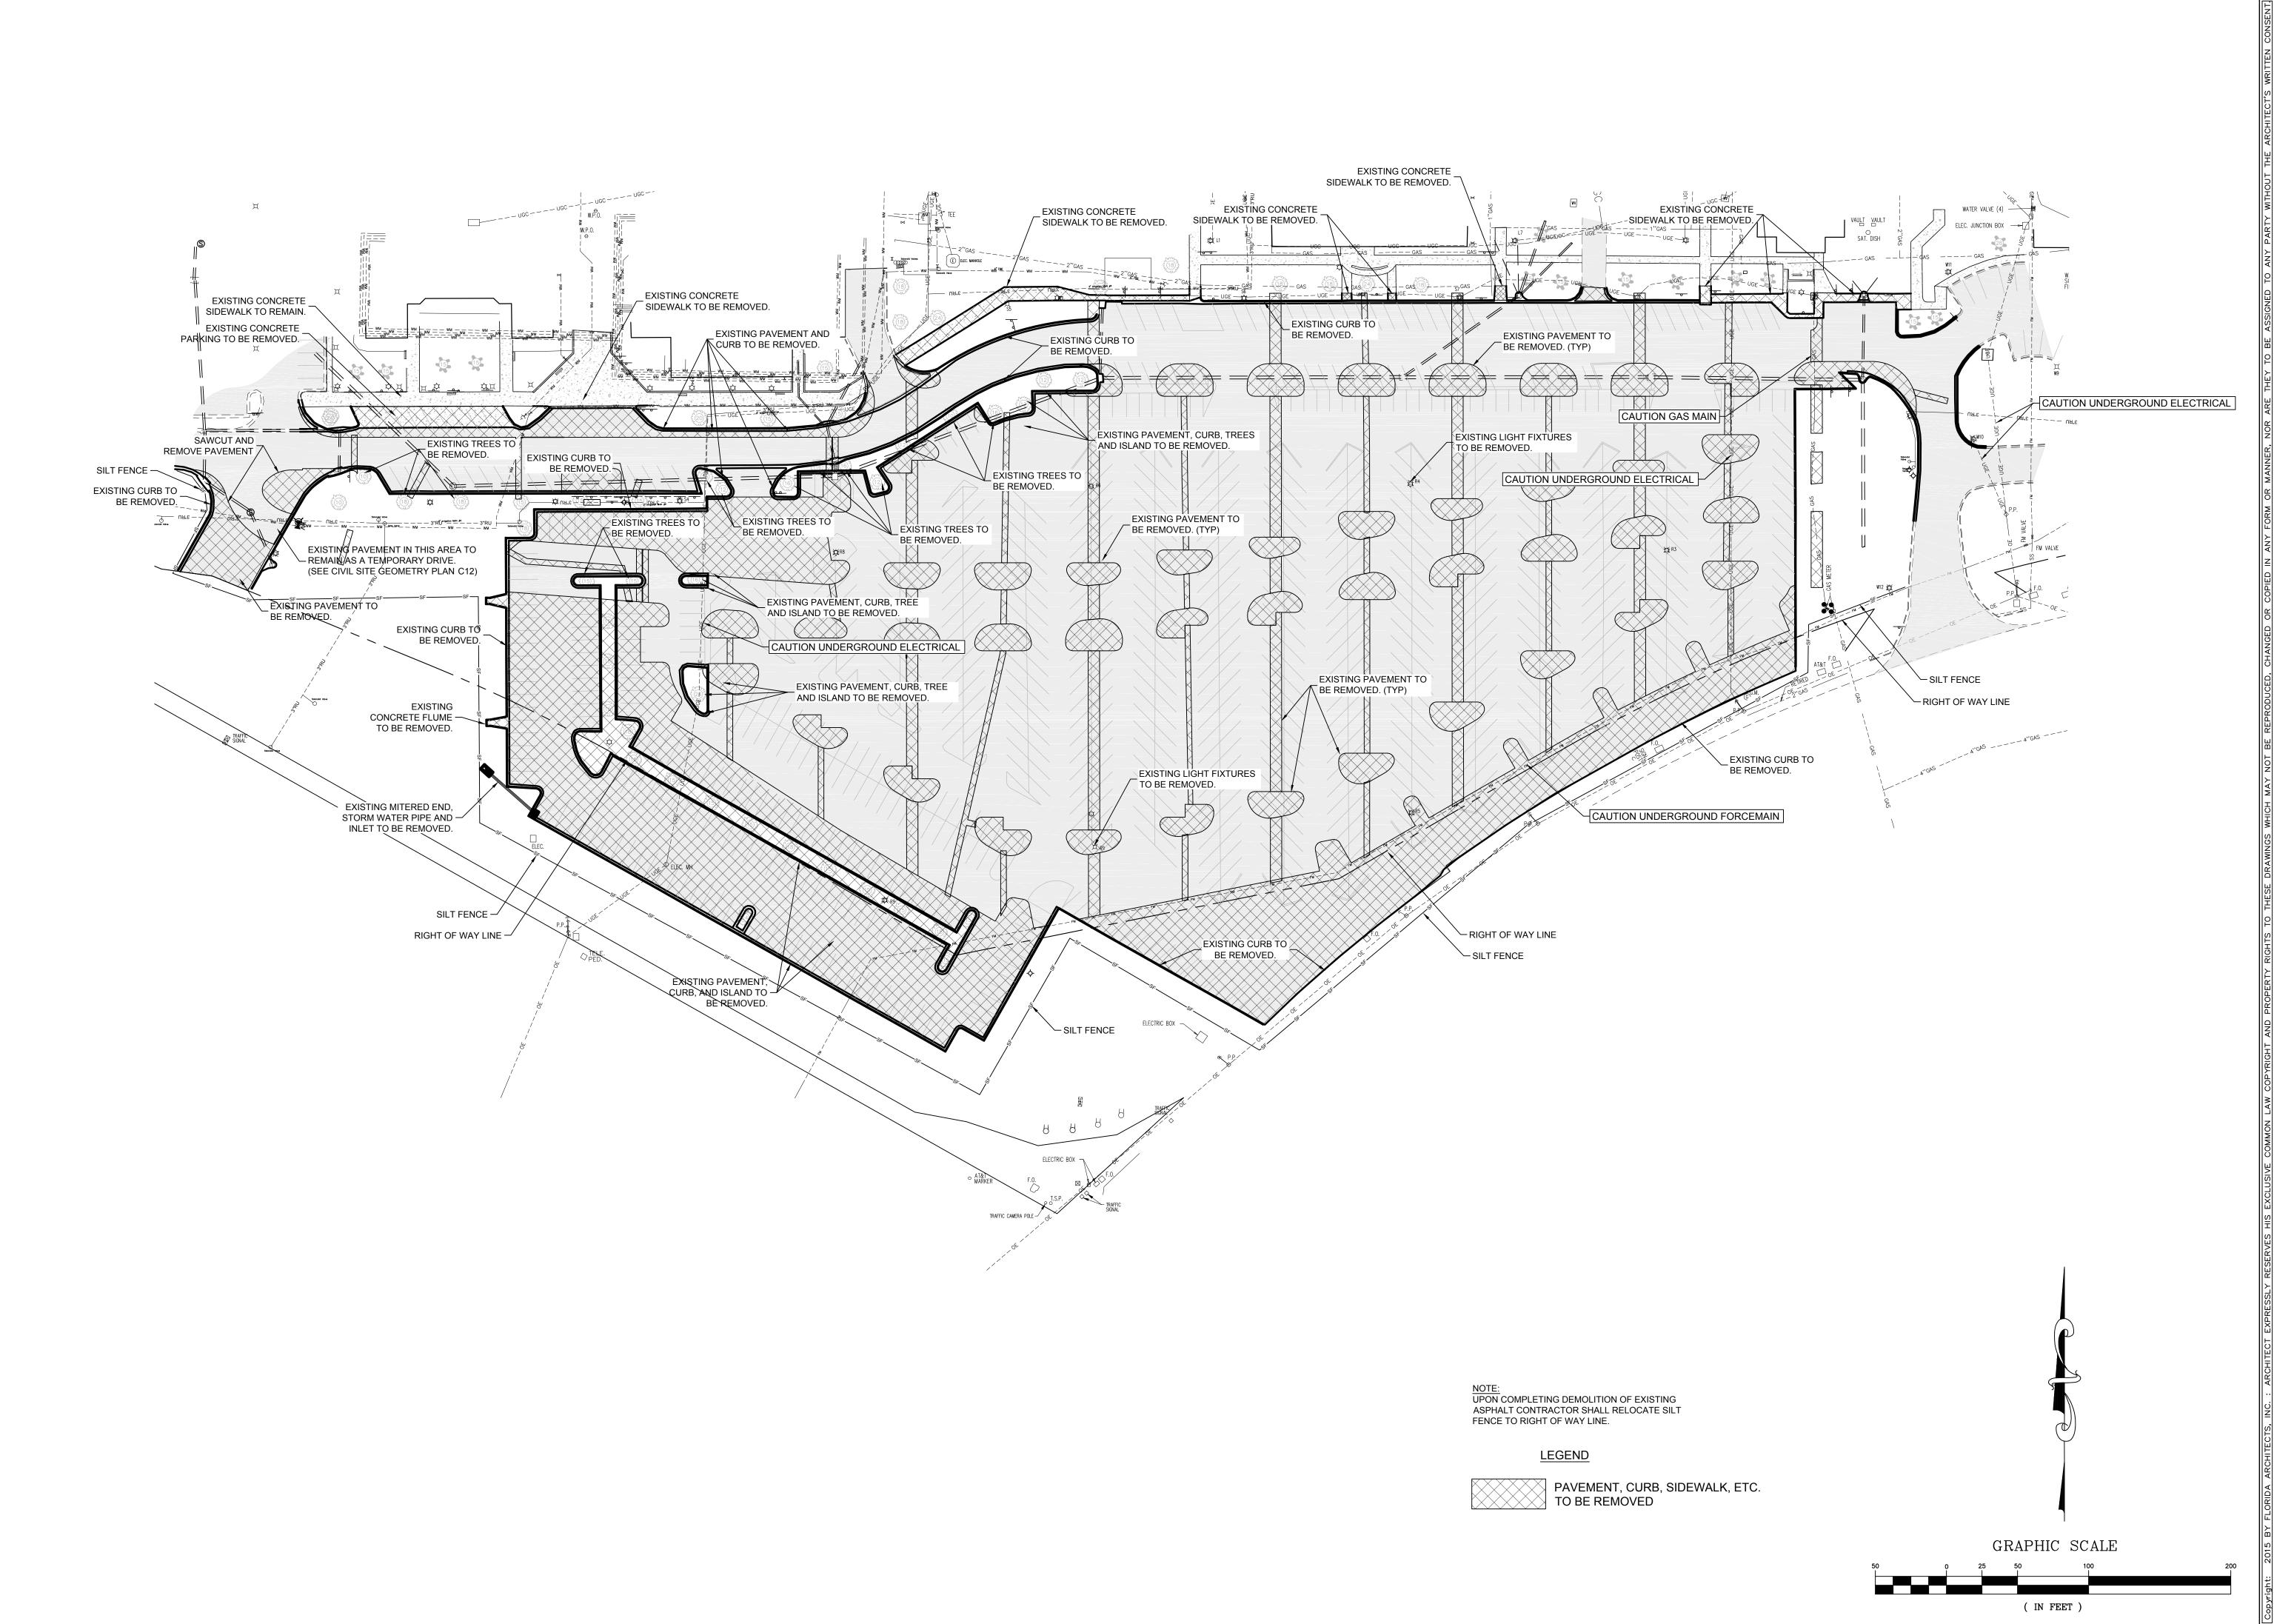

LICENSE #AA0002730 648 Florida Avenue

Panama City, Fl. 32401 P 850/257-5400

> JONATHAN SKLARSKI FL. P.E. 67361

> > Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By: BWR Checked By: J.S. Revisions:

PREBLE-RISH, INC


COAST STATE COLLEGE

CAMPUS IMPROVEMENTS **PHASE** GULF

EROSION AND

CONTROL DEMOLITION

BID DOCUMENTS

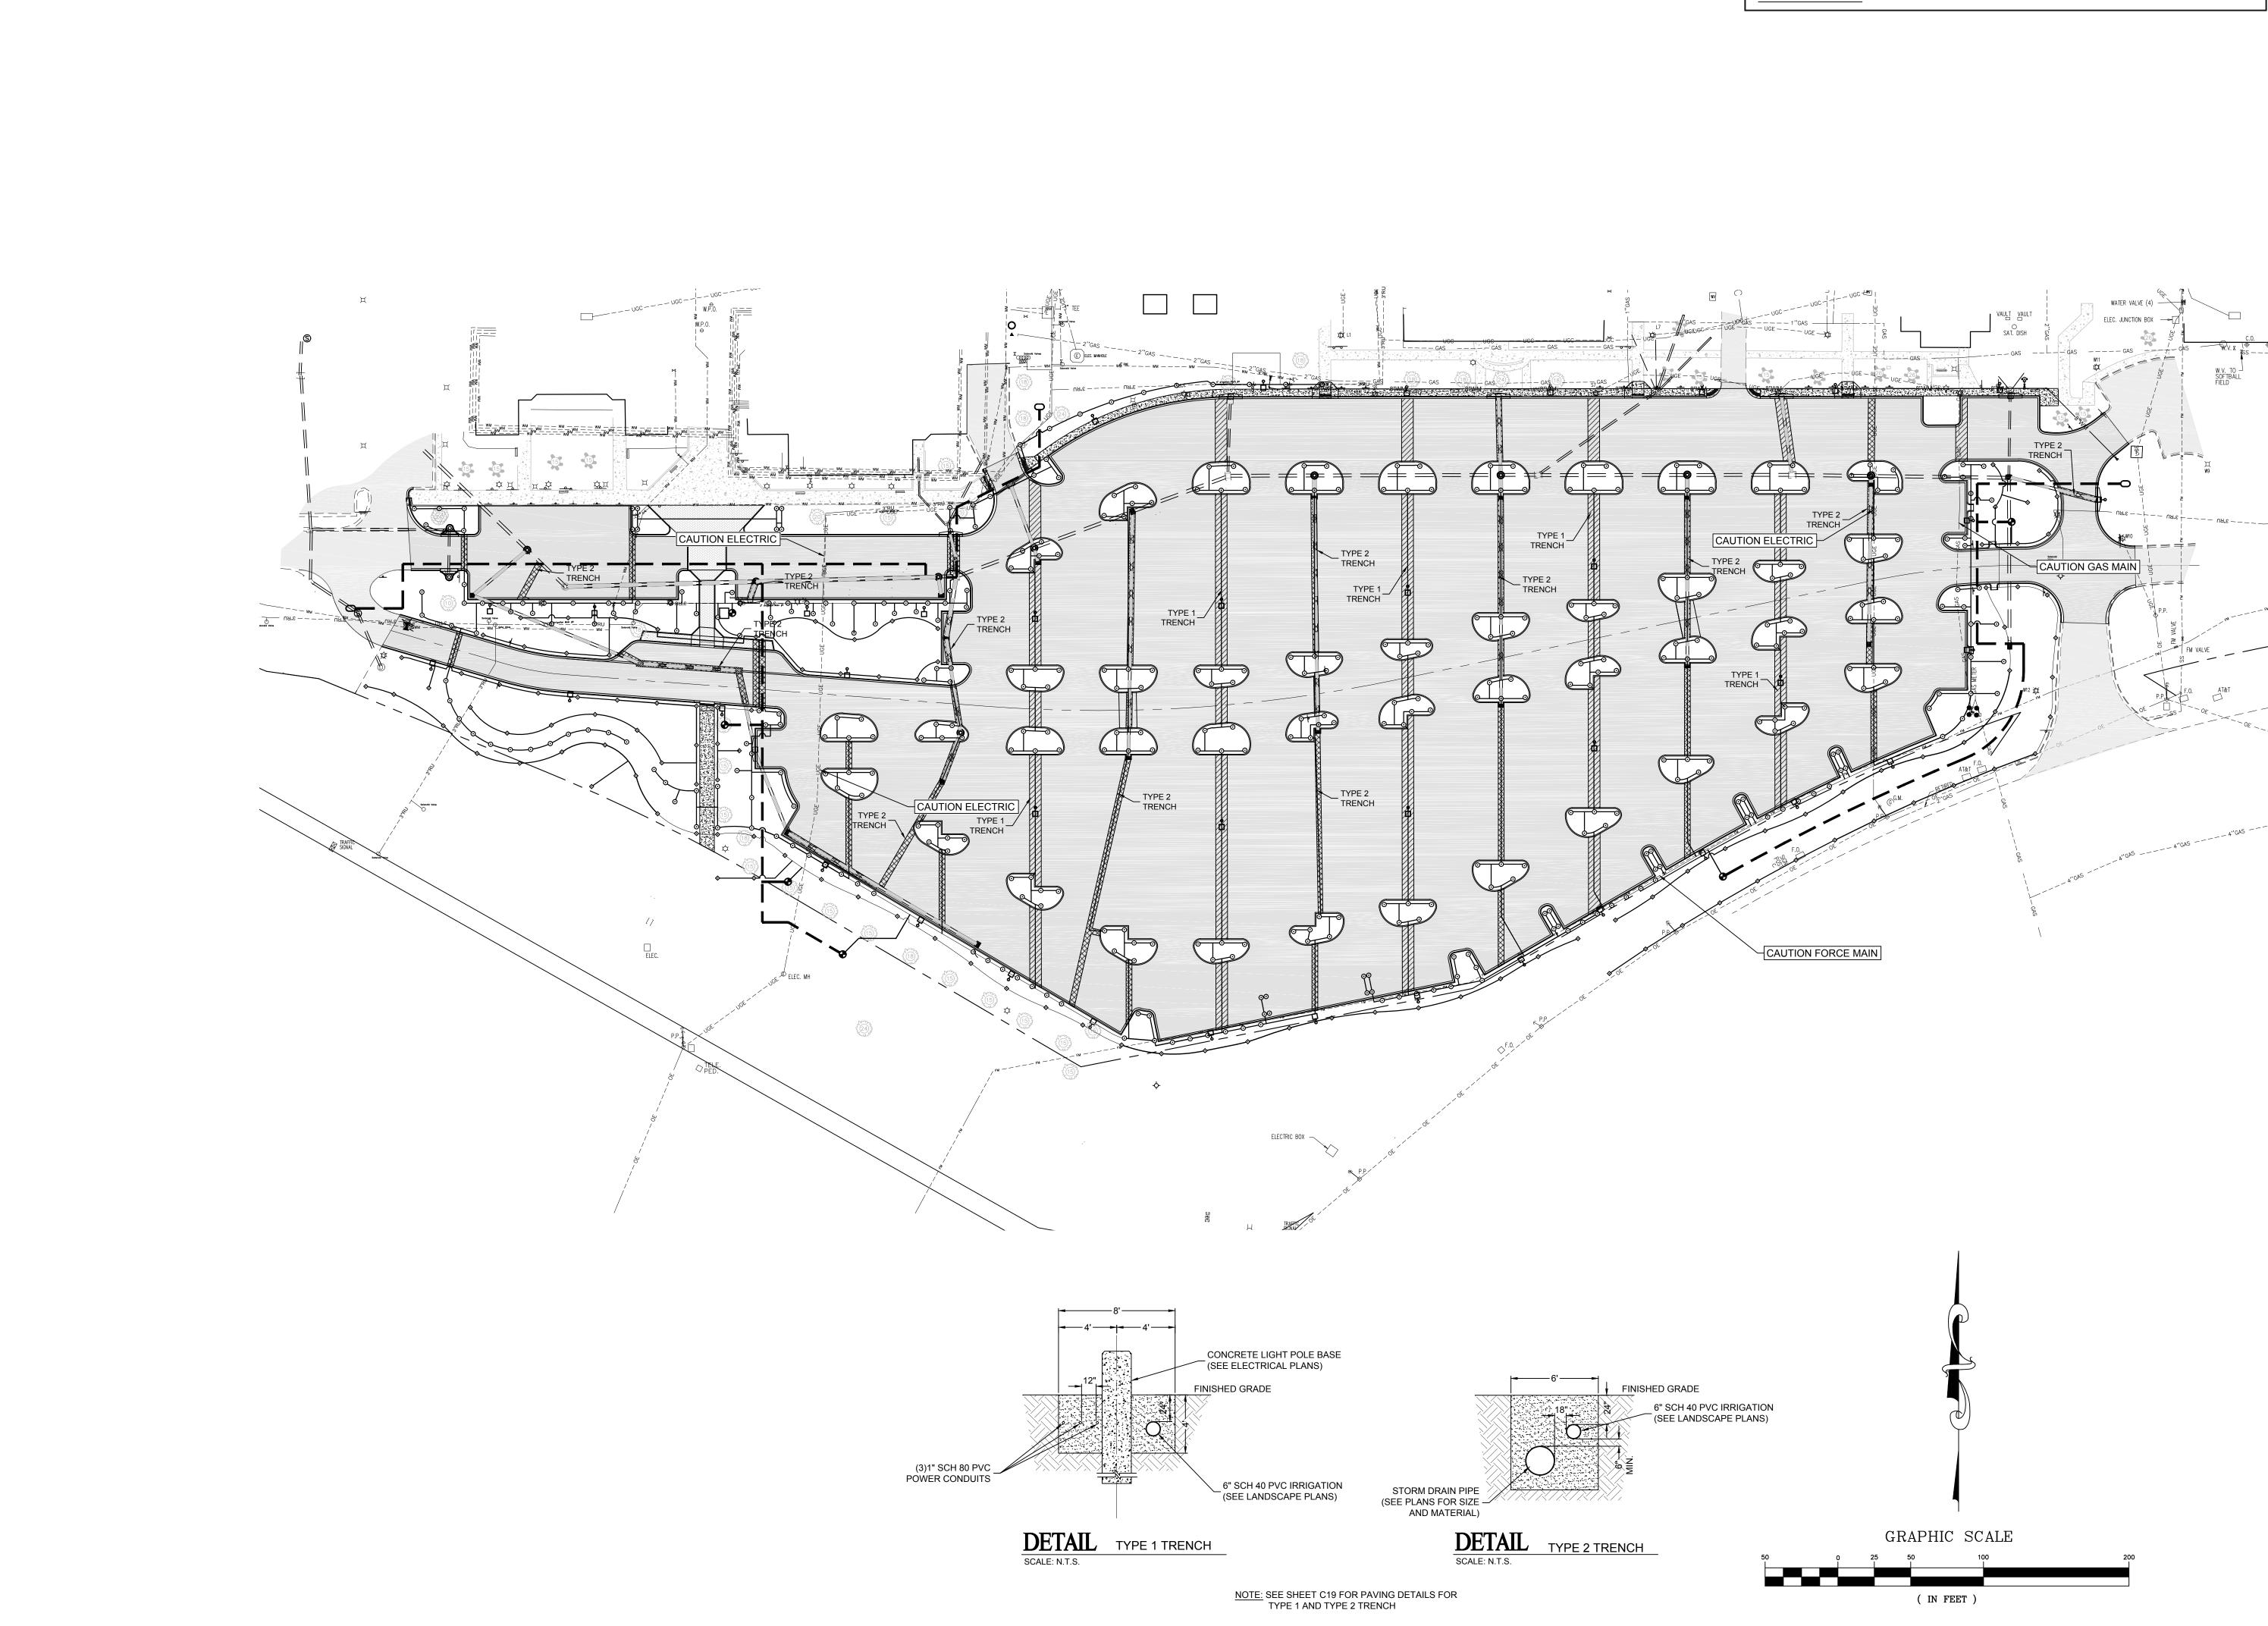

FLORIDA
ARCHITECTS
LICENSE #AA0002730
648 Florida Avenue
Panama City, Fl. 32401
P 850/257-5400

JONATHAN SKLARSKI FL. P.E. 67361

Principal in Charge
Joseph J. Sorci
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
BWR
Checked By:
J.S.


PREBLE-RISH, INC.

GULF COAST STATE COLLEGE
PHASE 1 CAMPUS

/ERALL SITE UTILITY PLAN

BID DOCUMENTS

Sheet Number

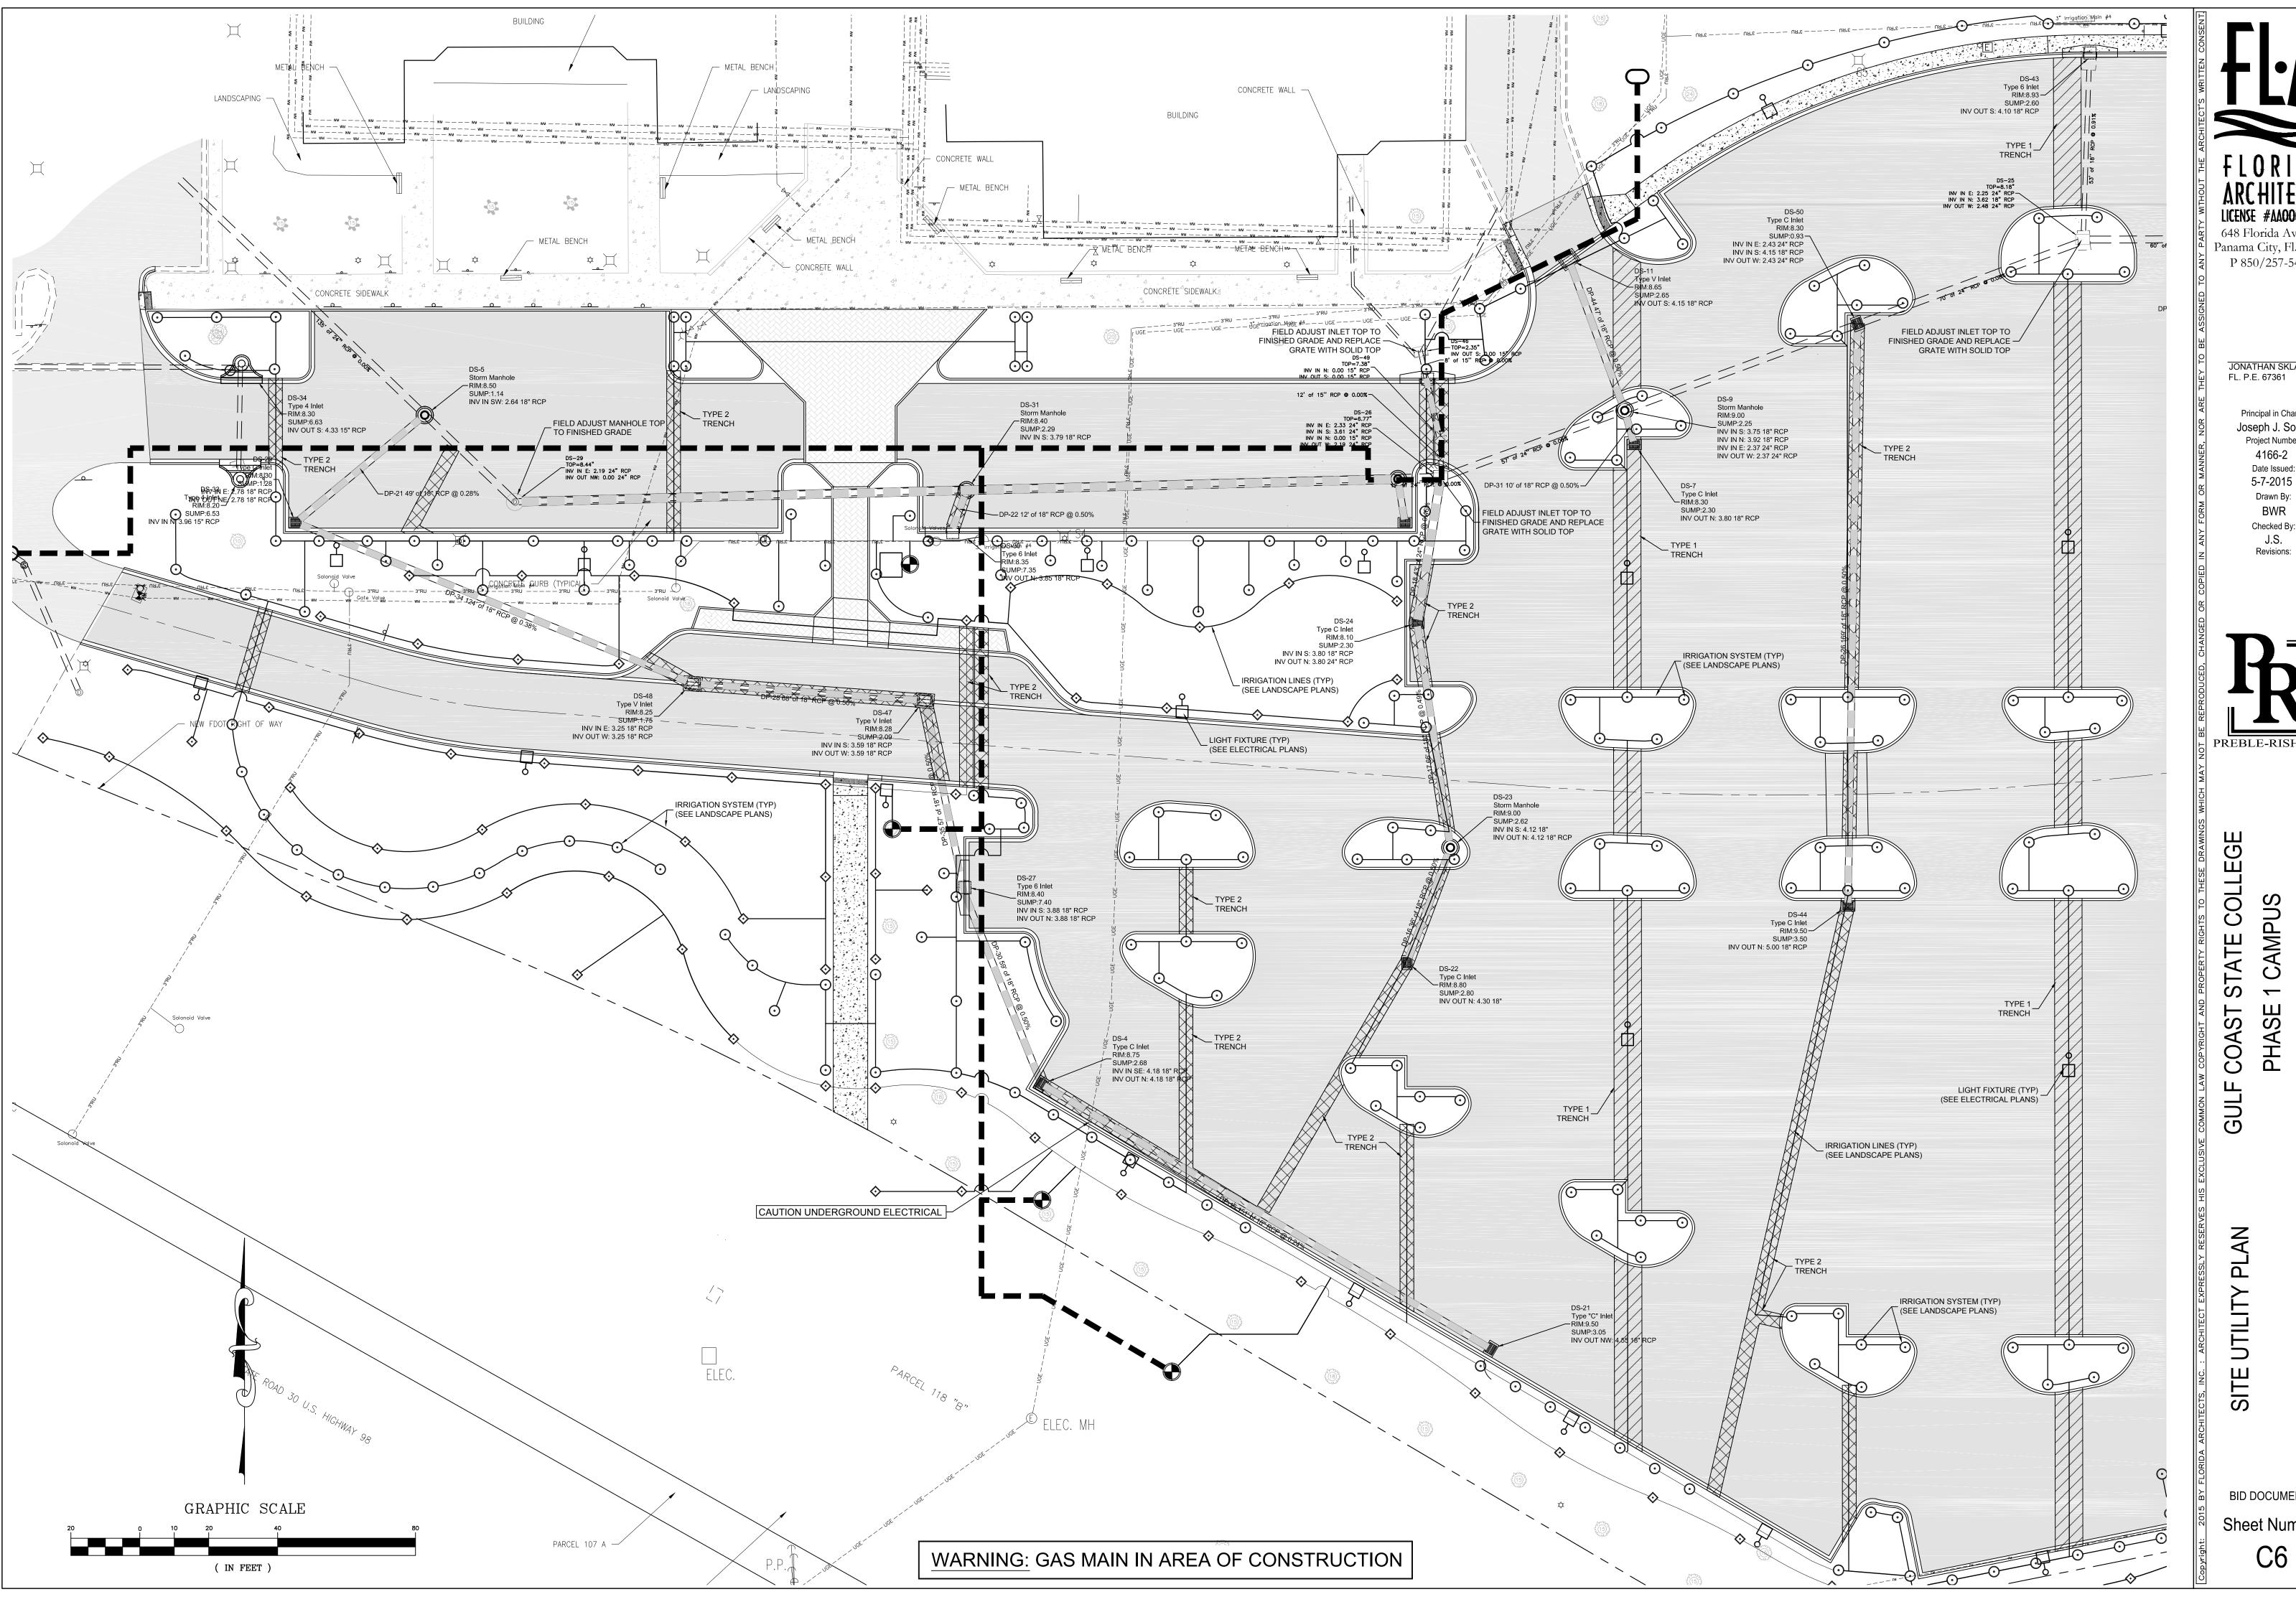


648 Florida Avenue Panama City, Fl. 32401 P 850/257-5400

JONATHAN SKLARSKI FL. P.E. 67361

> Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By: Checked By: J.S. Revisions:

PREBLE-RISH, INC

BID DOCUMENTS Sheet Number

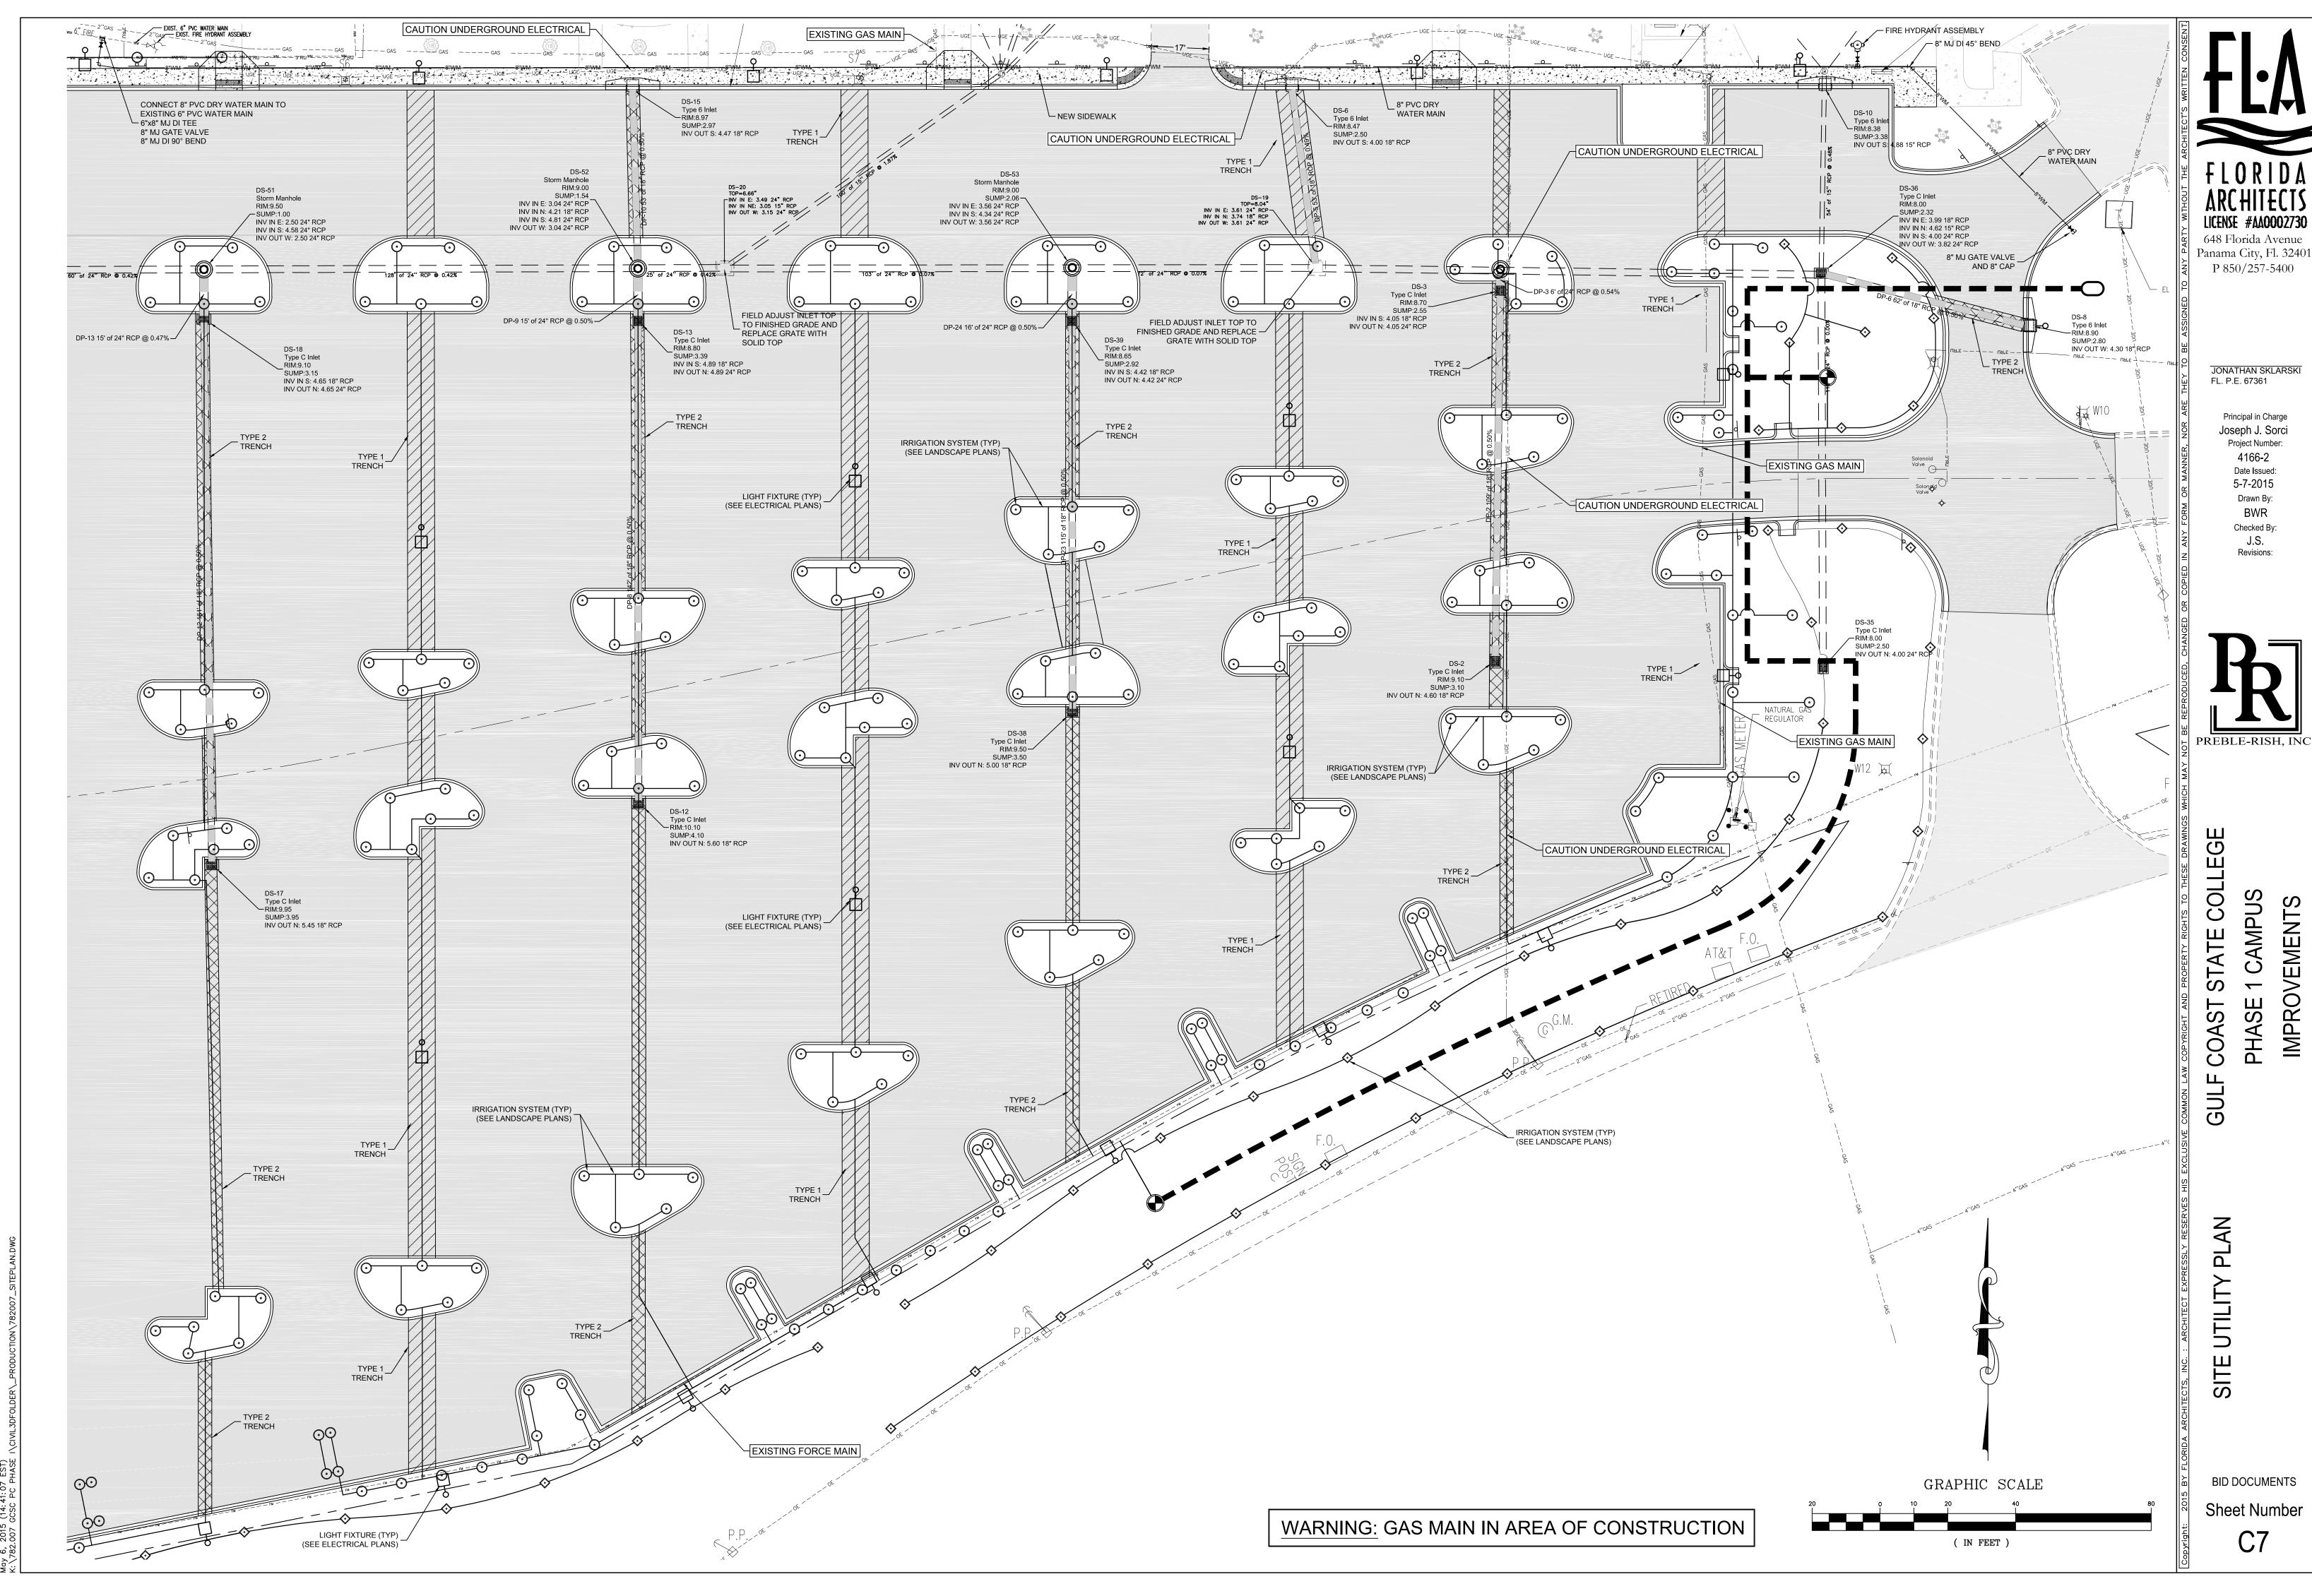



JONATHAN SKLARSKI FL. P.E. 67361

Principal in Charge
Joseph J. Sorci
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
BWR
Checked By:
J.S.
Revisions:


REBLE-RISH, INC.


COAST STATE COLLEGE
PHASE 1 CAMPUS

PAVING PLAN

GULF

BID DOCUMENTS

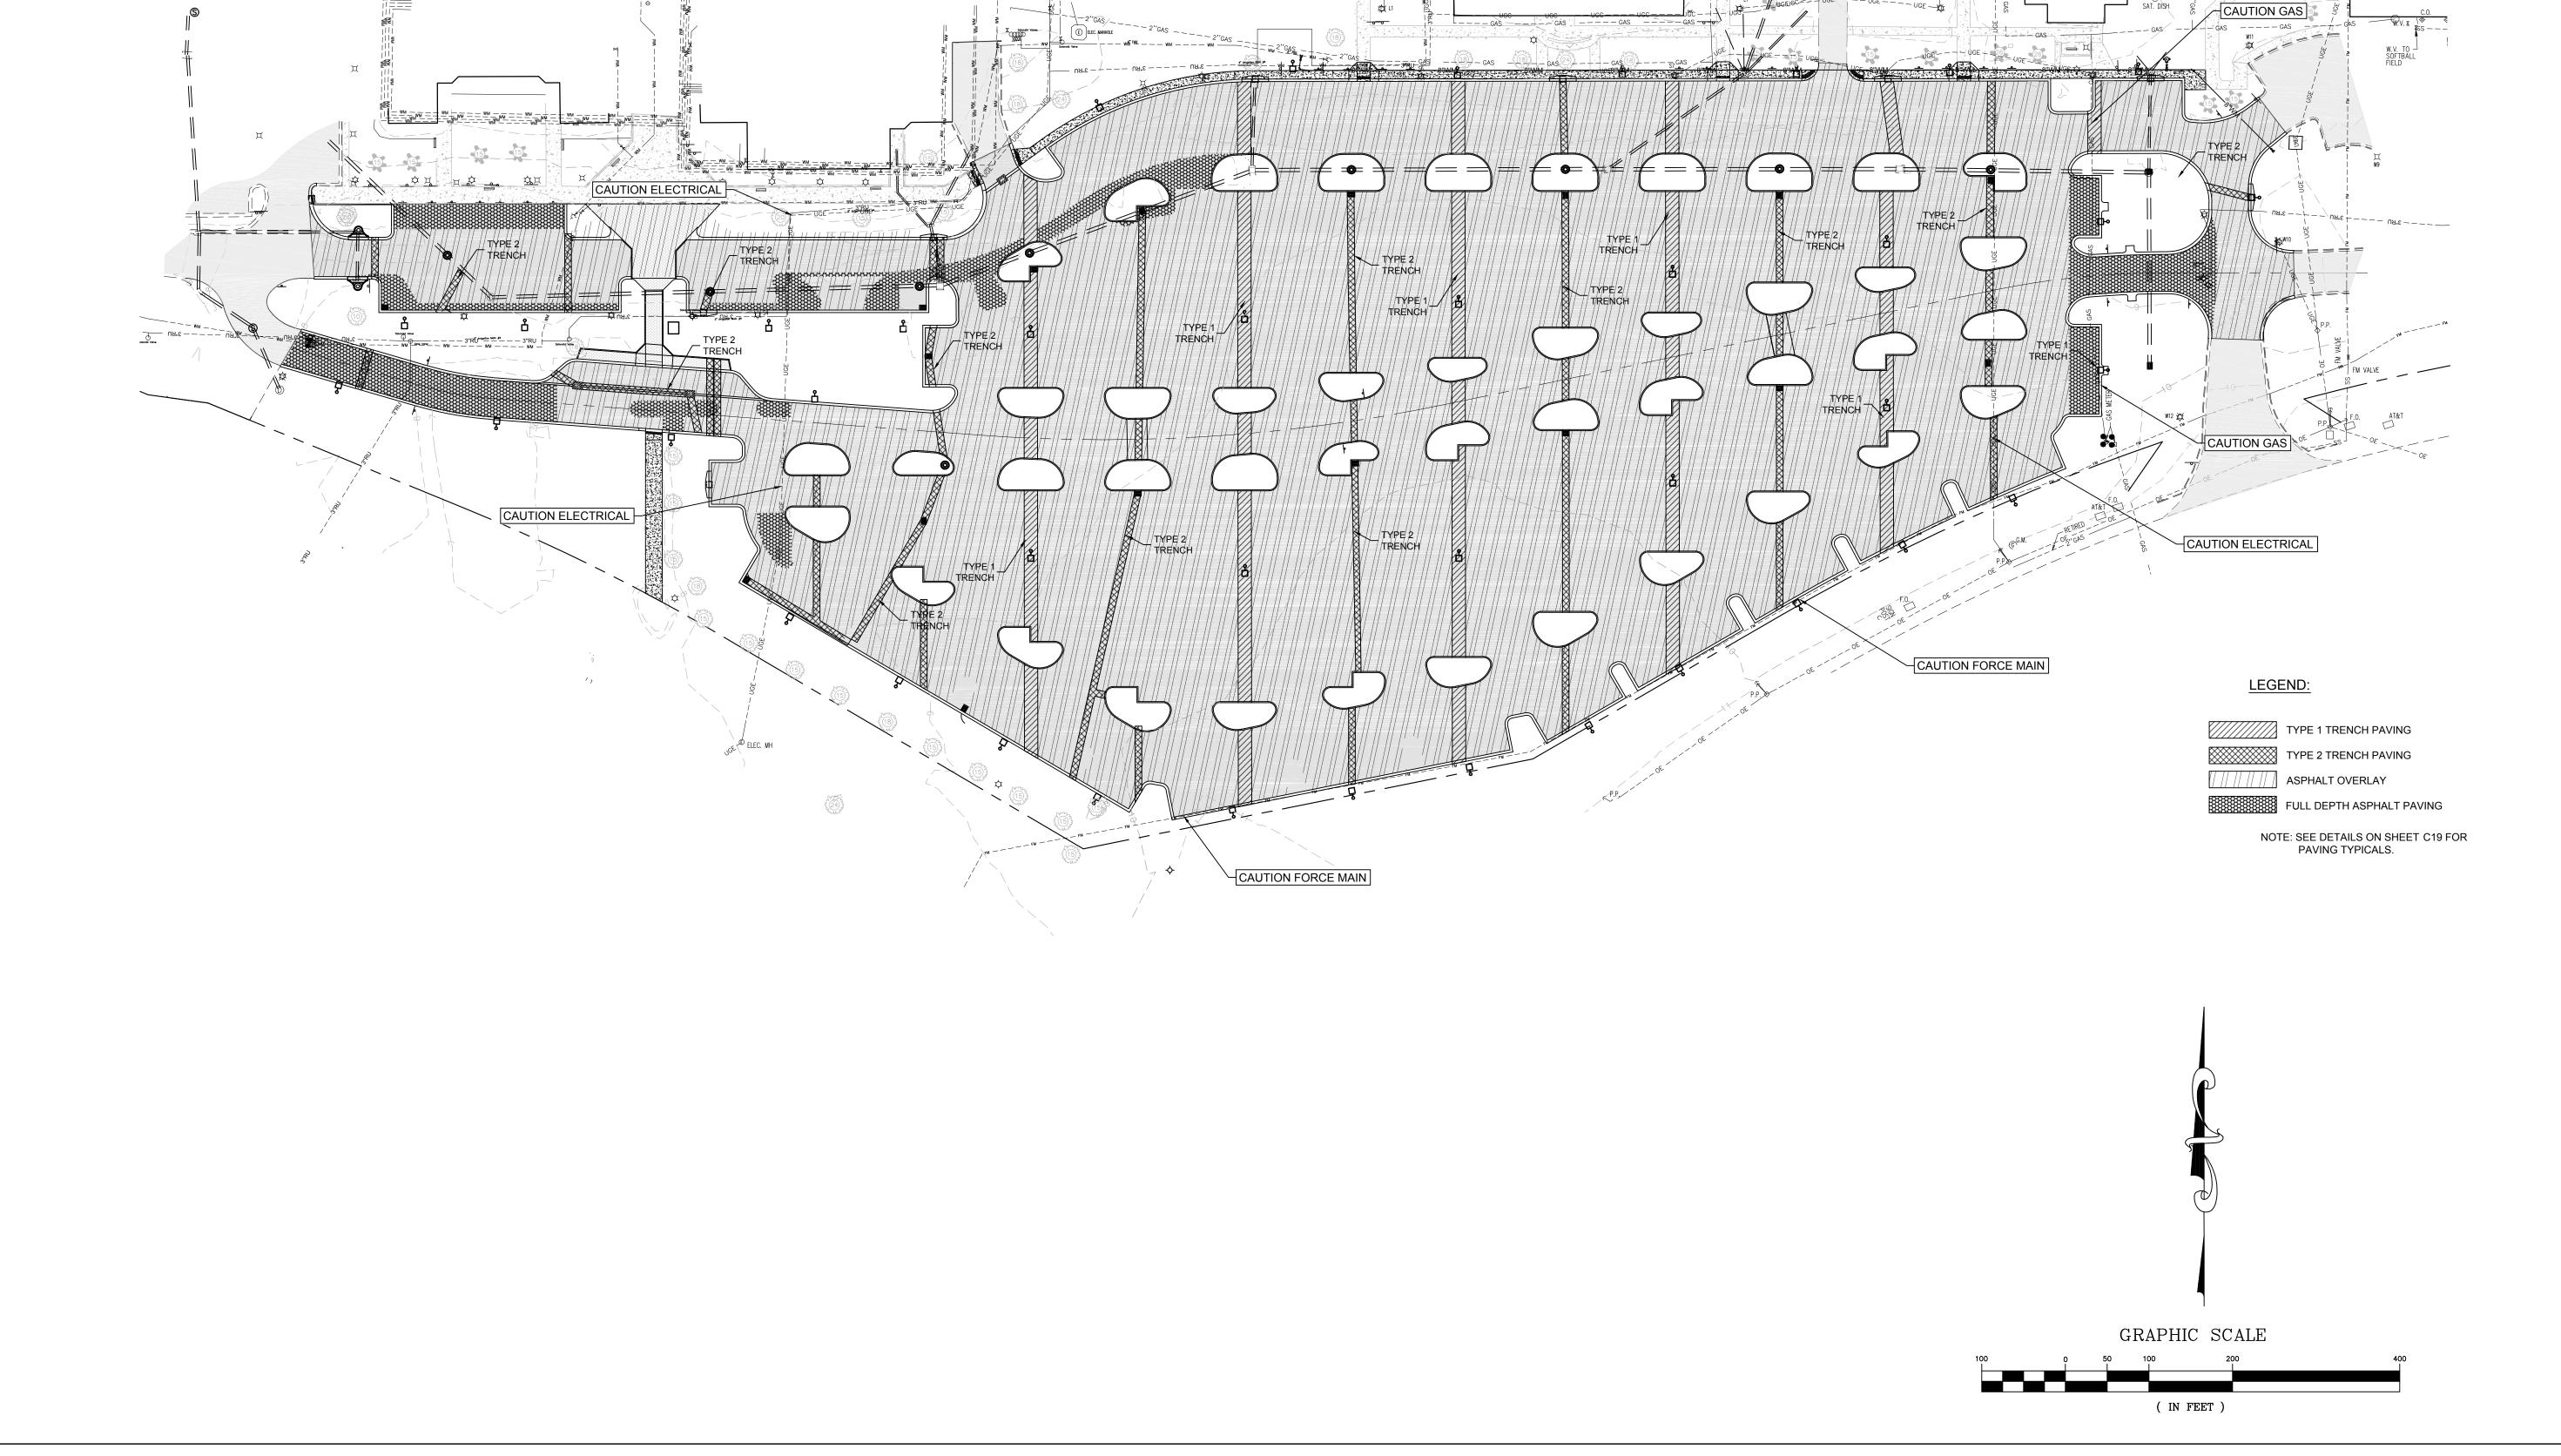

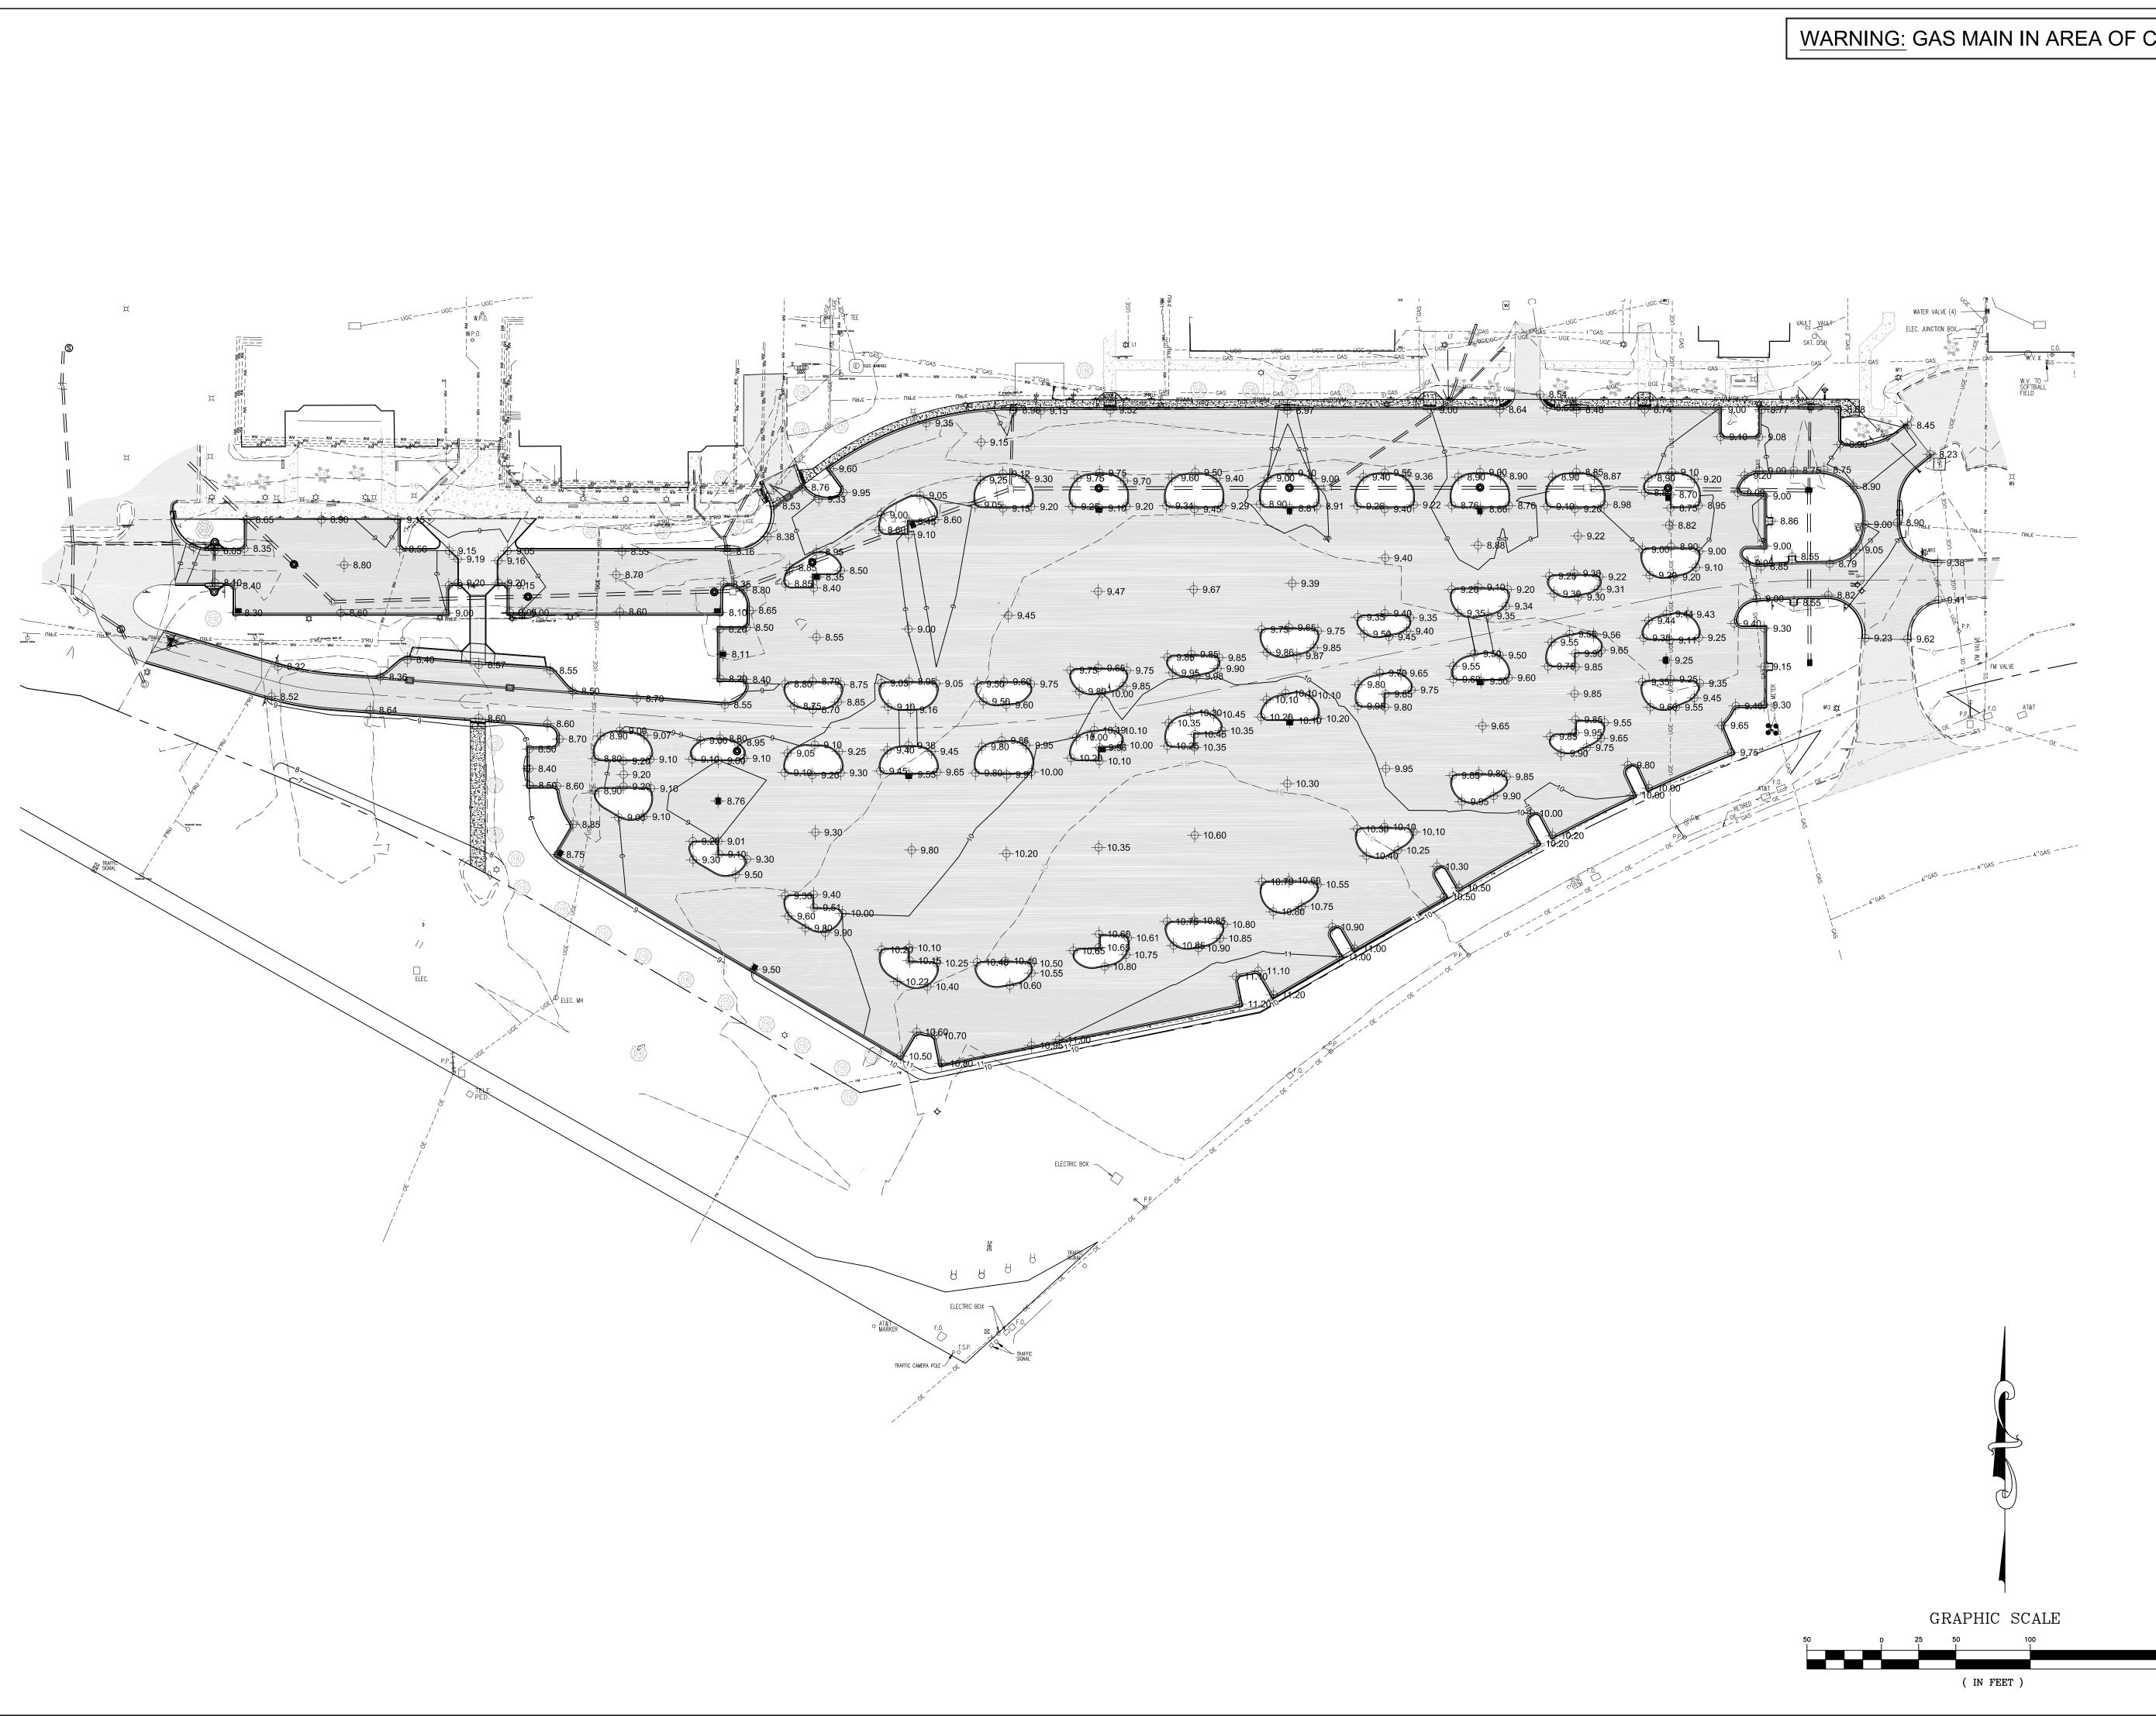

FLORIDA
ARCHITECTS
LICENSE #AA0002730 648 Florida Avenue Panama City, Fl. 32401 P 850/257-5400

JONATHAN SKLARSKI FL. P.E. 67361

Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By: Checked By: J.S.





GULF COAST STATE COLLEGE PHASE 1 CAMPUS IMPROVEMENTS PHASE

SITE GRADING PLAN OVERALL

BID DOCUMENTS

Sheet Number

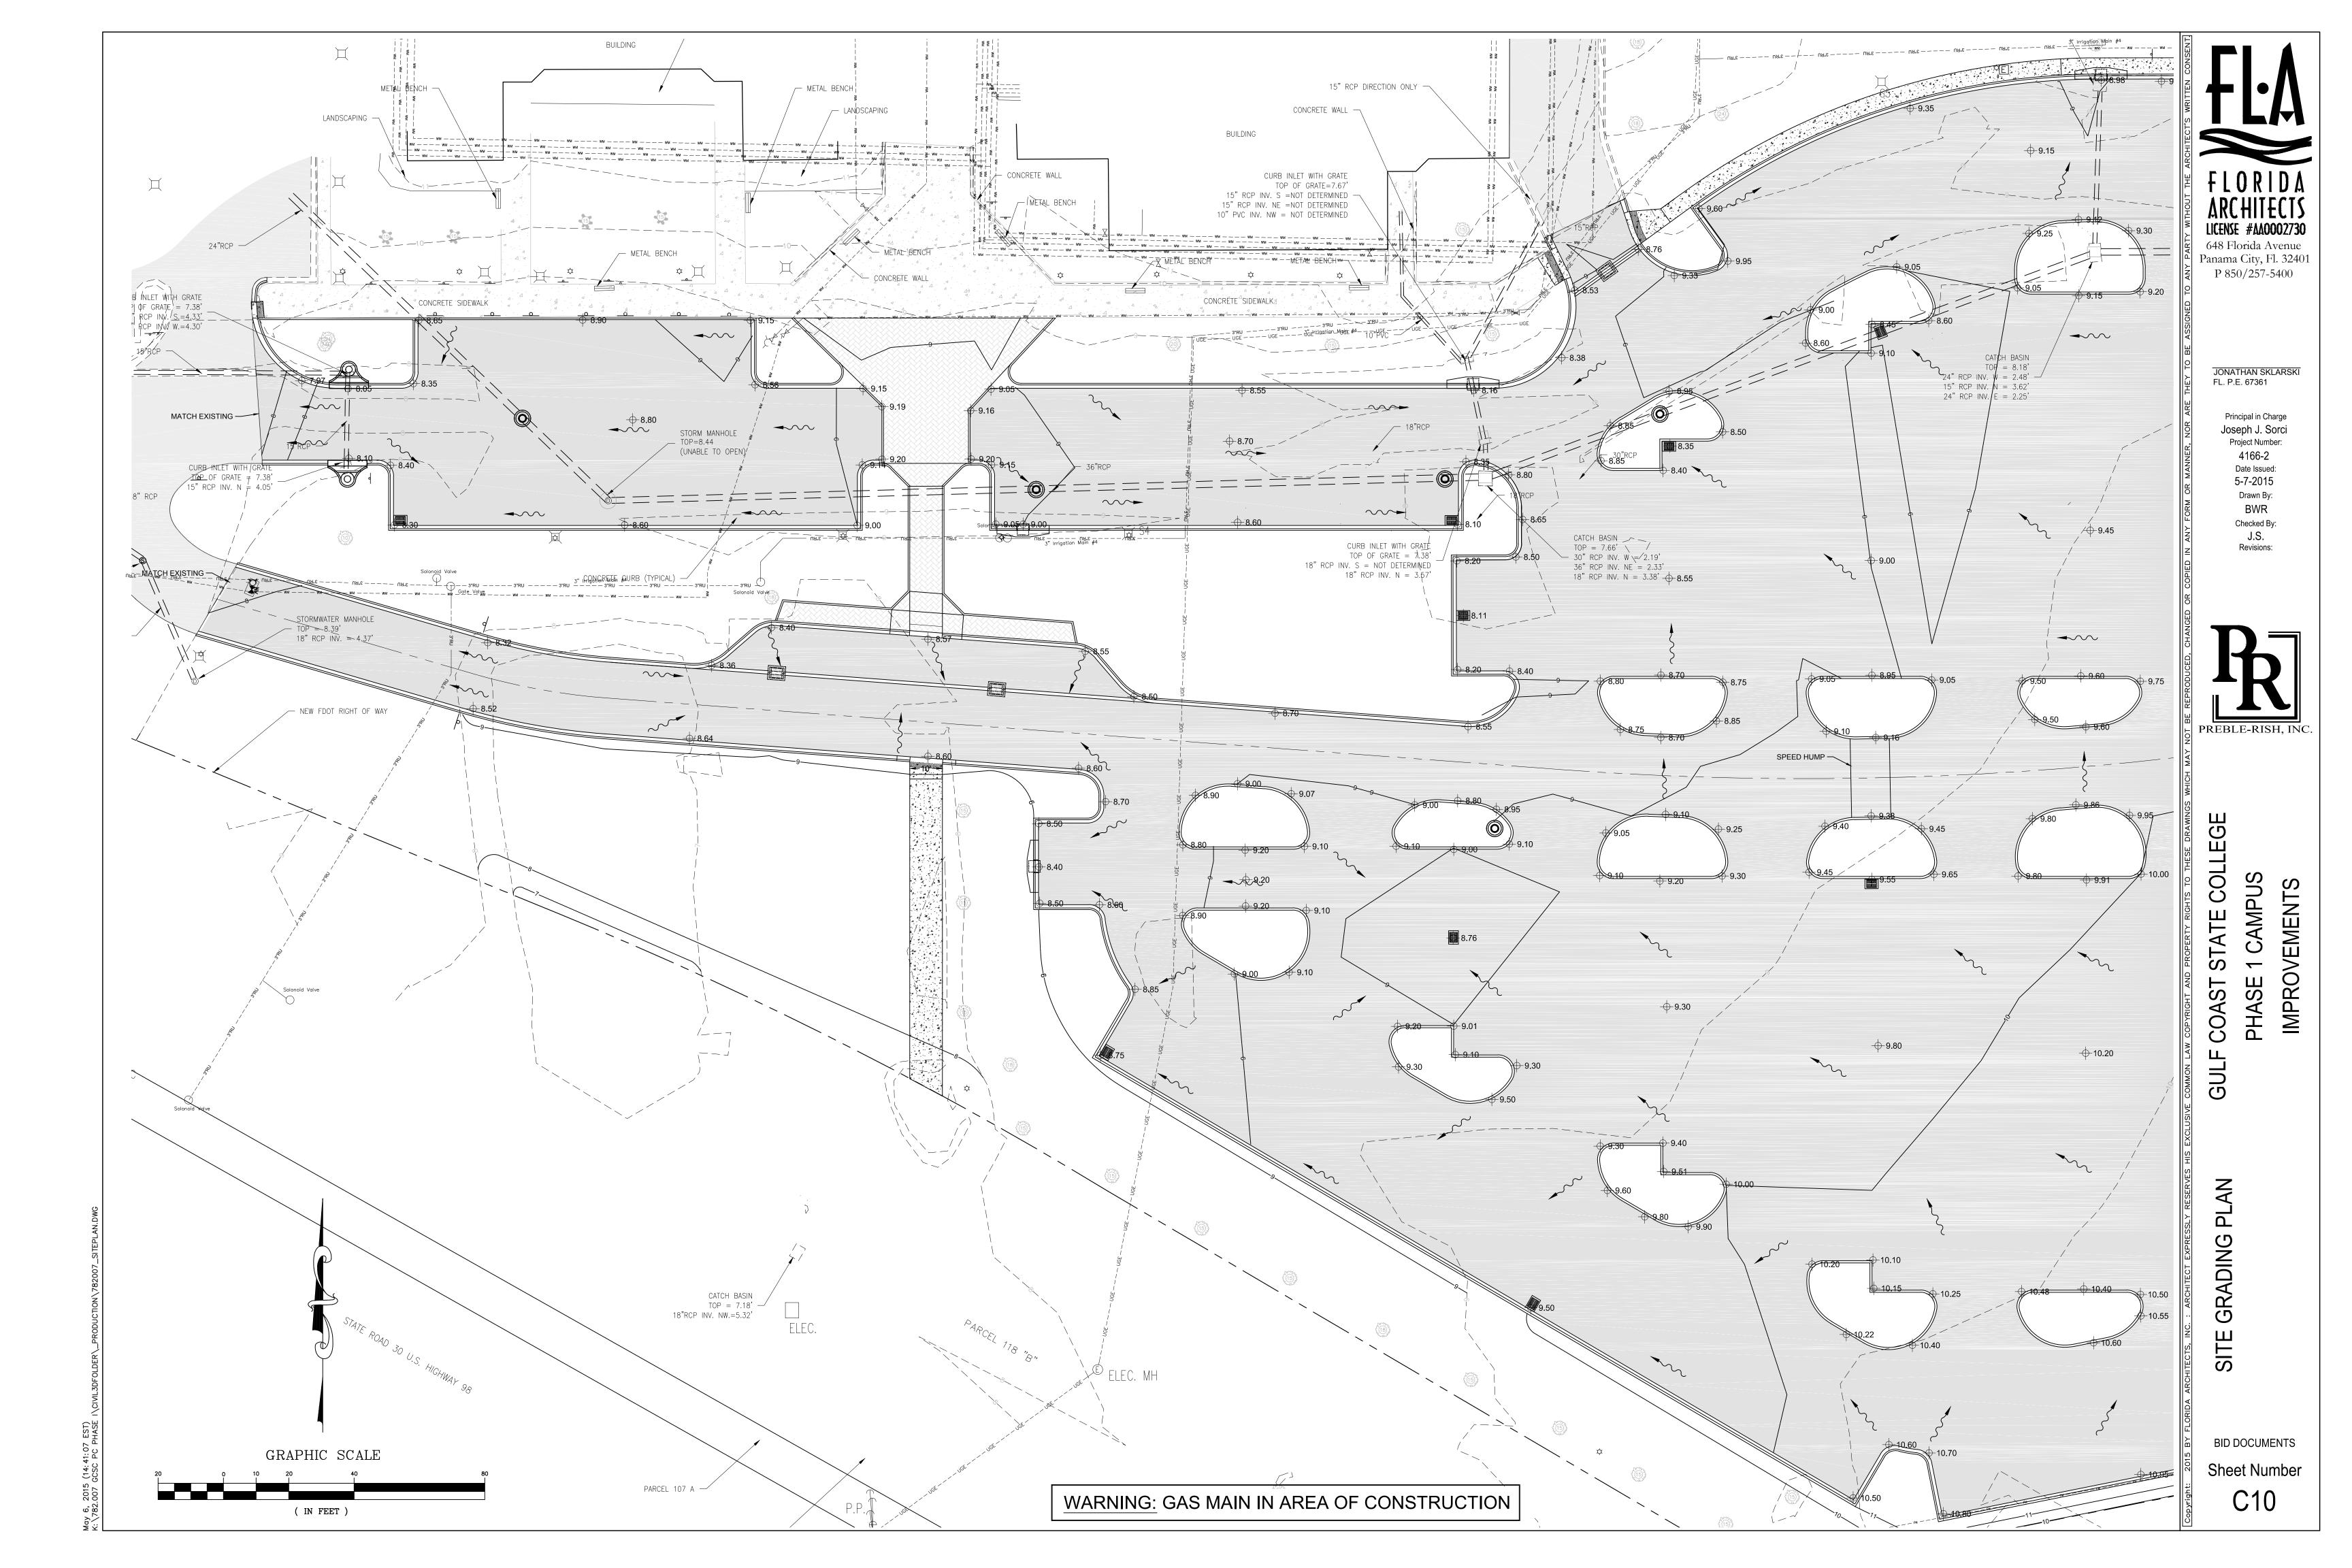

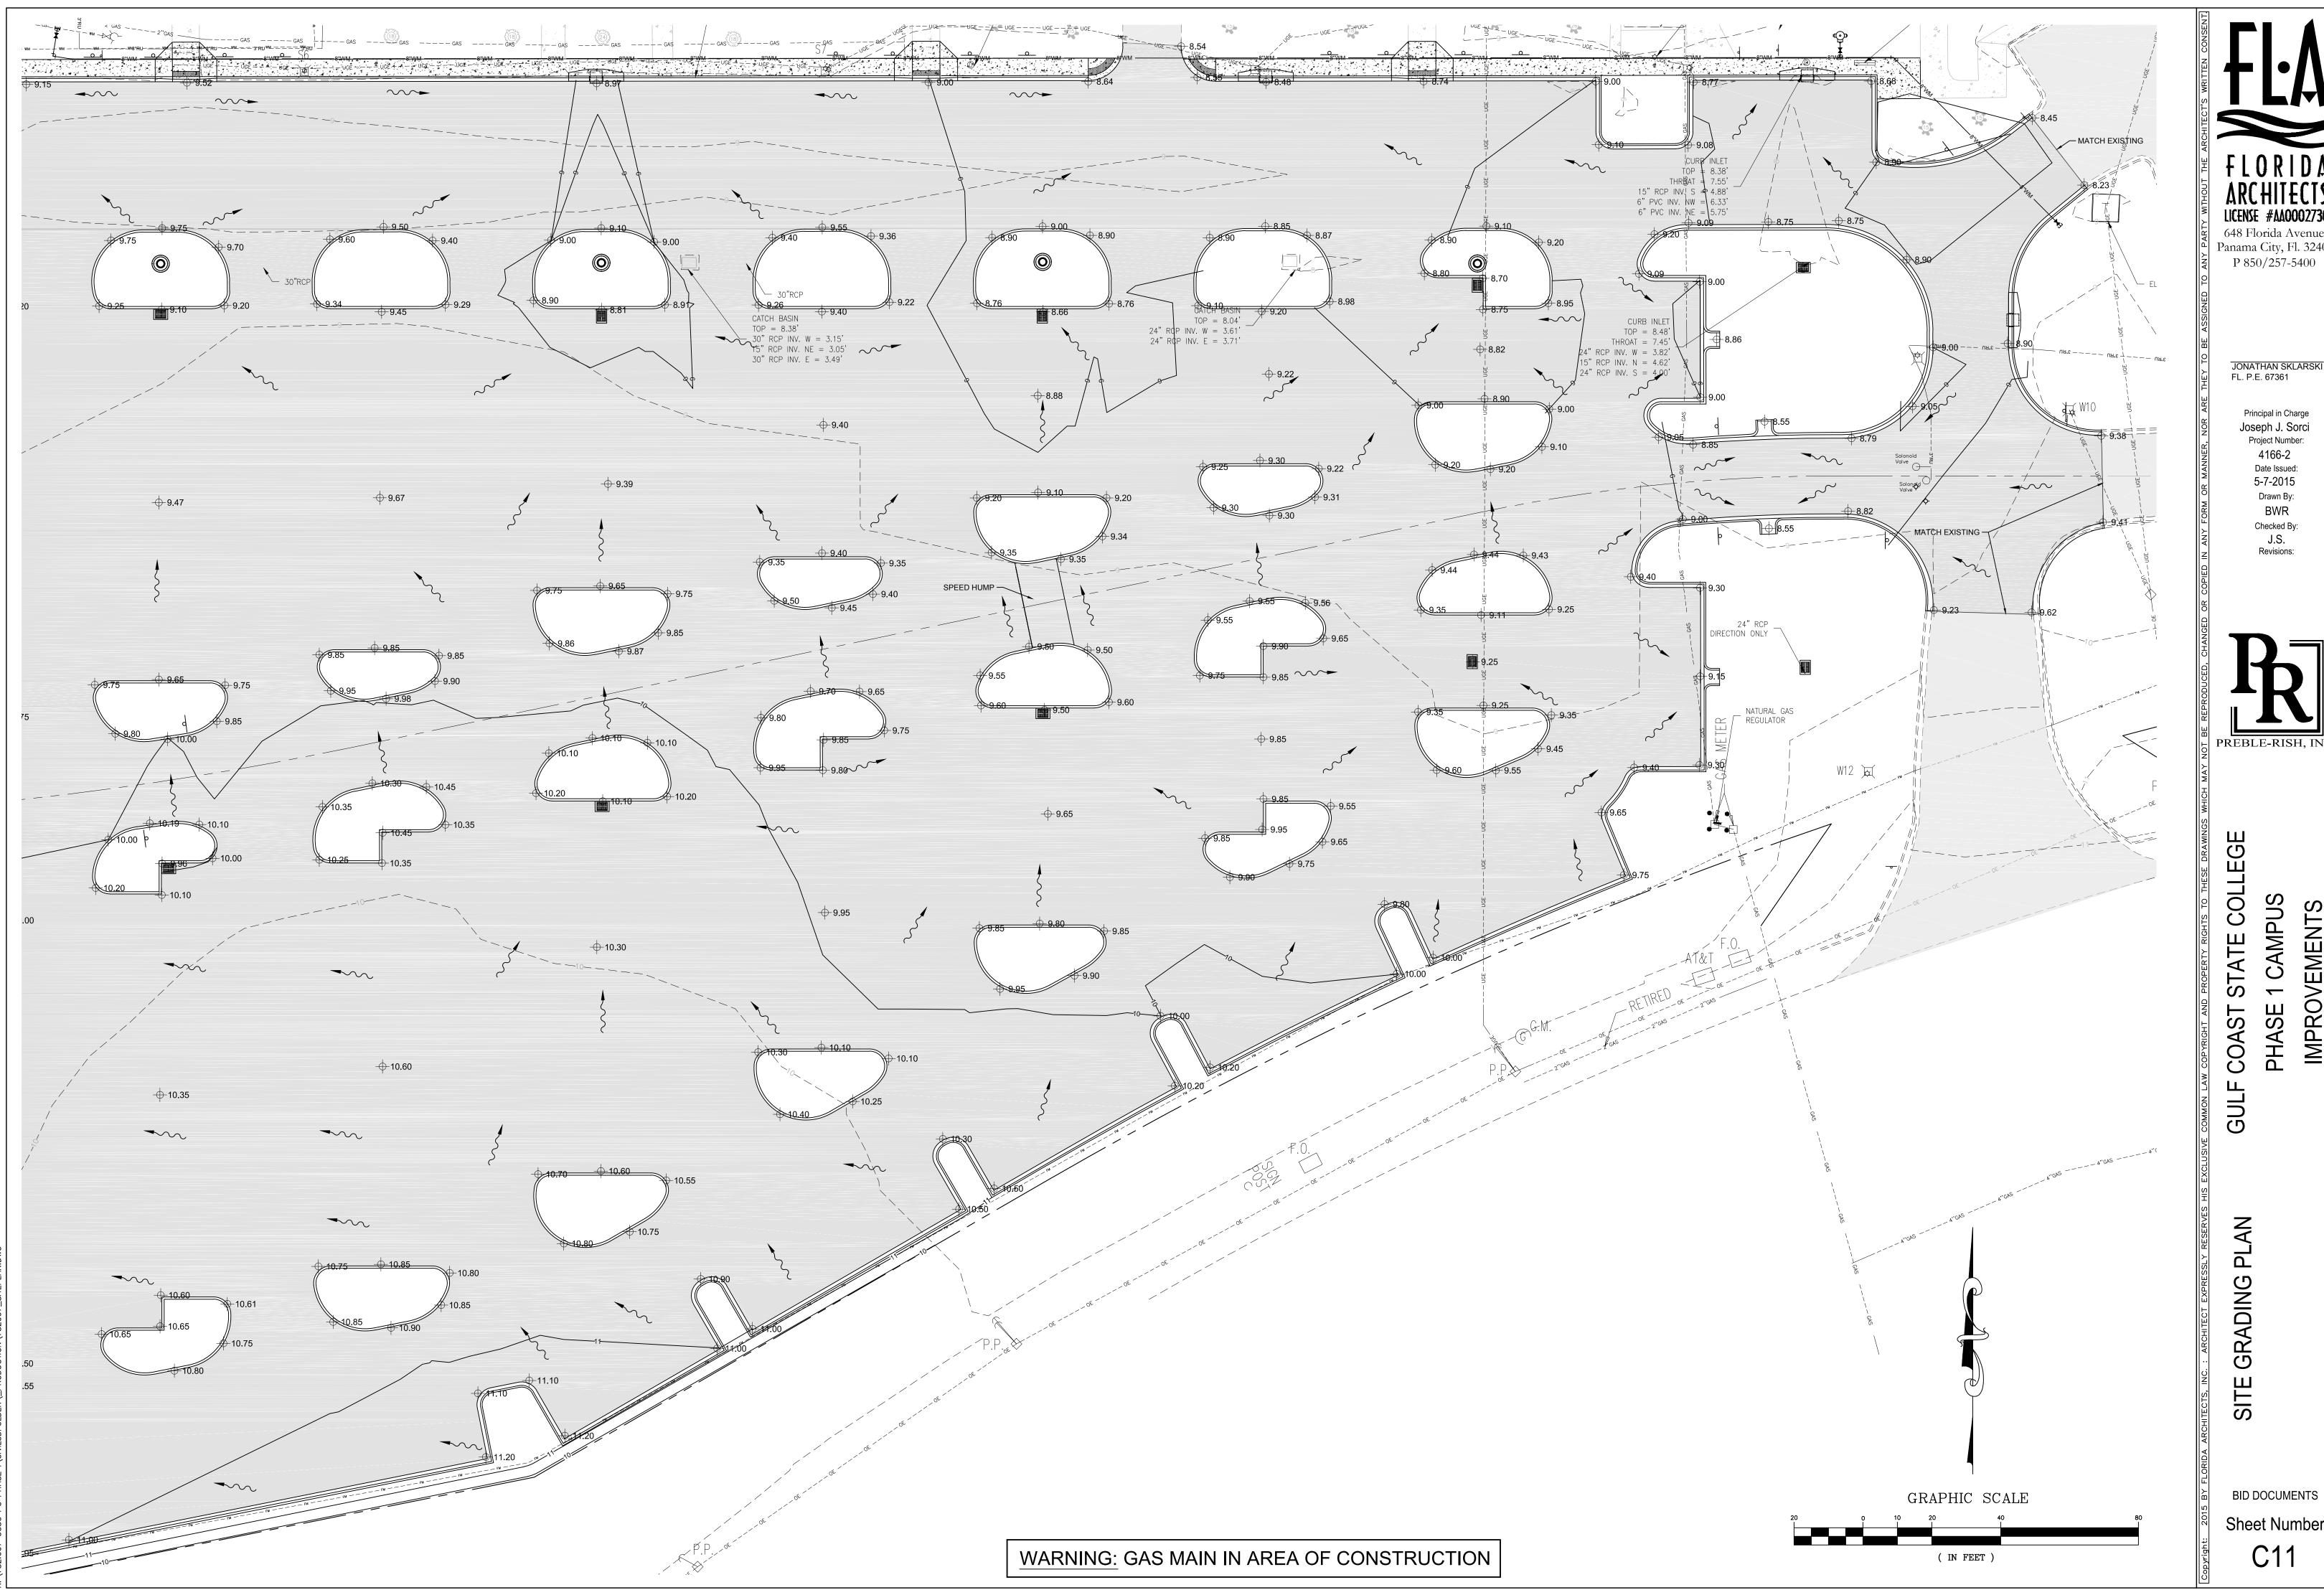


LICENSE #AAOOO2730 648 Florida Avenue Panama City, Fl. 32401

> JONATHAN SKLARSKI FL. P.E. 67361

> > Joseph J. Sorci Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By: BWR Checked By: J.S. Revisions:


PREBLE-RISH, INC

BID DOCUMENTS

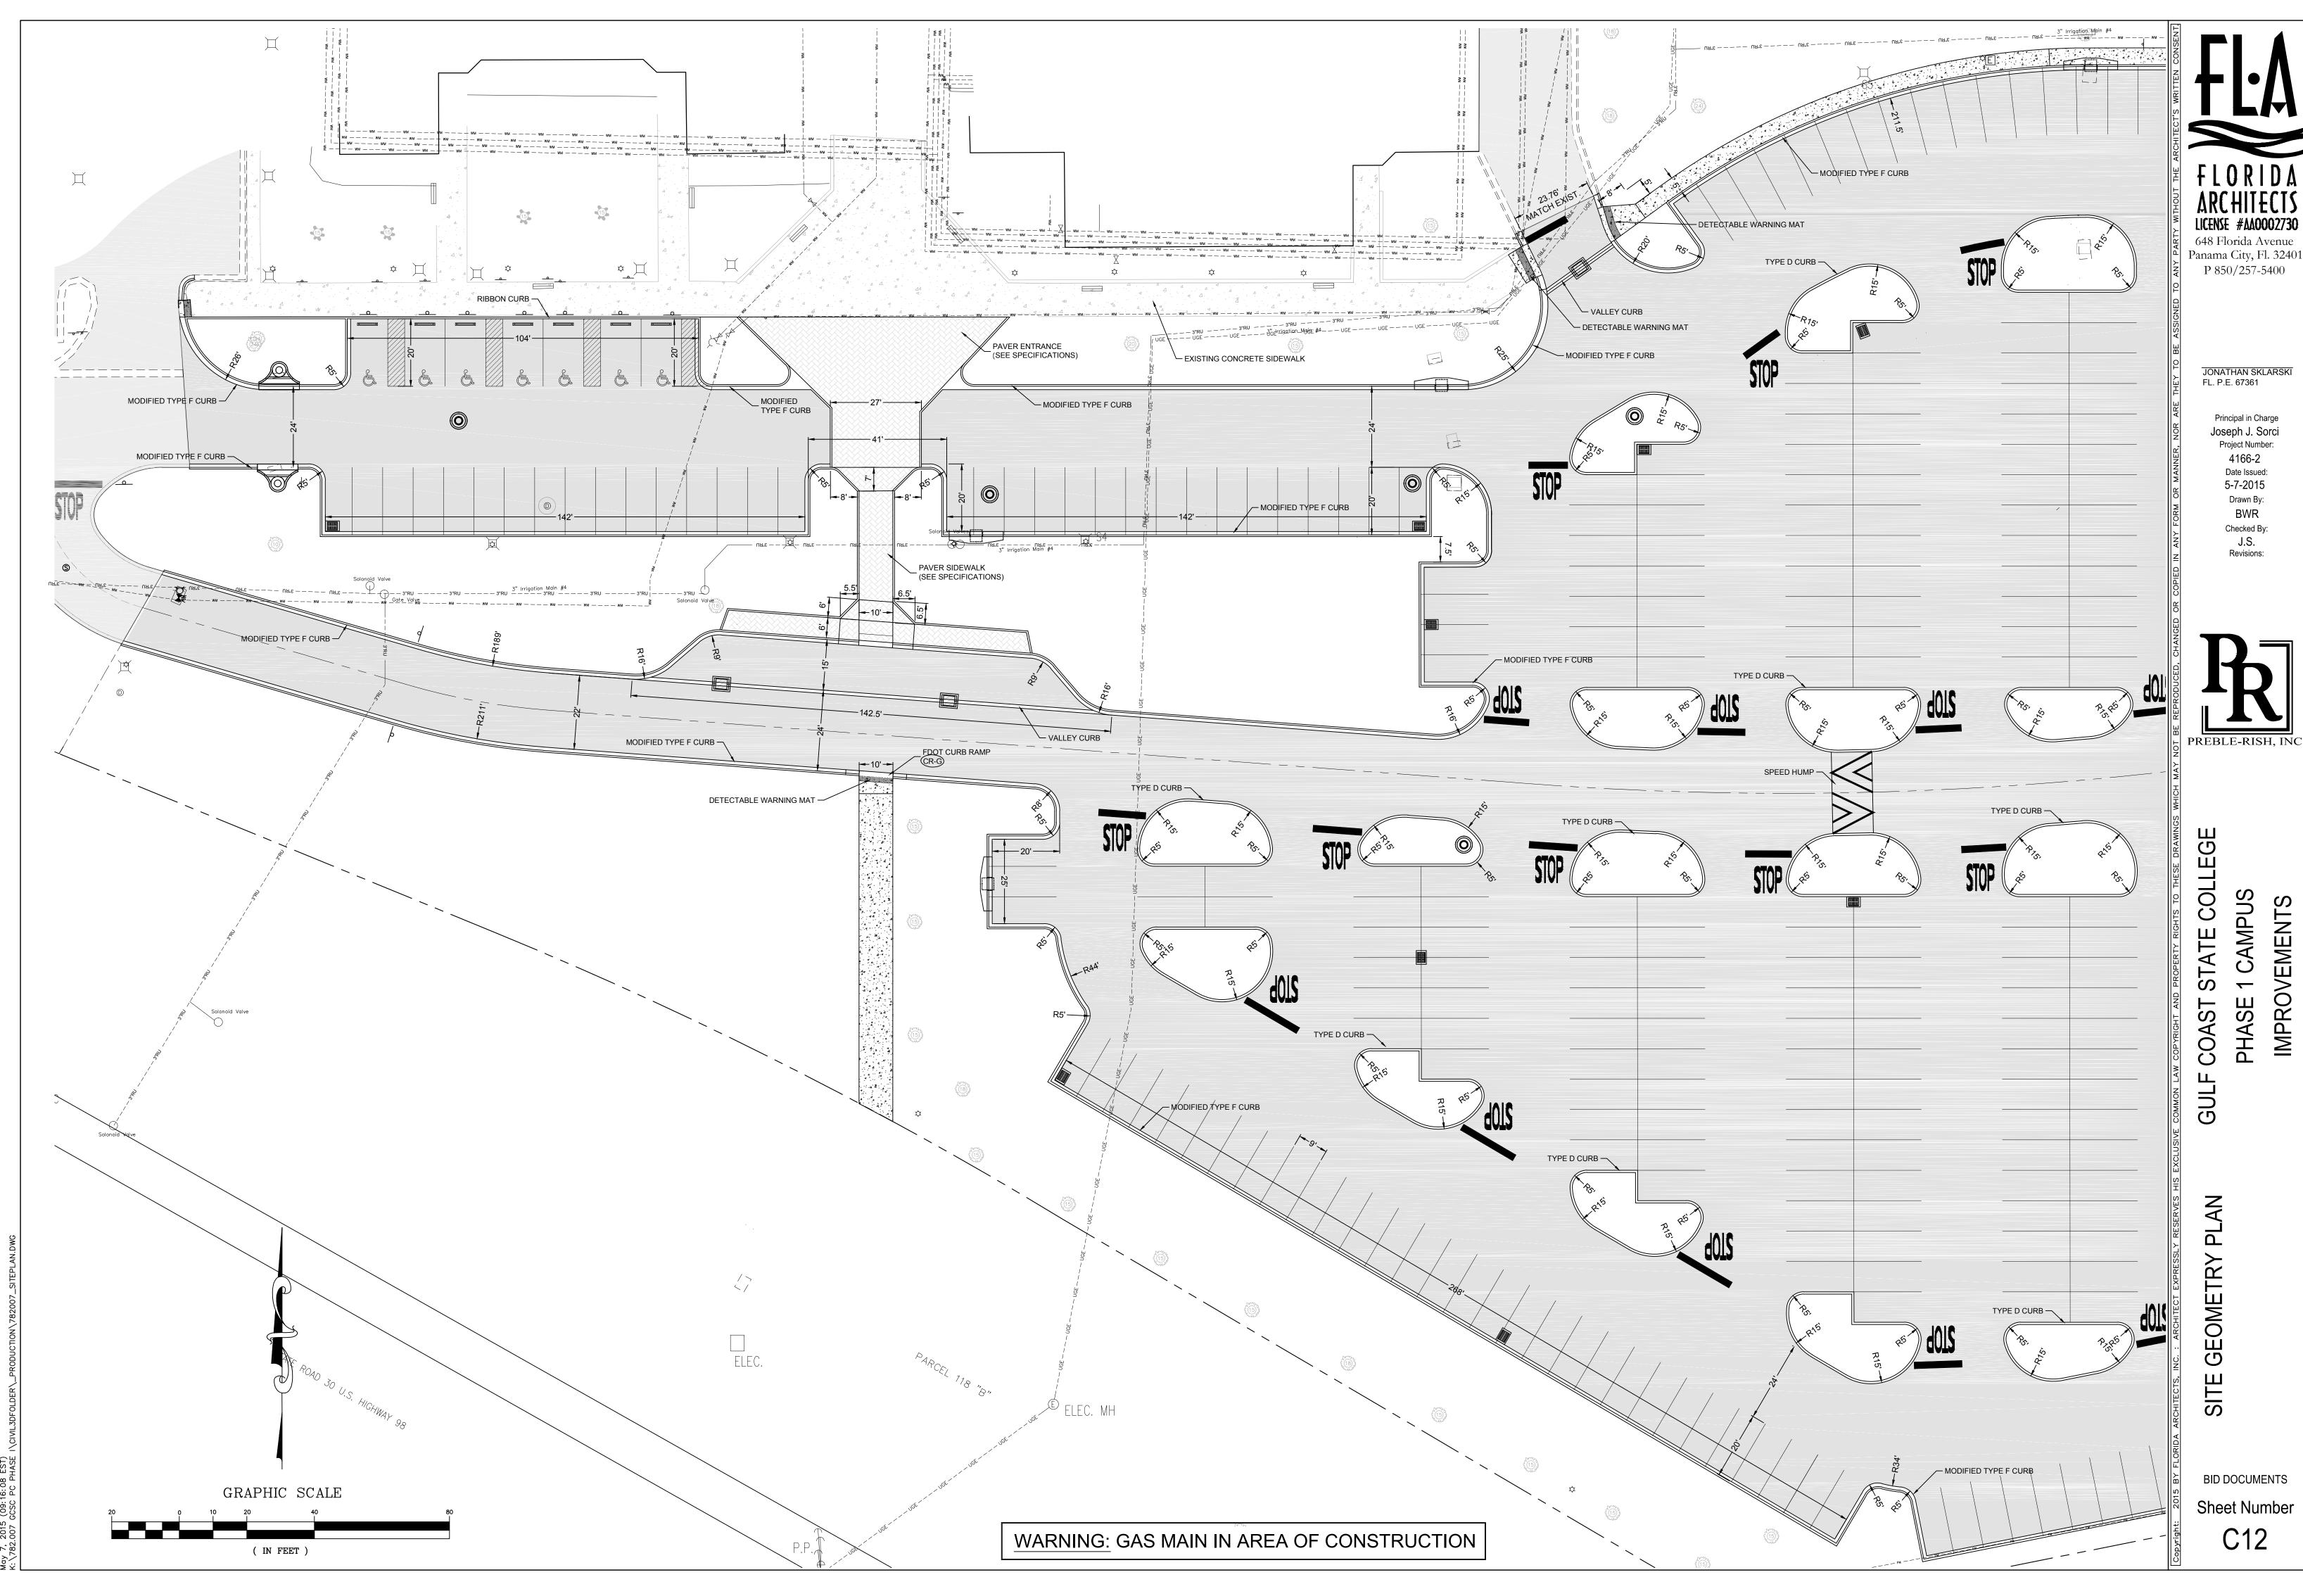



FLORIDA
ARCHITECTS
LICENSE #AA0002730

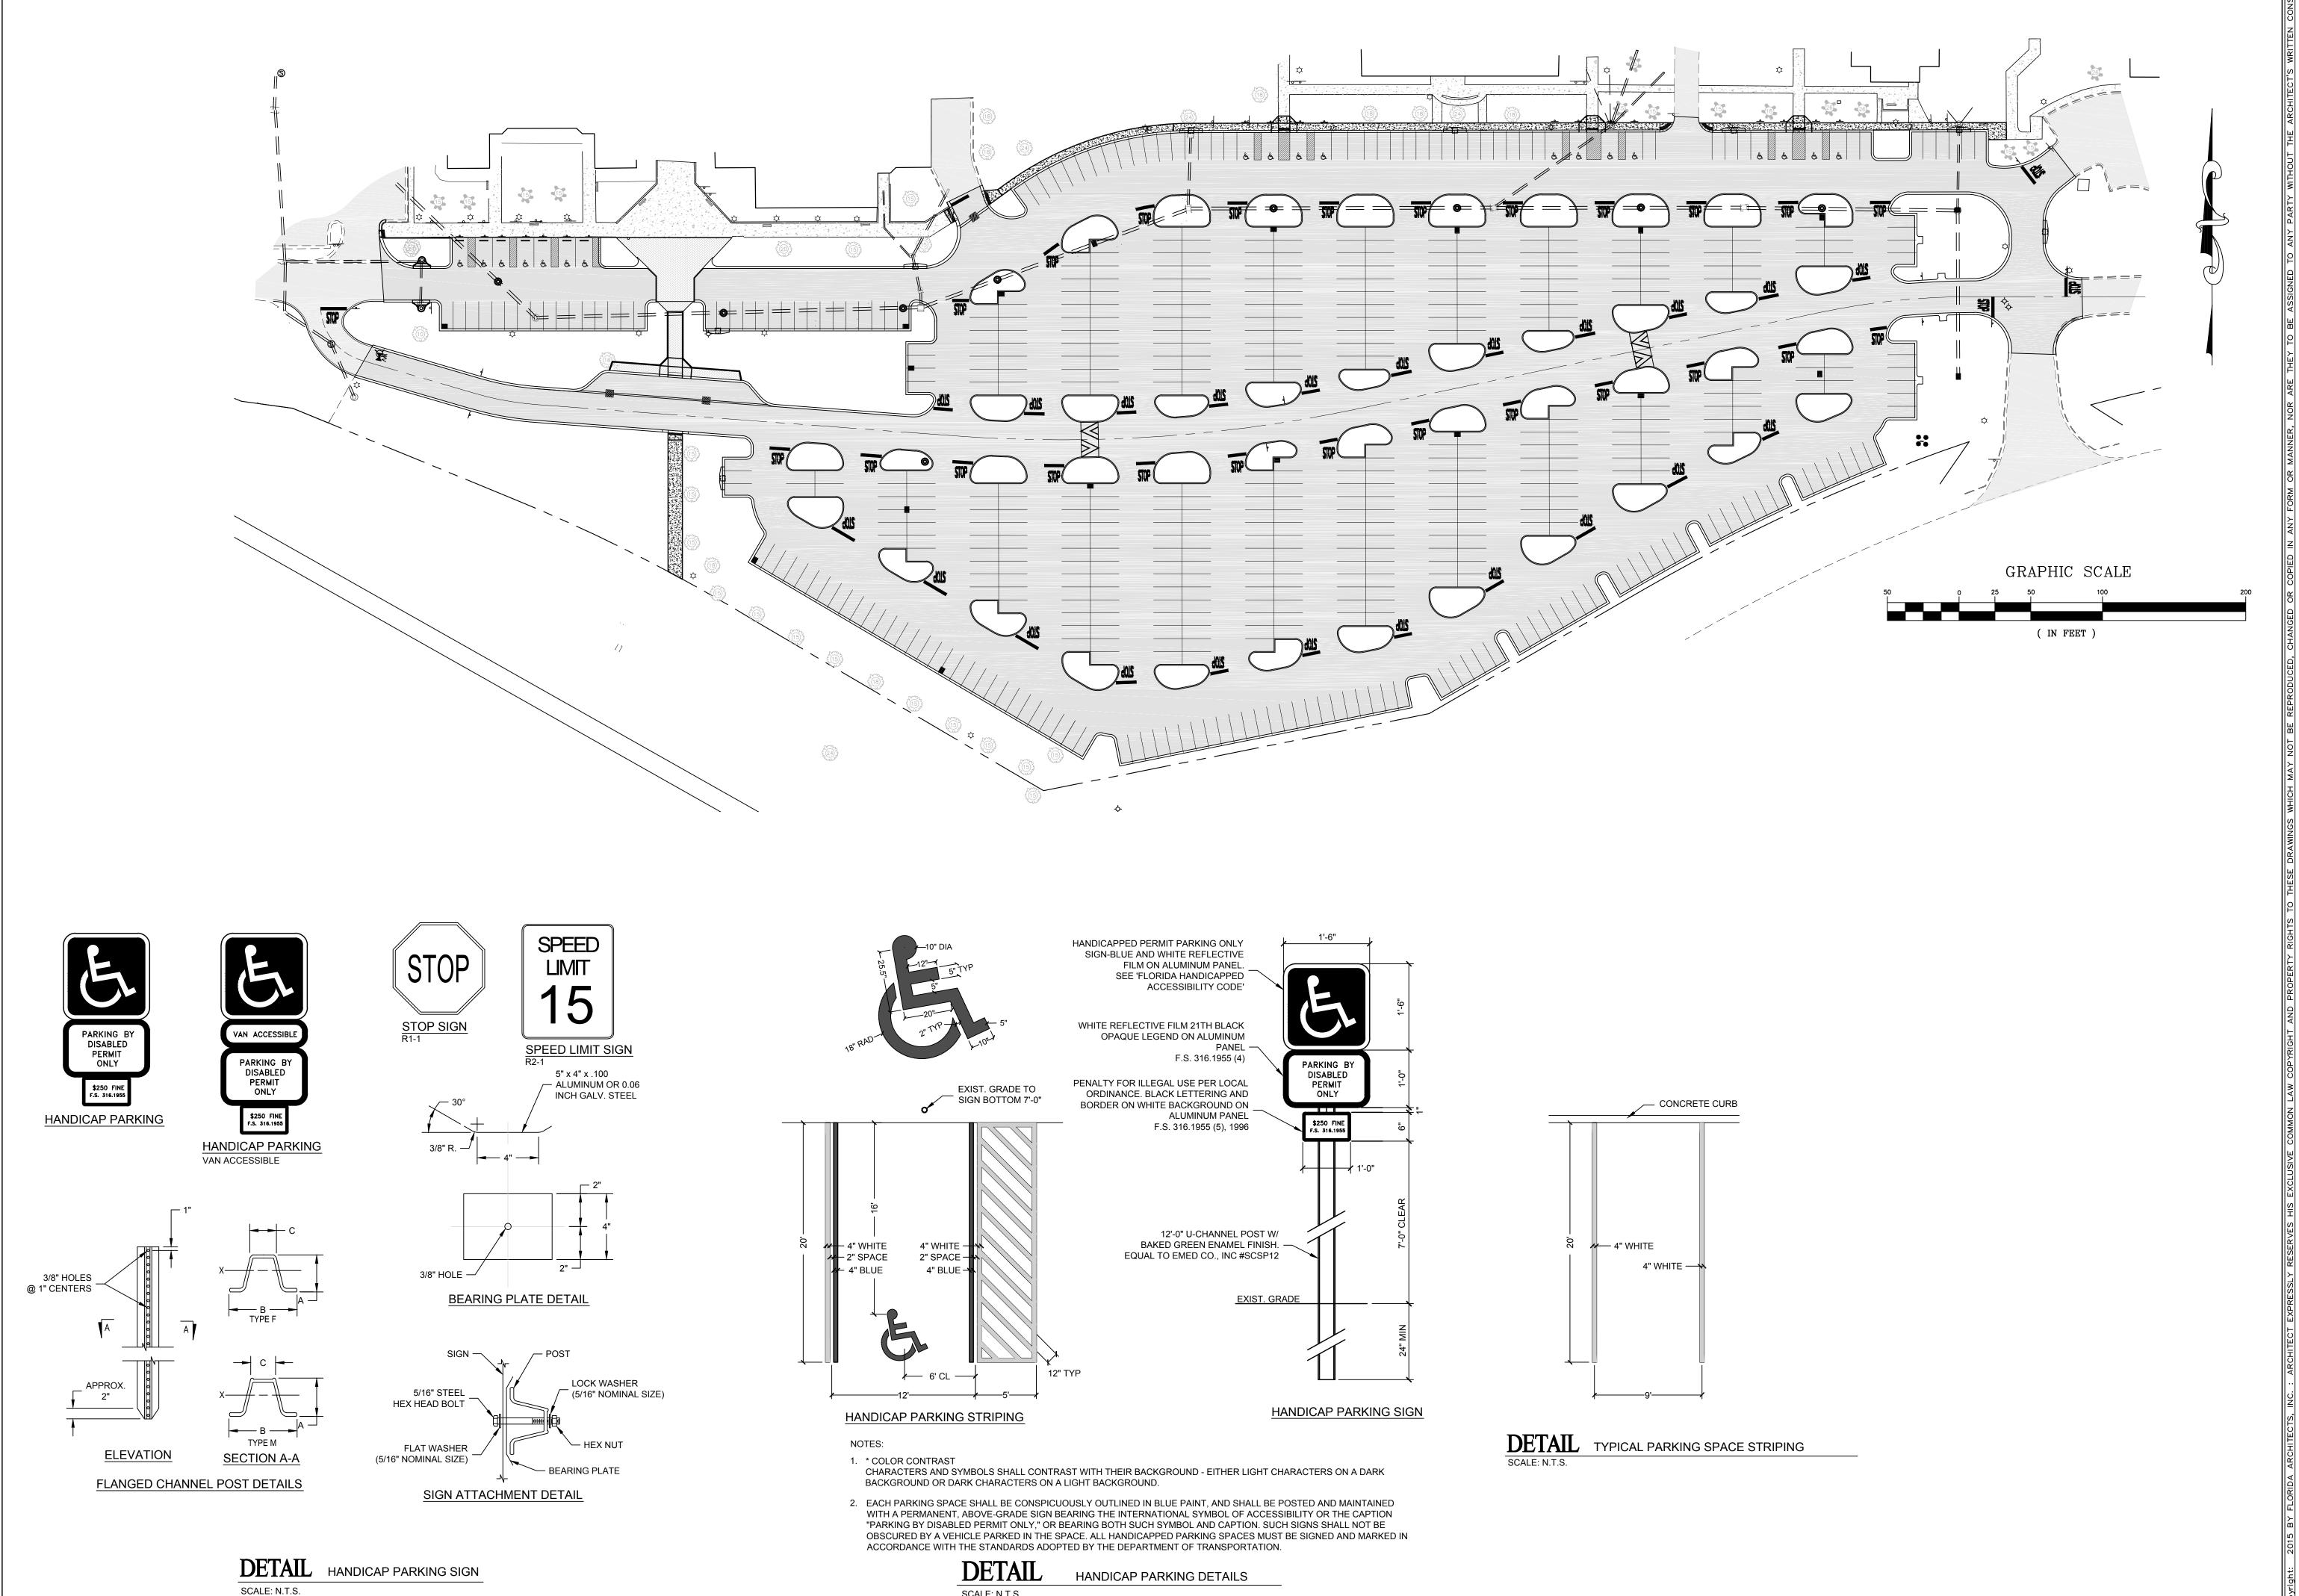

SCALE: N.T.S.

LICENSE #AAOOO2730 648 Florida Avenue Panama City, Fl. 32401

P 850/257-5400

JONATHAN SKLARSKI FL. P.E. 67361

> Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By: Checked By:

> > J.S.


COLLEGE CAMPUS STATE COAST **PHASE**

GULF


SIGNAGE STRIPING OVERALL

BID DOCUMENTS

Sheet Number

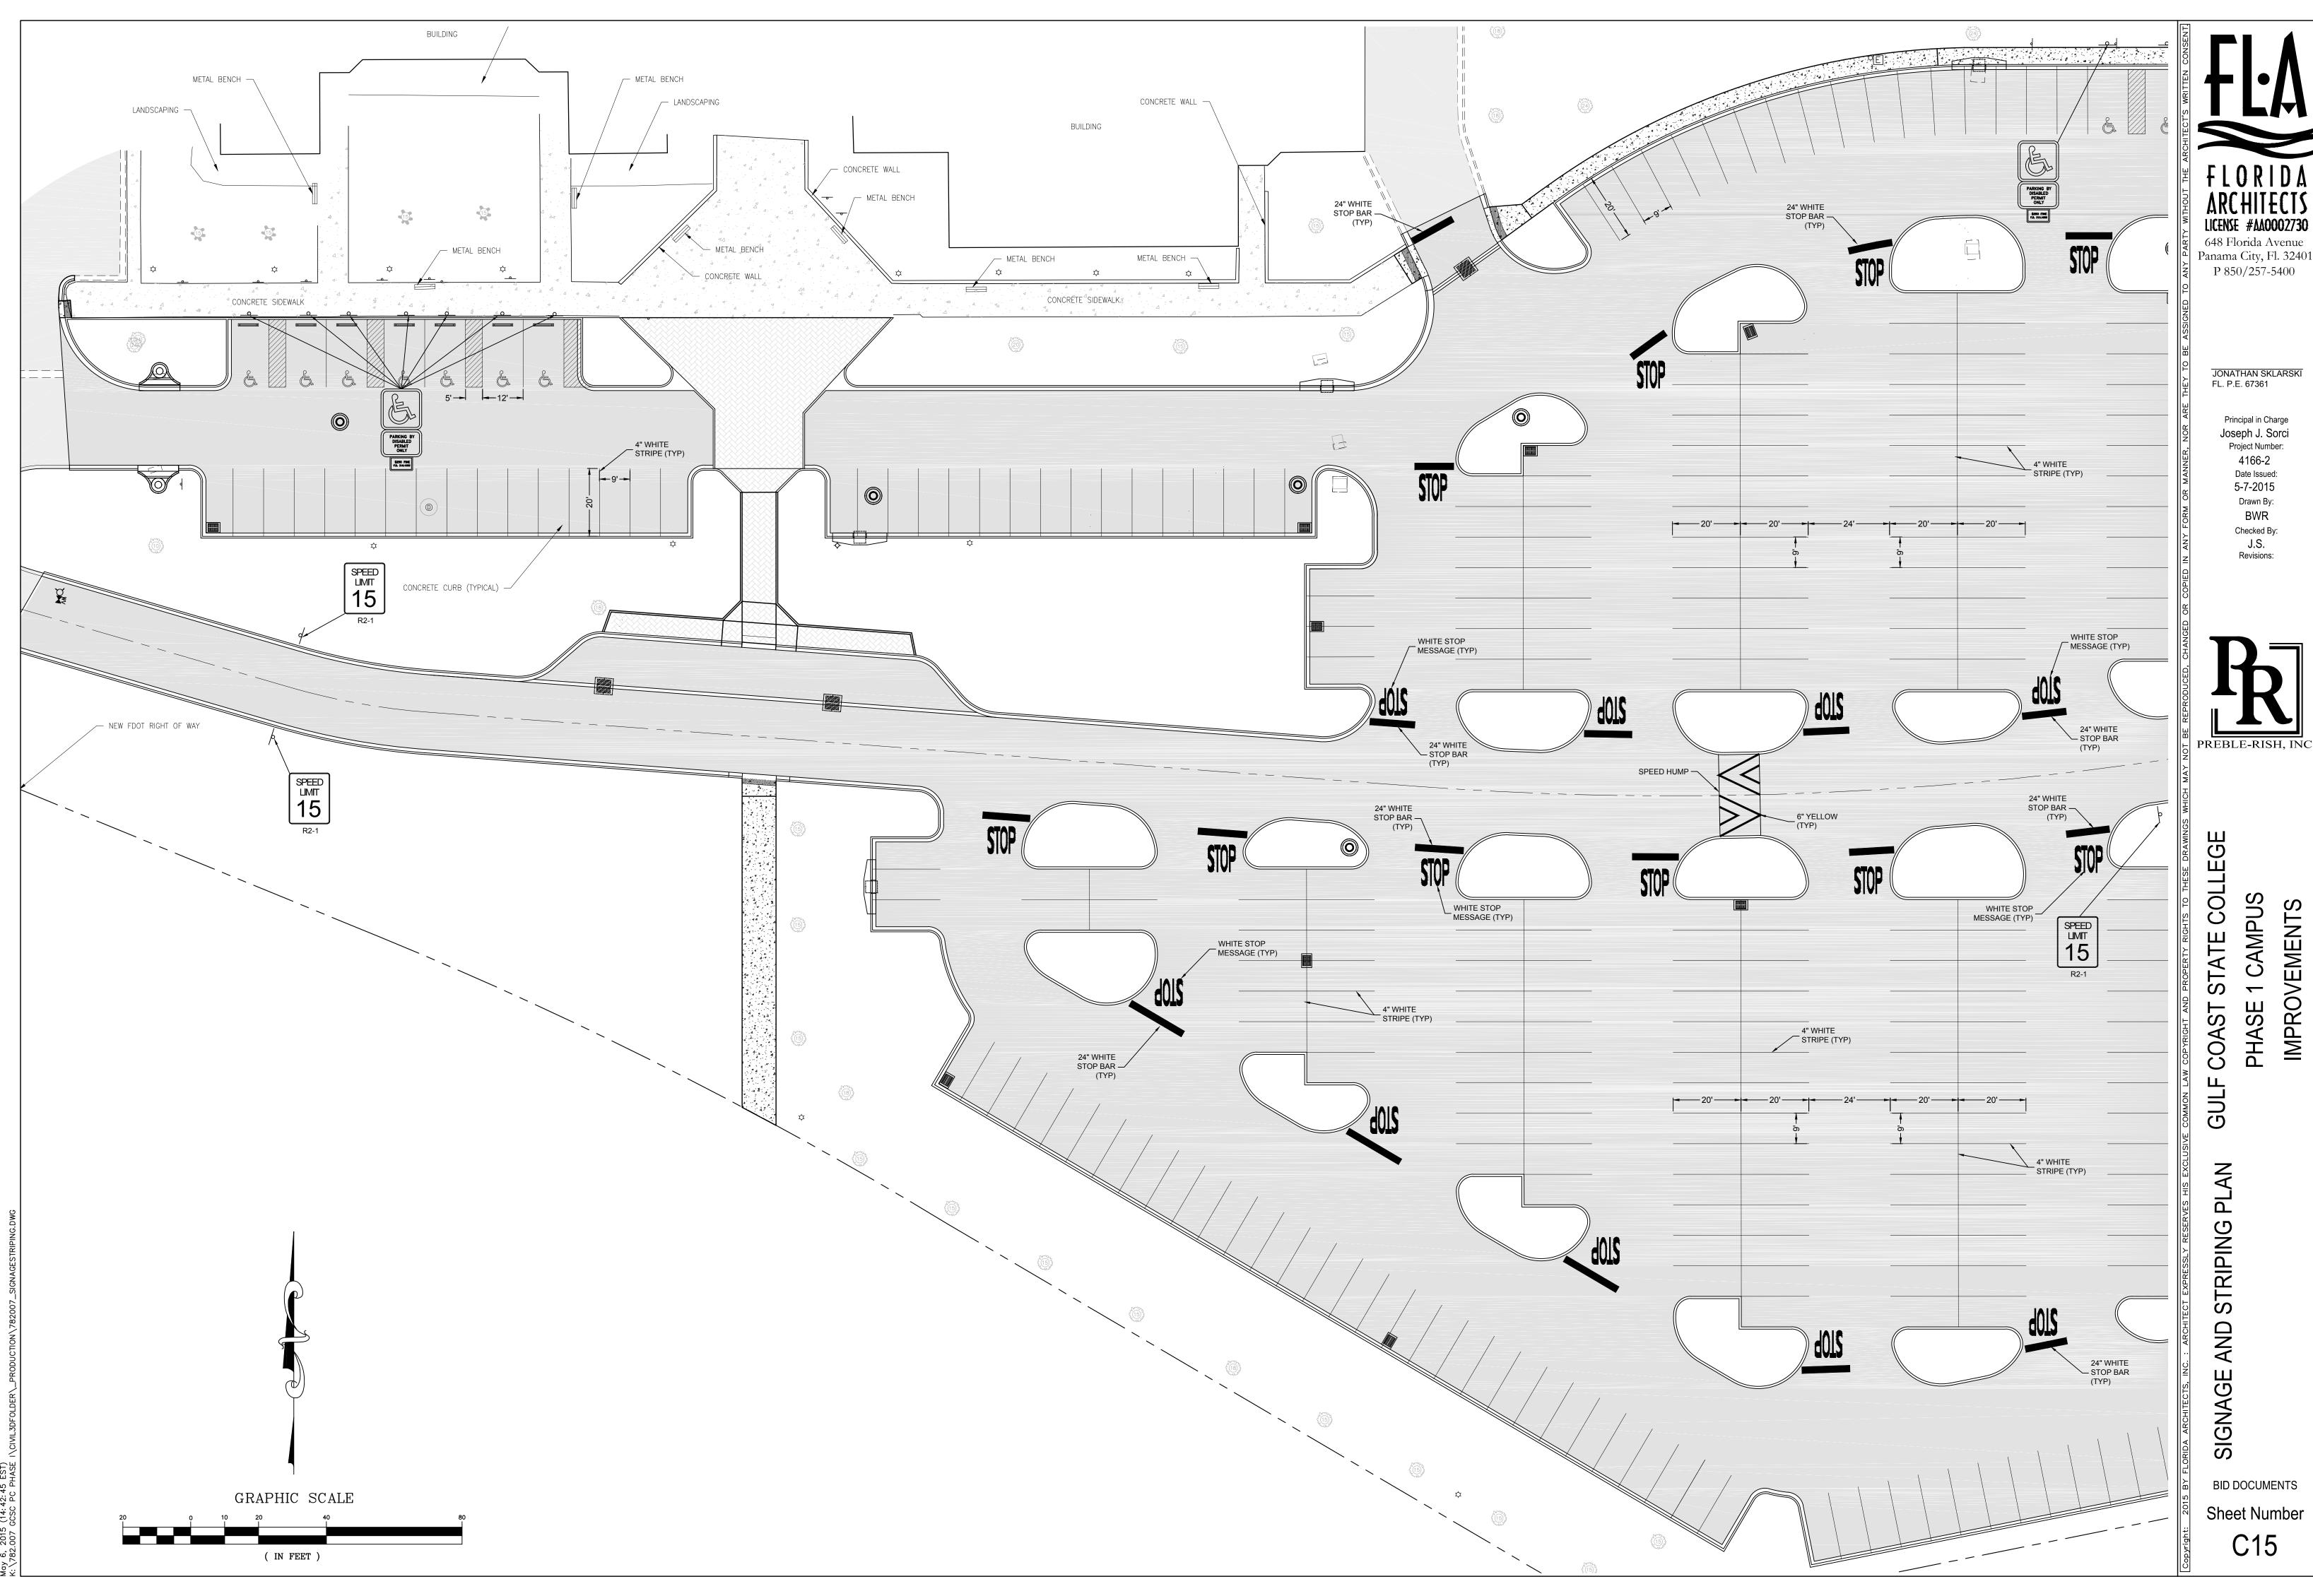

LICENSE #AAOOO2730 Panama City, Fl. 32401

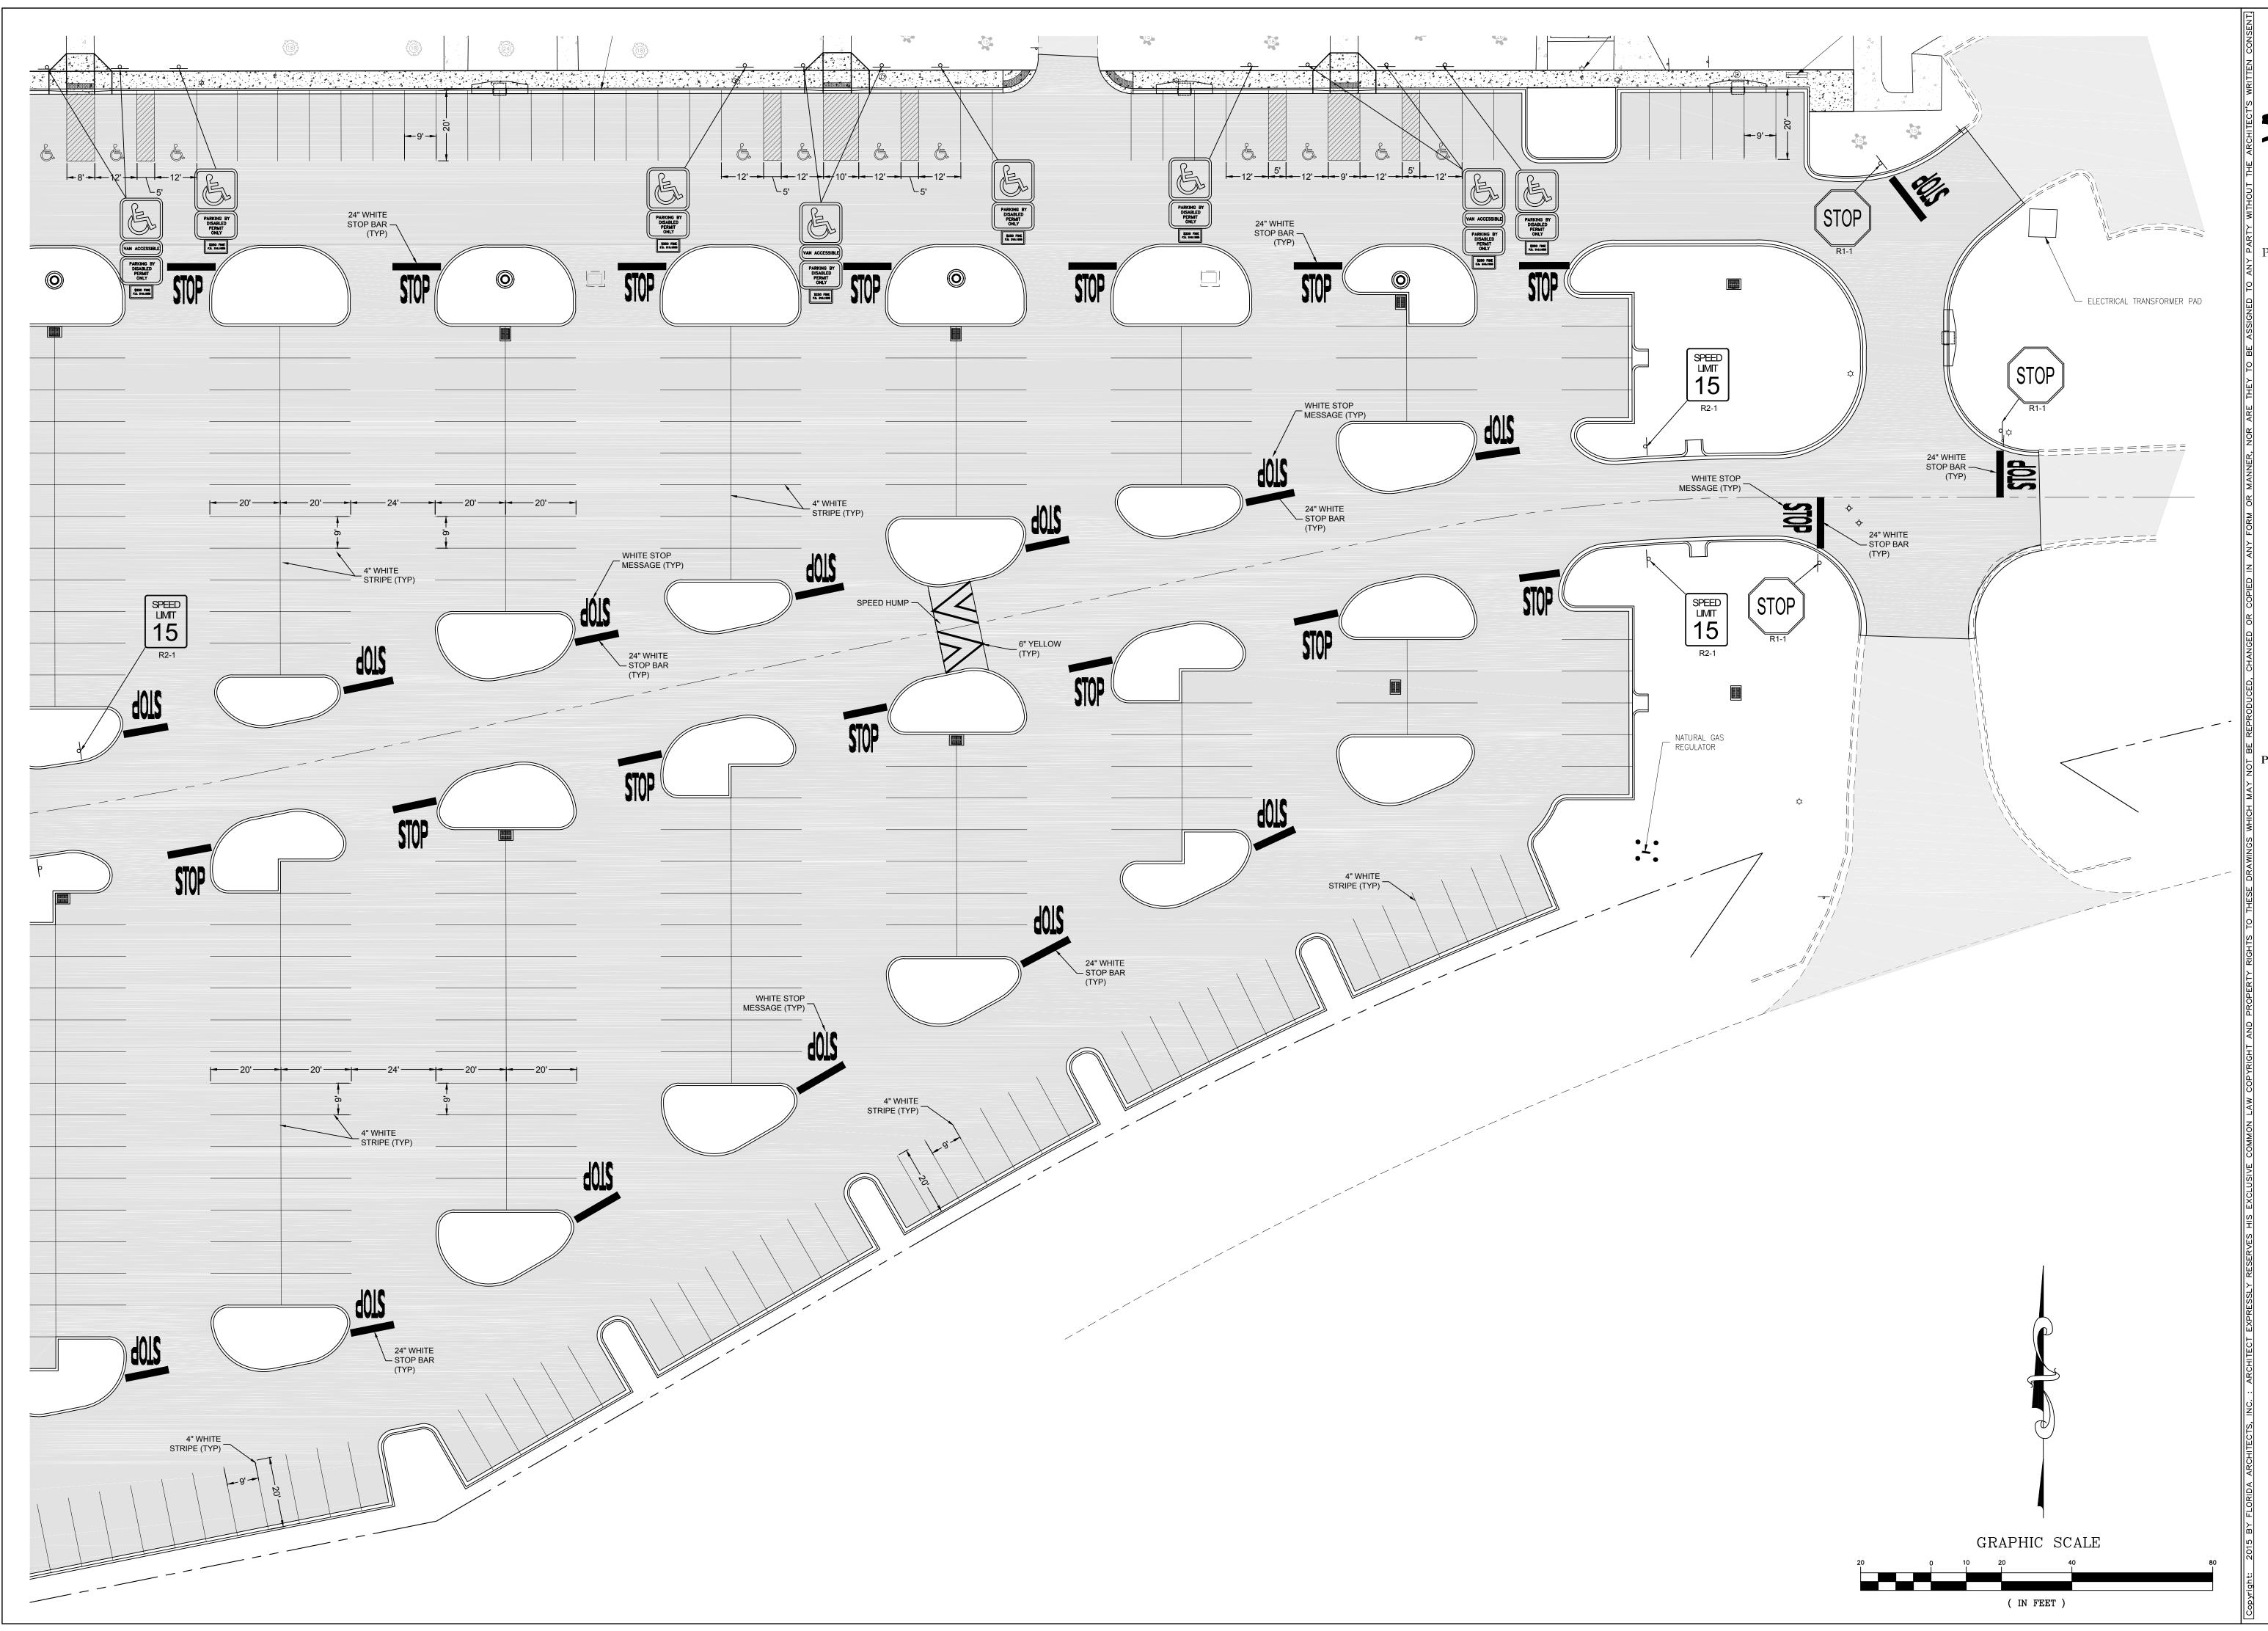

FLORIDA
ARCHITECTS
LICENSE #AA0002730
648 Florida Avenue
Panama City, Fl. 32401
P 850/257-5400

JONATHAN SKLARSKI FL. P.E. 67361

Principal in Charge
Joseph J. Sorci
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
B.R.
Checked By:
J.S.
Revisions:

REBLE-RISH, INC

GULF COAST STATE COLLEGE
PHASE 1 CAMPUS
IMPROVEMENTS

SIGNAGE AND STRIPING PLAN G

BID DOCUMENTS

Sheet Number

A. NATURE OF CONSTRUCTION ACTIVITY:

THIS PROJECT CONSISTS OF THE DEMOLITION OF EXISTING PARKING AND RECONSTRUCTION OF PAVED PARKING, DRIVEWAYS, STORMWATER CONVEYANCE, SIDEWALKS AND LANDSCAPE ISLANDS.

B. SEQUENCE OF MAJOR SOIL DISTURBING ACTIVITIES:

THE FOLLOWING SEQUENCE OF MAJOR ACTIVITIES SHALL BE FOLLOWED UNLESS THE CONTRACTOR CAN PROPOSE AN ALTERNATIVE THAT IS EQUAL OR BETTER AT CONTROLLING EROSION AND SEDIMENT AND IS APPROVED BY THE ENGINEER. THE DETAILED SEQUENCE FOR THE ENTIRE PROJECT CAN VARY SIGNIFICANTLY FROM CONTRACTOR TO CONTRACTOR. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING A DETAILED SEQUENCE OF CONSTRUCTION FOR ALL CONSTRUCTION ACTIVIES IN SECTION 104 EROSION CONTROL

FOR EACH CONSTRUCTION PHASE, INSTALL PERIMETER CONTROLS BEFORE BEGINNING OTHER WORK FOR THE CONSTRUCTION PHASE. REMOVE PERIMETER CONTROLS ONLY AFTER DISTURBED AREAS ARE

C. AREA ESTIMATES

TOTAL SITE AREA: 72 AC. 9.1 AC. TOTAL AREA DISTURBED:

D. RUNOFF DATA:

RUNOFF COEFFICIENT: BEFORE: 0.30 (UNPAVED); 0.98 (PAVED)

DURING: FROM 0.30 TO 0.50 (UNPAVED); 0.30 TO 0.98 (PAVED) AFTER: 0.30 (UNPAVED); 0.98 (PAVED)

SOIL DATA:

SEE ATTACHED GEOTECHNICAL REPORT

OUTFALL INFORMATION:

ALL DRAINAGE WILL CONNECT TO EXISTING OUTFALLS.

THE LOCATION MAP ON THE KEY SHEET DESCRIBES THE SITE.

SPECIFICALLY: DRAINAGE PATTERNS:

EXISTING DRAINAGE FLOWS GENERALLY TO LOCAL DRAINAGE NETWORKS OR DIRECTLY TO ADJACENT WOODS AND ULTIMATELY TO THE GULF OF MEXICO.

APPROXIMATE SLOPES: 0 TO 5 PERCENT

AREA OF SOIL DISTURBANCE: PROPOSED SITE, DRIVEWAYS, PARKING, AND DEMOLISHED FACILITIES. AREAS NOT TO BE DISTURBED: OUTSIDE OF EXISTING PROJECT LIMITS.

LOCATIONS OF TEMPORARY CONTROLS: TEMPORARY STABILIZATION PRACTICES WILL BE DESCRIBED IN THE NARRATIVE.

LOCATIONS OF PERMANENT CONTROLS: LOCATION OF PERMANENT STABILIZATION IS SHOWN ON THE PLANS.

AREAS TO BE STABILIZED: TEMPORARY STABILIZATION PRACTICES ARE SHOWN IN THE SAME LOCATION AS THE

TEMPORARY CONTROLS MENTIONED ABOVE. PERMANENT STABILIZATION IS SHOWN ON THE PLAN

SURFACE WATERS: NONE

DISCHARGE POINTS TO SURFACE WATERS: NO NEW DISCHARGE POINTS

F. RECEIVING WATERS:

RUNOFF FROM THE EXISTING DRAINAGE SYSTEM DISCHARGES THROUGH TREATMENT FACILITIES TO ST. ANDREW BAY.

2.0 CONTROLS

A. EROSION AND SEDIMENT CONTROLS:

THE FOLLOWING DISCUSSION DEFINES GENERAL GUIDELINES FOR THE SEQUENCES OF CONSTRUCTION AND THE USE OF STABILIZATION AND STRUCTURAL PRACTICES. THE CONTRACTOR IS ALSO RESPONSIBLE FOR DOCUMENTING THIS PORTION OF THE SWPPP IN THE SECTION 104 EROSION CONTROL PLAN, ALL ITEMS REPRESENTED IN THE FOLLOWING DISCUSSION ARE TREATED IN DETAIL IN THE "FLORIDA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION" (2010). THE CONTRACTOR SHALL GENERATE AN IMPLEMENTATION SCHEDULE FOR EACH PHASE OF CONSTRUCTION OPERATIONS OR ACTIVITIES.

1. STABILIZATION PRACTICES:

IN THE SECTION 104 EROSION CONTROL PLAN, THE CONTRACTOR SHALL DESCRIBE THE STABILIZATION PRACTICES PROPOSED TO CONTROL EROSION. THE CONTRACTOR SHALL INITIATE ALL STABILIZATION MEASURES AS SOON AS PRACTICAL BUT IN NO CASE IN MORE THAN 7 DAYS. THE STABILIZATION PRACTICES SHALL INCLUDE AT LEAST THE FOLLOWING, UNLESS OTHERWISE APPROVED BY THE ENGINEER.

PERMANENT:

SOD IN ACCORDANCE WITH SPECIFICATION SECTION 575. ALL STABILIZATION PRACTICES SHALL BE INITIATED AS SOON AS PRACTICABLE IN PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITIES ARE TEMPORARILY OR PERMANENTLY CEASED. THE CONTRACTOR IS ALSO RESPONSIBLE FOR DOCUMENTING THIS PORTION OF THE SWPPP ON THE SECTION 104 EROSION CONTROL PLAN.

TEMPORARY:

SEED AND MULCH AND SOD IN ACCORDANCE WITH SPECIFICATION SECTION 104

2. STRUCTURAL PRACTICES:

ALL SEDIMENT CONTROLS SHALL BE IN PLACE PRIOR TO ANY SOIL DISTURBING ACTIVITY UPSTREAM OF THE CONTROL. THE CONTRACTOR IS ALSO RESPONSIBLE FOR DOCUMENTING THIS PORTION OF THE SWPPP ON THE SECTION 104 EROSION CONTROL PLAN.

SEDIMENT BARRIERS, TURBIDITY BARRIERS AND INLET PROTECTION

B. STORMWATER MANAGEMENT

STORMWATER WILL BE CONVEYED THROUGH CLOSED CONVEYANCE SYSTEMS AND DITCHES TO LOCAL

STORMWATER TREATMENT FACILITIES.

C. OTHER CONTROLS WASTE DISPOSAL

IN THE SECTION 104 EROSION CONTROL PLAN, THE CONTRACTOR SHALL DESCRIBE PROPOSED METHODS TO PREVENT THE DISCHARGE OF SOLID MATERIALS, INCLUDING BUILDING MATERIALS, TO WATERS OF THE UNITED STATES. THE PROPOSED METHODS SHALL INCLUDE AT LEAST THE FOLLOWING, UNLESS OTHERWISE APPROVED BY THE ENGINEER.

PROVIDE LITTER CONTROL AND COLLECTION WITHIN THE PROJECT DURING CONSTRUCTION ACTIVITES.

DISPOSE OF ALL FERTILIZER OR OTHER CHEMICAL CONTAINERS ACCORDING TO EPA'S STANDARD PRACTICES AS DETAILED BY THE MANUFACTURER.

DISPOSE OF SOLID MATERIALS INCLUDING BUILDING AND CONSTRUCTION MATERIALS OFFSITE BUT NOT IN SURFACE WATERS OR WETLANDS.

2. OFFSITE VEHICLE TRACKING:

IN THE SECTION 104 EROSION CONTROL PLAN, THE CONTRACTOR SHALL DESCRIBE THE PROPOSED METHODS FOR MINIMIZING OFFSITE VEHICLE TRACKING OF SEDIMENTS AND GENERATING DUST. UNLESS APPROVED BY THE ENGINEER, THE PROPOSED METHODS SHALL INCLUDE AT LEAST THE FOLLOWING.

COVERING LOADED HAUL TRUCKS WITH TARPAULINS.

REMOVING EXCESS DIRT FROM ROADS DAILY.

STABILIZING CONSTRUCTION ENTRANCES ACCORDING TO DESIGN STANDARD 106.

USING ROADWAY SWEEPERS DURING DUST GENERATING ACTIVITIES SUCH AS EXCAVATION AND MILLING OPERATIONS.

3. STATE AND LOCAL REGULATIONS FOR WASTE DISPOSAL, SANITARY SEWER OR SEPTIC TANK

IN THE SECTION 104 EROSION CONTROL PLAN, THE CONTRACTOR SHALL DESCRIBE THE PROPOSED PROCEDURES TO COMPLY WITH APPLICABLE STATE AND LOCAL REGULATIONS FOR WASTE DISPOSAL, SANITARY SEWER AND SEPTIC SYSTEMS.

4. FERTILIZERS AND PESTICIDES:

FERTILIZERS SHALL BE APPLIED ACCORDING TO SPECIFICATION SECTION 570 OR 577 OF THE FDOT STANDARD SPECIFICATIONS. THE CONTRACTOR IS ALSO RESPONSIBLE FOR DOCUMENTING THIS PORTION OF THE SWPPP ON THE SECTION 104 EROSION CONTROL PLAN.

5. TOXIC SUBSTANCES:

IN THE SECTION 104 EROSION CONTROL PLAN, THE CONTRACTOR SHALL PROVIDE A LIST OF TOXIC SUBSTANCES THAT ARE LIKELY TO BE USED ON THE JOB AND PROVIDE A PLAN ADDRESSING THE GENERATION, APPLICATION, MIGRATION, STORAGE AND DISPOSAL OF THESE SUBSTANCES.

3.0 MAINTENANCE:

REPLACEMENT ITEM

INTERVAL MAINTENANCE SILT FENCE IN ACCORDANCE WITH SECTION 104 1 YEAR

REMOVE MILLED MATERIAL AND DEBRIS 1 YEAR INLET PROTECTION FROM BAGS TO KEEP FROM ENTERING TRAFFIC LANE AND CURB INLETS

THE CONTRACTOR IS ALSO RESPONSIBLE FOR DOCUMENTING THIS PORTION OF THE SWPPP

4.0 INSPECTIONS QUALIFIED PERSONNEL SHALL INSPECT THE FOLLOWING ITEMS AT LEAST ONCE EVERY SEVEN CALENDAR DAYS AND WITHIN 24 HOURS OF THE END OF A STORM THAT IS 0.5 INCHES OR GREATER. THE ENGINEER SHALL BE RESPONSIBLE FOR COMPLETING THE WEEKLY INSPECTION REPORT FORM AND SUBMISSION OF THE FORM TO THE FDOT CENTRAL OFFICE ON A MONTHLY BASIS. WHERE SITES HAVE BEEN FINALLY STABILIZED, INSPECTIONS SHALL BE CONDUCTED AT LEAST ONCE EVERY MONTH.

- POINTS OF DISCHARGE TO WATERS OF THE UNITED STATES

ON THE SECTION 104 EROSION CONTROL PLAN

- DISTURBED AREAS OF THE SITE THAT HAVE NOT BEEN FINALLY STABILIZED

- STRUCTURAL CONTROLS

- AREAS USED FOR STORAGE OF MATERIALS THAT ARE EXPOSED TO PRECIPITATION

- LOCATIONS WHERE VEHICLES ENTER OR EXIT THE SITE

5.0 NON-STORMWATER DISCHARGES

THE CONTRACTOR IS ALSO RESPONSIBLE FOR DOCUMENTING THIS PORTION OF THE SWPPP ON THE SECTION 104 EROSION CONTROL PLAN. IF CONTAMINATED SOIL OR GROUNDWATER IS ENCOUNTERED, CONTACT THE PROJECT ADMINISTRATOR AND ENGINEER OF RECORD

PHASING OF IMPLEMENTATION

PHASE I - INSTALLATION OF ENVIRONMENTAL CONTROL FEATURES

ENVIRONMENTAL CONTROL FEATURES AS PROVIDED IN PLANS QUANTITIES ARE TO BE INSTALLED THROUGHOUT THE CONSTRUCTION LIMITS, AT ENVIRONMENTALLY SENSITIVE AREAS AS SHOWN ON THE PLANS, OR AT AREAS AS DIRECTED BY THE PROJECT ADMINISTRATOR. THESE FEATURES INCLUDE, BUT ARE NOT LIMITED TO, SILT FENCE, SYNTHETIC BALES, ETC.

PHASE II - SITE WORK OPERATIONS

SITE WORK SHALL BE DONE AS INDICATED ON THE PLANS.

PHASE III - DRAINAGE SYSTEM OR STRUCTURE ENVIRONMENTAL CONTROL FEATURES

ENVIRONMENTAL CONTROL FEATURES AS PROVIDED IN PLANS ARE TO BE INSTALLED AT ALL AREAS OF EXCAVATION OR FILL FOR DRAINAGE SYSTEM OR STRUCTURE CONSTRUCTION PRIOR TO SUCH EXCAVATION OR FILL. ALL STREAMS OR DITCHES ARE TO BE PROTECTED FROM EROSION OR SILTATION BY METHODS DETAILED IN THE STANDARD INDICES. THESE INCLUDE SILT FENCE, SYNTHETIC BALES, ETC.

PHASE IV - MAINTENANCE OF ENVIRONMENTAL CONTROL FEATURES

ALL ENVIRONMENTAL CONTROL FEATURES ARE TO BE MAINTAINED THROUGHOUT THE LIFE OF THE PROJECT AS NECESSARY FOR THE VARIOUS CONSTRUCTION PHASES. THE CONTRACTOR MUST INSURE THAT ALL OF THESE FEATURES FUNCTION PROPERLY AT ALL

GENERAL NOTES

1. THE CONTRACTOR MAY CONSTRUCT THE PROJECT IN SEGMENTS BUT EACH OF THE ABOVE PHASES MUST BE FOLLOWED FOR EACH SEGMENT.

2. ALL EROSION AND MATERIAL DEPOSITS MUST BE CONTAINED WITHIN THE PROJECT

STORMWATER SYSTEM MAINTENANCE NOTES:

- 1. CONTRACTOR SHALL STAGE AND TIME CONSTRUCTION TO MINIMIZE THE SIZE OF EXPOSED SOIL AREAS AND THE TIME BETWEEN EXPOSING THE SOIL AREA AND FINISHING THE SOIL AREA.
- 2. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR PERFORMING A TASK TO PROVIDE EROSION CONTROL UNLESS ANOTHER PARTY HAS BEEN PREVIOUSLY SPECIFIED AS RESPONSIBLE FOR THE EROSION CONTROL ASSOCIATED WITH THAT TASK. IN THE EVENT ANOTHER PARTY IS RESPONSIBLE FOR EROSION CONTROL, THE CONTRACTOR SHALL STILL BE RESPONSIBLE FOR COORDINATION WITH THE PARTY RESPONSIBLE. IN THE EVENT THAT DAMAGE TO THE CONSTRUCTED ITEM RESULTS ARE DUE TO LACK OF EROSION CONTROL, THE CONTRACTOR SHALL REPAIR OR REPLACE THE ITEM AT NO CHARGE TO THE OWNER.
- 3. THE CONTRACTOR IS TO PROVIDE EROSION CONTROL/ SEDIMENTATION BARRIER (HAY BALES, SILT FENCE, TURBIDITY BARRIER, OR AS SPECIFIED IN THE CONSTRUCTION DRAWINGS) TO PREVENT SILTATION OF ADJACENT PROPERTY, STREETS, STORM SEWERS, WATERWAYS, AND WETLAND OR JURISDICTIONAL AREAS. IF, IN THE OPINION OF THE ENGINEER, AND/OR REGULATORY AUTHORITIES, EXCESSIVE QUANTITIES OF MATERIAL ARE TRANSPORTED OFF-SITE BY EROSION OR STORMWATER RUNOFF, THE CONTRACTOR SHALL IMPROVE CONDITIONS TO THE SATISFACTION OF THE ENGINEER AND/OR AUTHORITIES AT NO ADDITIONAL COST TO THE OWNER. IN NO CASE SHALL CONSTRUCTION COMMENCE PRIOR TO INSTALLATION OF EROSION CONTROL/SEDIMENTATION BARRIER.
- 4. CONTRACTOR SHALL PLACE STRAW, MULCH, OR OTHER SUITABLE MATERIAL ON GROUND IN AREAS WHERE CONSTRUCTION-RELATED TRAFFIC IS TO ENTER AND EXIT SITE.
- 5. IF WIND EROSION BECOMES SIGNIFICANT DURING CONSTRUCTION, THE CONTRACTOR SHALL STABILIZE THE AREA USING SPRINKLING IRRIGATION OR OTHER ACCEPTABLE METHODS.
- 6. ALL NEW DRAINAGE PIPE SHALL BE AS INDICATED ON PLANS OR APPROVED EQUAL.
- 7. CONTRACTOR SHALL BE RESPONSIBLE FOR CONSTRUCTION MONITORING, NOTICE OF COMMENCEMENT, AND AS-BUILT CERTIFICATION.
- 8. CONTRACTOR SHALL PREPARE A DEWATERING AND STOCKPILE PLAN AS PART OF THE NPDES
- 9. THE OWNER IS TO MAINTAIN THE STORMWATER SYSTEM PER THE OPERATION AND MAINTENANCE PLAN.

648 Florida Avenue

JONATHAN SKLARSKI FL. P.E. 67361

Panama City, Fl. 32401

P 850/257-5400

Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued: Checked By



GE Ш

COL 'ATE COAS

ORMW/

GUL

BID DOCUMENTS

TYPE III SILT FENCE PROTECTION

AROUND DITCH BOTTOM INLETS.

SILT FENCE APPLICATIONS

DO NOT DEPLOY IN A MANNER THAT SILT FENCES WILL ACT AS A DAM ACROSS PERMANENT FLOWING

WATERCOURSES. SILT FENCES ARE TO BE USED AT UPLAND LOCATIONS AND TURBIDITY BARRIERS

NOTE: SILT FENCE TO BE PAID FOR UNDER THE CONTRACT UNIT PRICE FOR STAKED SILT FENCE (LF). TYPE III SILT FENCE

TYPE III SILT FENCE

- WIRE FENCE - WHERE REQUIRED

LINE

NOTES:

SCALE: N.T.S.

1. DIG TRENCH 6" DEEP.

6'-0" MIN.

SPACING.

2. LAY IN FABRIC TO BOTTOM OF TRENCH.

DETAIL SILT FENCE

3. BACK TRENCH, COVERING FABRIC.


COMMERCIAL SILT FENCE ON

UPSTREAM SIDE OF POSTS

5' METEL POST OR

2" X 2" WOOD POST

USED AT PERMANENT BODIES OF WATER.

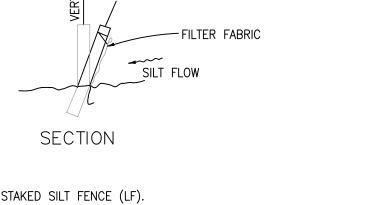

NOTE: SPACING FOR TYPE III FENCE TO BE

IN ACCORDANCE WITH CHART 1, SHEET 1 OF 3 AND DITCH INSTALLATIONS AT DRAINAGE

TYPE III SILT FENCE

STRUCTURES SHEET 2 OF 3.


PARTIAL INLET COMPLETED INLET

ANCHOR BALES WITH

2 - 2" X 2" X 4'

STAKES PER BALE.

-APRON 🖯

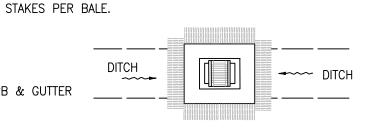


DITCH BOTTOM INLET

ANCHOR BALES WITH


2 - 2" X 2" X 4'

AROUND INLETS OR SIMILAR STRUCTURES


- SIDEWALK -

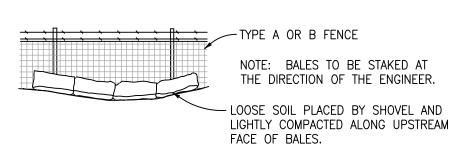


BALES BACKED

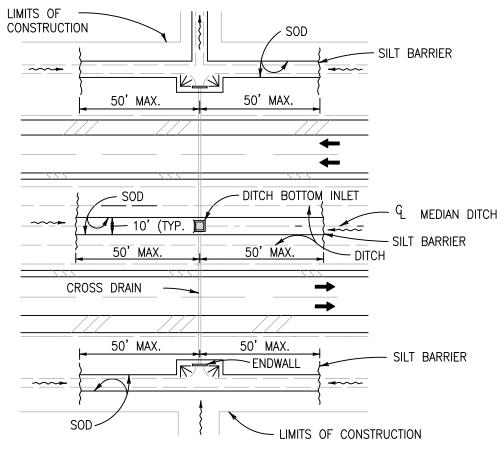


DITCH INSTALLATIONS AT DRAINAGE STRUCTURES

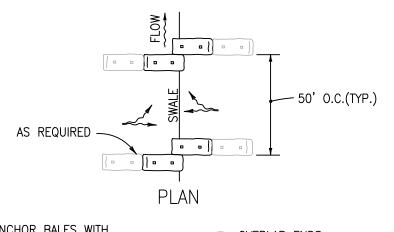


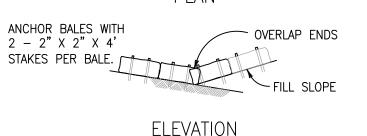

TO BE USED AT SELECTED SITES WHERE THE NATURAL GROUND SLOPES TOWARD THE TOE OF SLOPE

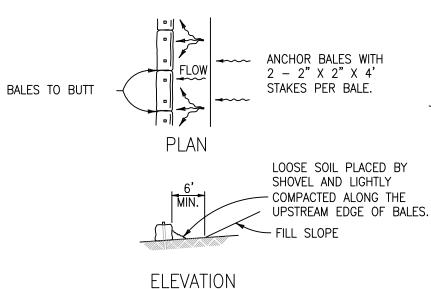

TO BE USED AT SELECTED SITES WHERE THE NATURAL GROUND SLOPES AWAY FROM THE TOE OF SLOPE

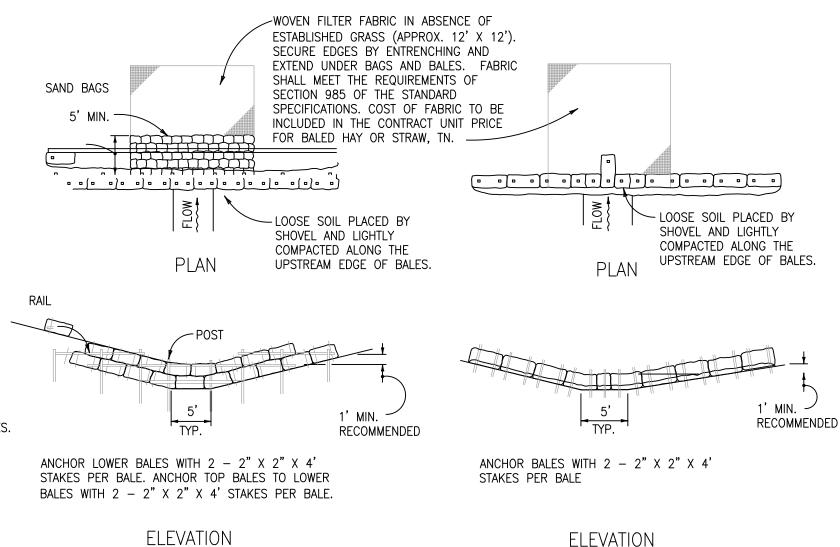

ELEVATION

BARRIER FOR PAVED DITCH

SPACING: BALE BARRIERS FOR PAVED DITCHES SHOULD BE SPACED

IN ACCORDANCE WITH THE CHART BELOW

ANCHOR BALES WITH

2 - 2" X 2" X 4'

STAKES PER BALE.

LOOSE SOIL PLACED BY SHOVEL AND LIGHTLY

EDGE OF BALES.

COMPACTED ALONG UPSTREAM


MIN. RECOMMENDED

TYPE I

CONDITIONS OUTLINED IN THE CHART BELOW.

TYPE II

APPLICATION AND SPACING: THE USE OF TYPES I & II BALE BARRIERS SHOULD BE LIMITED TO THE



Closed Cell Solid Plastic Foam Flotation (6" Dia. Equiv.) (12 Lbs. Per Ft. Buoyancy) — ─5/8" Polypro Rope (600 lb. Breaking 18 Oz. Nylon Reinforced PVC Fabric (300 psi Test) With Lacing Grommets + 1/4" Galvanized Chain

DETAIL TURBIDITY CURTAIN SCALE: N.T.S.

TYPE 1

DEWATERING NOTES


1. THE FACILITY IS AUTHORIZED TO DISCHARGE PRODUCED GROUND WATER FROM ANY NON-CONTAMINATED SITE ACTIVITY WHICH DISCHARGES BY A POINT SOURCE TO SURFACE WATERS OF THE STATE, AS DEFINED IN CHAPTER 62-620, F.A.C., ONLY IF THE REPORTED VALUES FOR THE PARAMETERS LISTED IN TABLE 1 DO NOT EXCEED ANY OF THE LISTED SCREENING VALUES. BEFORE DISCHARGE OF PRODUCED GROUND WATER CAN OCCUR FROM SUCH SITES, ANALYTICAL TESTS ON SAMPLES OF THE PROPOSED UNTREATED DISCHARGE WATER SHALL BE PERFORMED TO DETERMINE IF CONTAMINATION EXISTS.

2. MINIMUM REPORTING REQUIREMENTS FOR ALL PRODUCED GROUND WATER DISCHARGES. THE EFFLUENT SHALL BE SAMPLED BEFORE THE COMMENCEMENT OF DISCHARGE, AGAIN WITHIN THIRTY (30) DAYS AFTER COMMENCEMENT OF DISCHARGE, AND THEN ONCE EVERY SIX (6) MONTHS FOR THE LIFE OF THE PROJECT. SAMPLES SHALL BE TAKEN PRIOR TO ACTUAL DISCHARGE OR MIXING WITH THE RECEIVING WATERS. THE EFFLUENT SHALL BE SAMPLED FOR THE PARAMETERS LISTED IN

	Screening Values for Discharges					
	into:					
Parameter	Fresh Waters	Coastal Waters				
Total Organic Carbon (TOC)	10.0 mg/L	10.0 mg/L				
pH, standard units	6.0 - 8.5	6.5 - 8.5				
Total Recoverable Mercury	0.012 µg/L	0.025 µg/L				
Total Recoverable Cadmium	9.3 µg/L	9.3 µg/L				
Total Recoverable Copper	2.9 µg/L	2.9 µg/L				
Total Recoverable Lead	0.03 mg/L	5.6 µg/L				
Total Recoverable Zinc	86.0 µg/L	86.0 µ/L				
Total Recoverable Chromium (Hex.)	11.0 µg/L	50.0 μg/L				
Benzene	1.0 µg/L	1.0 µg/L				
Naphthalene	100.0 µg/L	100.0 µg/L				

Table 1

- 3. FOR FRESH WATERS AND COASTAL WATERS, THE PH OF THE EFFLUENT SHALL NOT BE LOWERED TO LESS THAN 6.0 UNITS FOR FRESH WATERS, OF LESS THAN 6.5 UNITS FOR COASTAL WATERS, OR RAISED ABOVE 8.5 UNITS, UNLESS NATURAL BACKGROUND DATA CONFIRMING A NATURAL BACKGROUND PH OUTSIDE OF THIS RANGE IS SUBMITTED. IF NATURAL BACKGROUND OF THE RECEIVING WATER IS DETERMINED TO BE LESS THAN 6.0 UNITS FOR FRESH WATERS, OR LESS THAN 6.5 UNITS IN COASTAL WATERS, THE PH SHALL NOT VARY BELOW NATURAL BACKGROUND OR VARY MORE THAN ONE (1) UNIT ABOVE NATURAL BACKGROUND FOR FRESH AND COASTAL WATERS. IF NATURAL BACKGROUND OF THE RECEIVING WATER IS DETERMINED TO BE HIGHER THAN 8.5 UNITS, THE PH SHALL NOT VARY ABOVE NATURAL BACKGROUND OR VARY MORE THAN ONE (1) UNIT BELOW NATURAL BACKGROUND OF FRESH AND COASTAL WATERS. THE CONTRACTOR SHALL INCLUDE THE NATURAL BACKGROUND PH OF THE RECEIVING WATERS WITH THE RESULTS OF THE ANALYSES LISTED IN NOTE 2. FOR PURPOSES OF THIS SECTION ONLY, FRESH WATERS ARE THOSE HAVING A CHLORIDE CONCENTRATION OF LESS THAN 1500 MG/L, AND COASTAL WATERS ARE THOSE HAVING A CHLORIDE CONCENTRATION EQUAL TO OR GREATER THAN 1500 MG/L.
- 4. IN ACCORDANCE WITH RULE 62-302.500 (1) (A-C), F.A.C., THE DISCHARGE SHALL AT ALL TIMES BE FREE FROM FLOATING SOLIDS, VISIBLE FOAM, TURBIDITY, OR VISIBLE OIL IN SUCH AMOUNTS AS TO FORM NUISANCES ON SURFACE WATERS.
- 5. ALL OF THE GENERAL CONDITIONS LISTED IN RULE 62-621.250, F.A.C., ARE APPLICABLE.

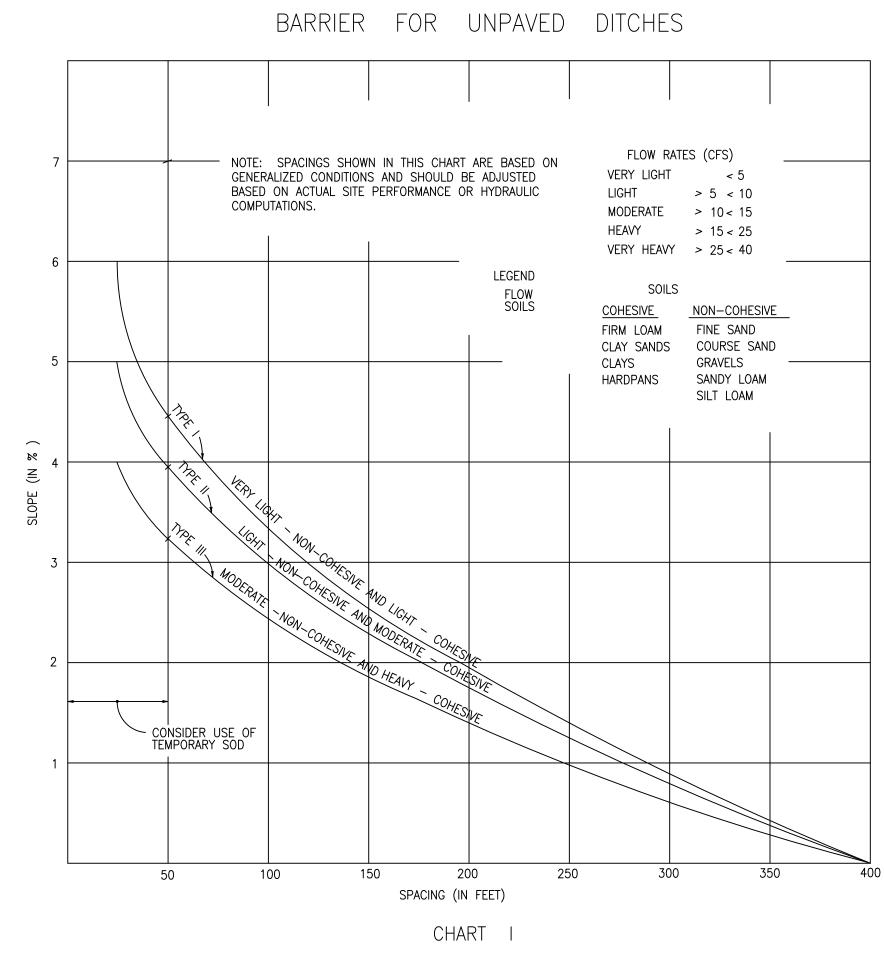

RECOMMENDED SPACING FOR TYPE I AND TYPE II HAY BALE BARRIERS, AND TYPE III SILT FENCES

BID DOCUMENTS

Sheet Number C18

PREVENTION

LICENSE #AA0002730

648 Florida Avenue

Panama City, Fl. 32401

P 850/257-5400

JONATHAN SKLARSKI

Principal in Charge

Joseph J. Sorci

Project Number:

4166-2

Date Issued:

5-7-2015

Drawn By:

BWR

Checked By:

J.S.

Revisions:

PREBLE-RISH, INC

CAMPUS

PHASE

COLLEGE

TATE


COAST

GUL

POLLUTION

STORMWATER

FL. P.E. 67361

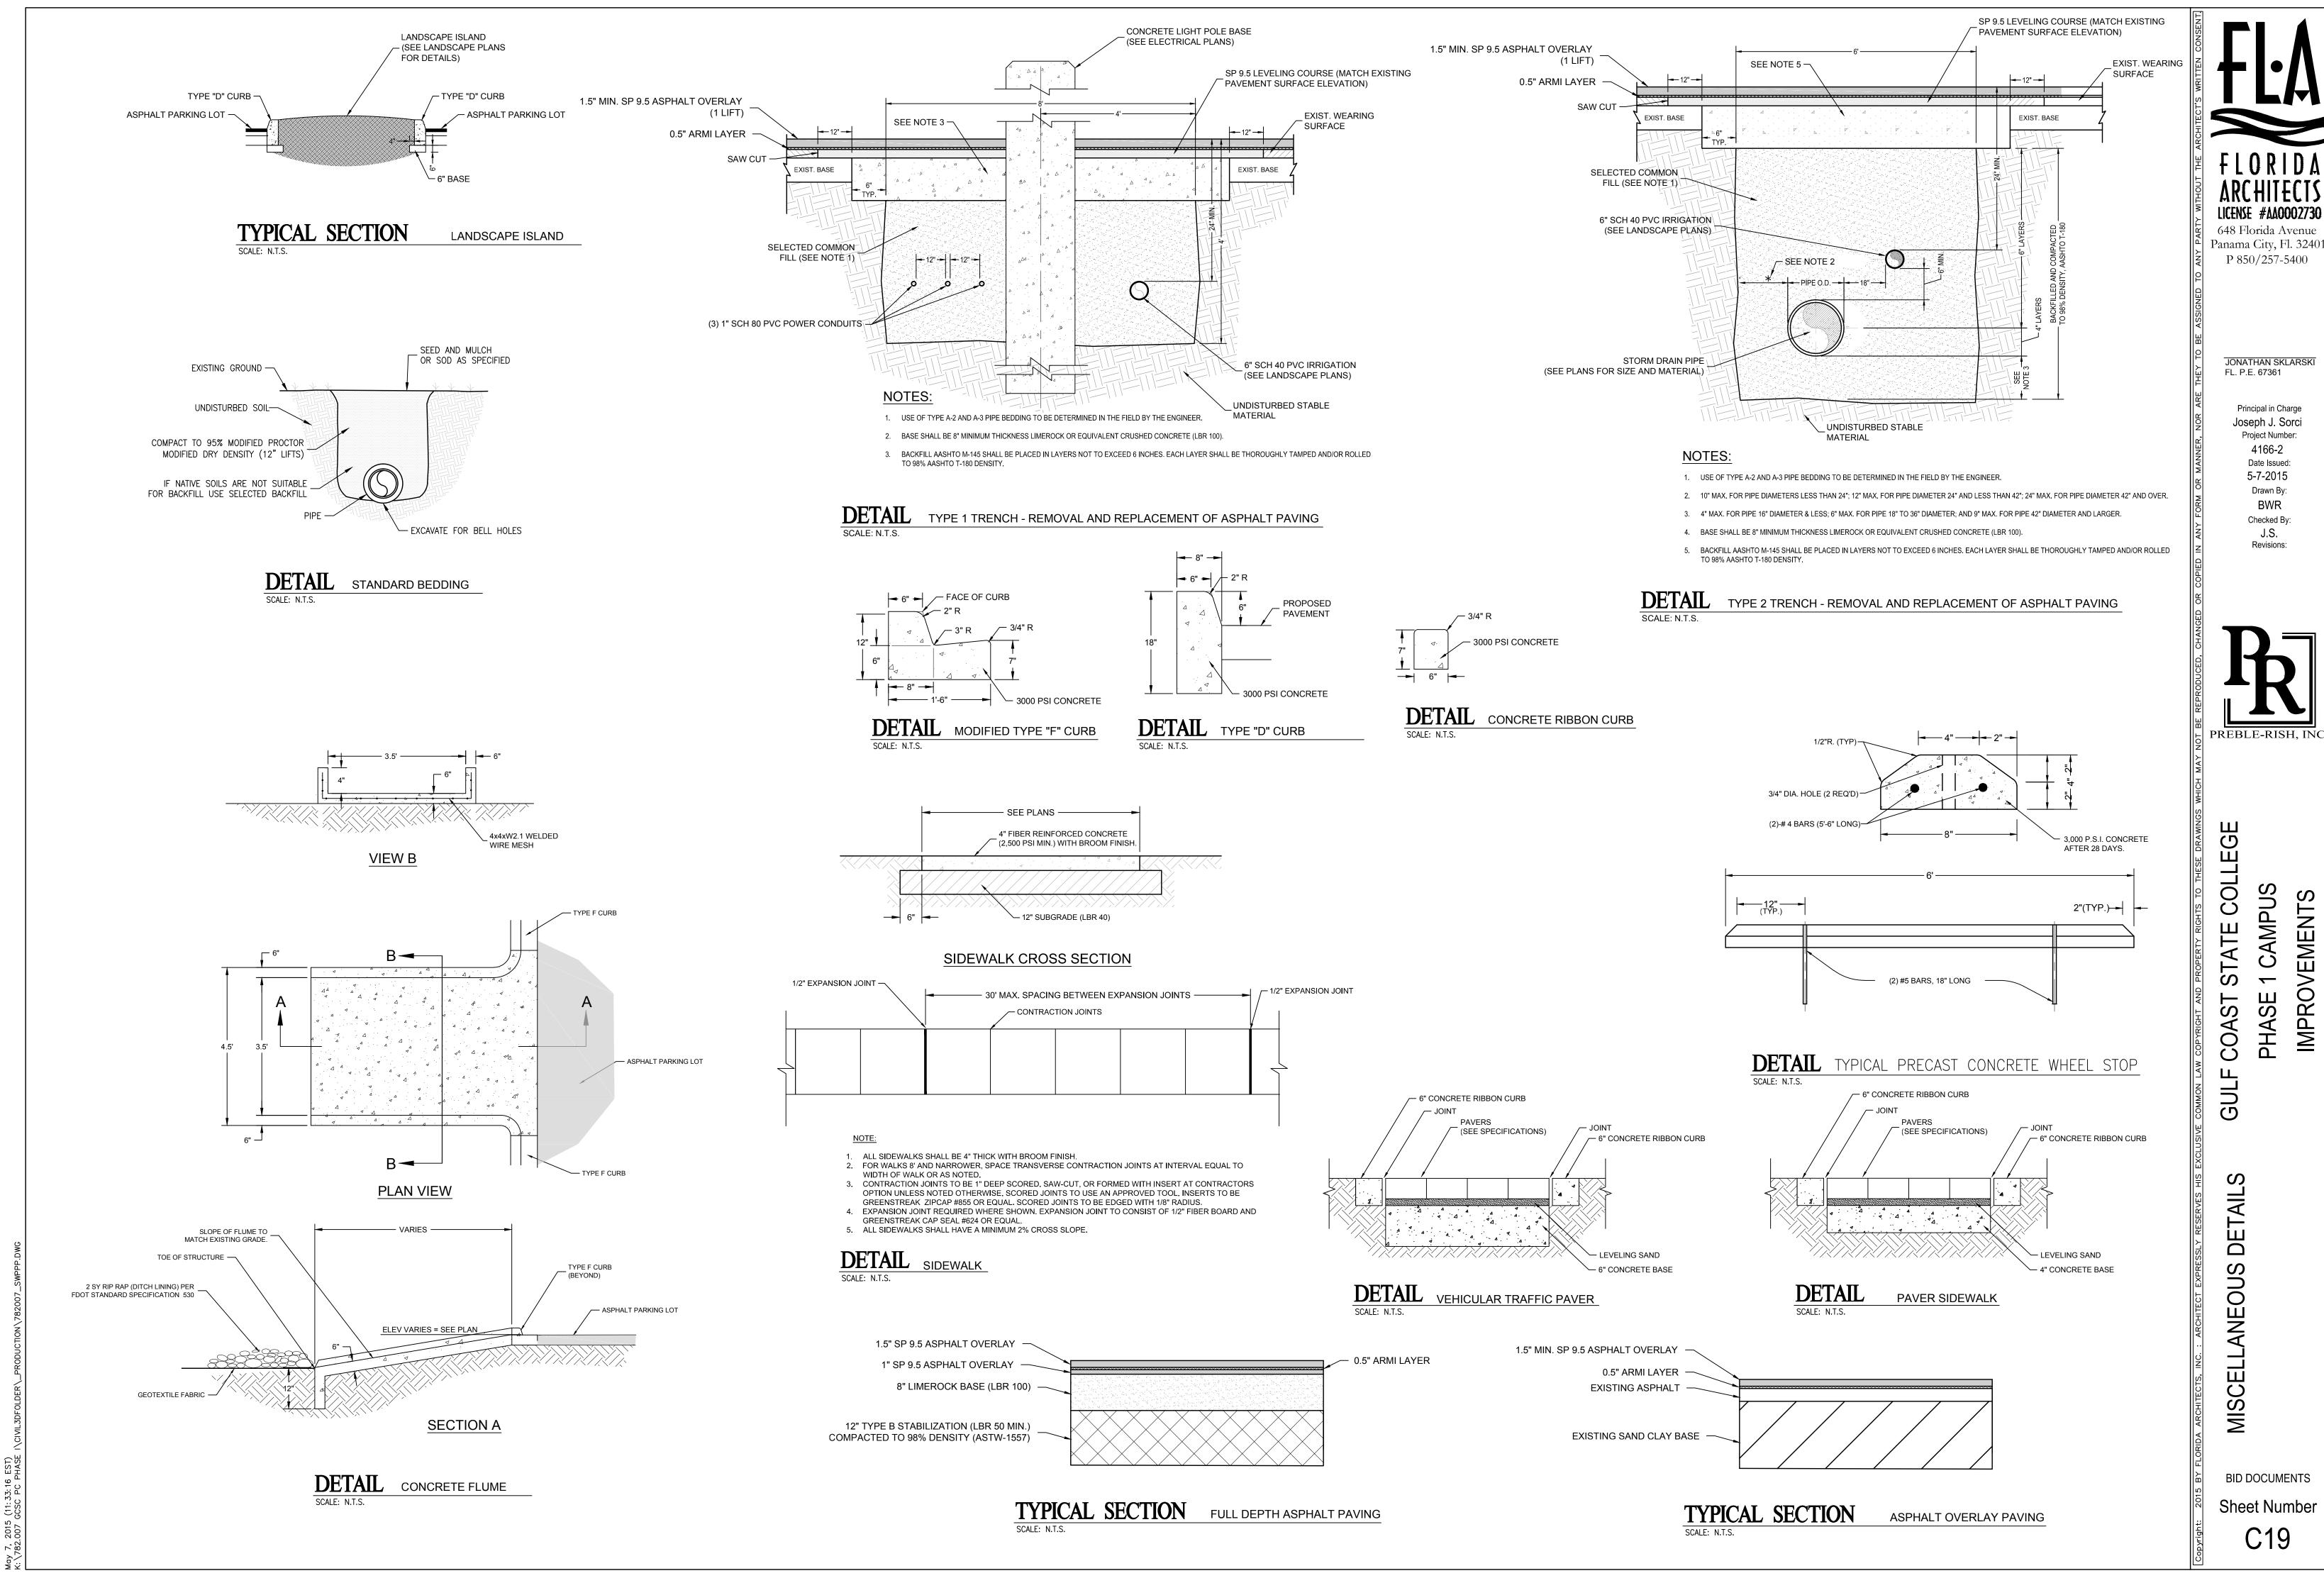

648 Florida Avenue

JONATHAN SKLARSKI FL. P.E. 67361

Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By: BWR Checked By: J.S. Revisions:

PREBLE-RISH, INC


COLLEGE

PHASE

AIL ANEOUS

BID DOCUMENTS


Sheet Number

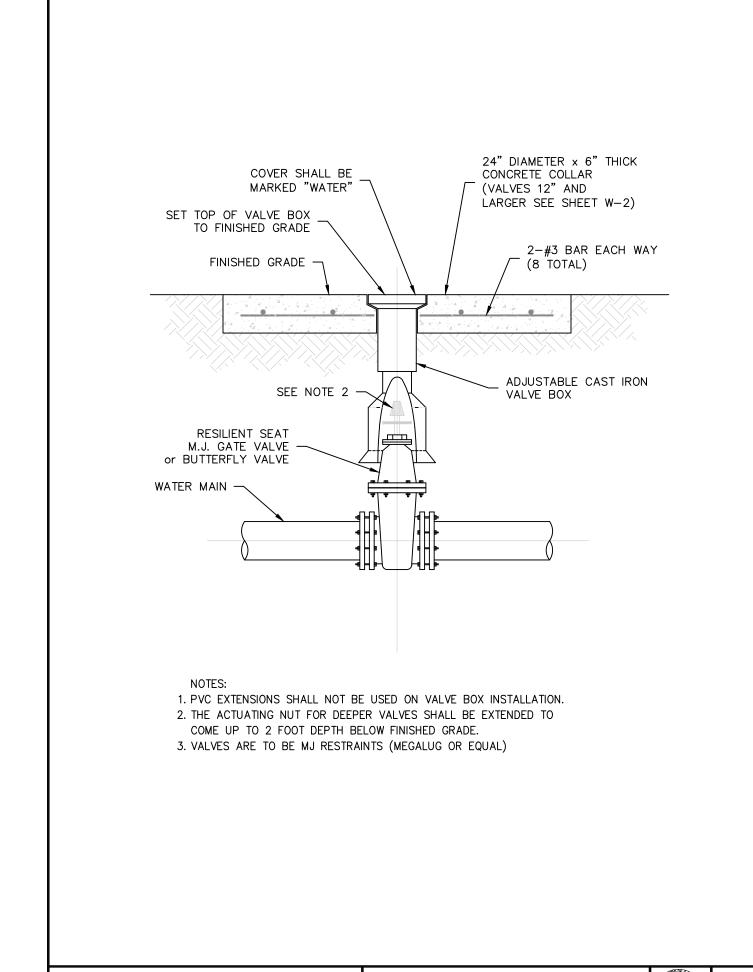

CITY OF PANAMA CITY ENGINEERING DEPARTMENT

POTABLE WATER GATE VALVE & VALVE BOX W-1



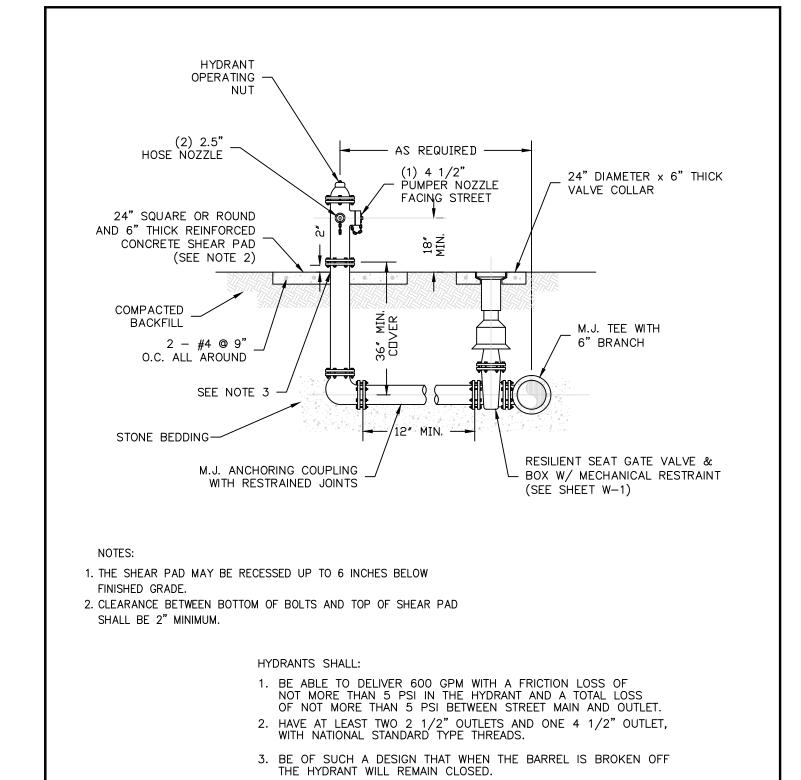

4. HAVE CONNECTION TO THE STREET MAIN OF NOT LESS THAN 6

7. HAVE A GATE VALVE BETWEEN HYDRANT AND THE STREET MAIN.

APPROVED MODELS ARE AMERICAN DARLING B84B, MUELLER CENTURION, AVK 2780, M&H 129 OR CLOW MEDALLION. NO SUBSTITUTIONS ARE ALLOWED.

FIRE HYDRANT

ASSEMBLY DETAIL

5. HAVE ALL FITTINGS WITH MEG-A-LUG GLANDS.

INCHES IN DIA.

CITY OF PANAMA CITY

ENGINEERING DEPARTMENT

6. HAVE ALL D.I.P. PIPING.

8. HAVE A 5 1/4" MAIN VALVE SEAT.

LICENSE #AAOOO2730 648 Florida Avenue Panama City, Fl. 32401 P 850/257-5400

JONATHAN SKLARSKI FL. P.E. 67361

> Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By: BWR Checked By: J.S. Revisions:


PREBLE-RISH, INC


COLLEGE CAMPUS 'EMENTS IMPROVEMENT STATE **PHASE** COAST


GULF TAIL DE.

SOOS MISCELLANE

BID DOCUMENTS

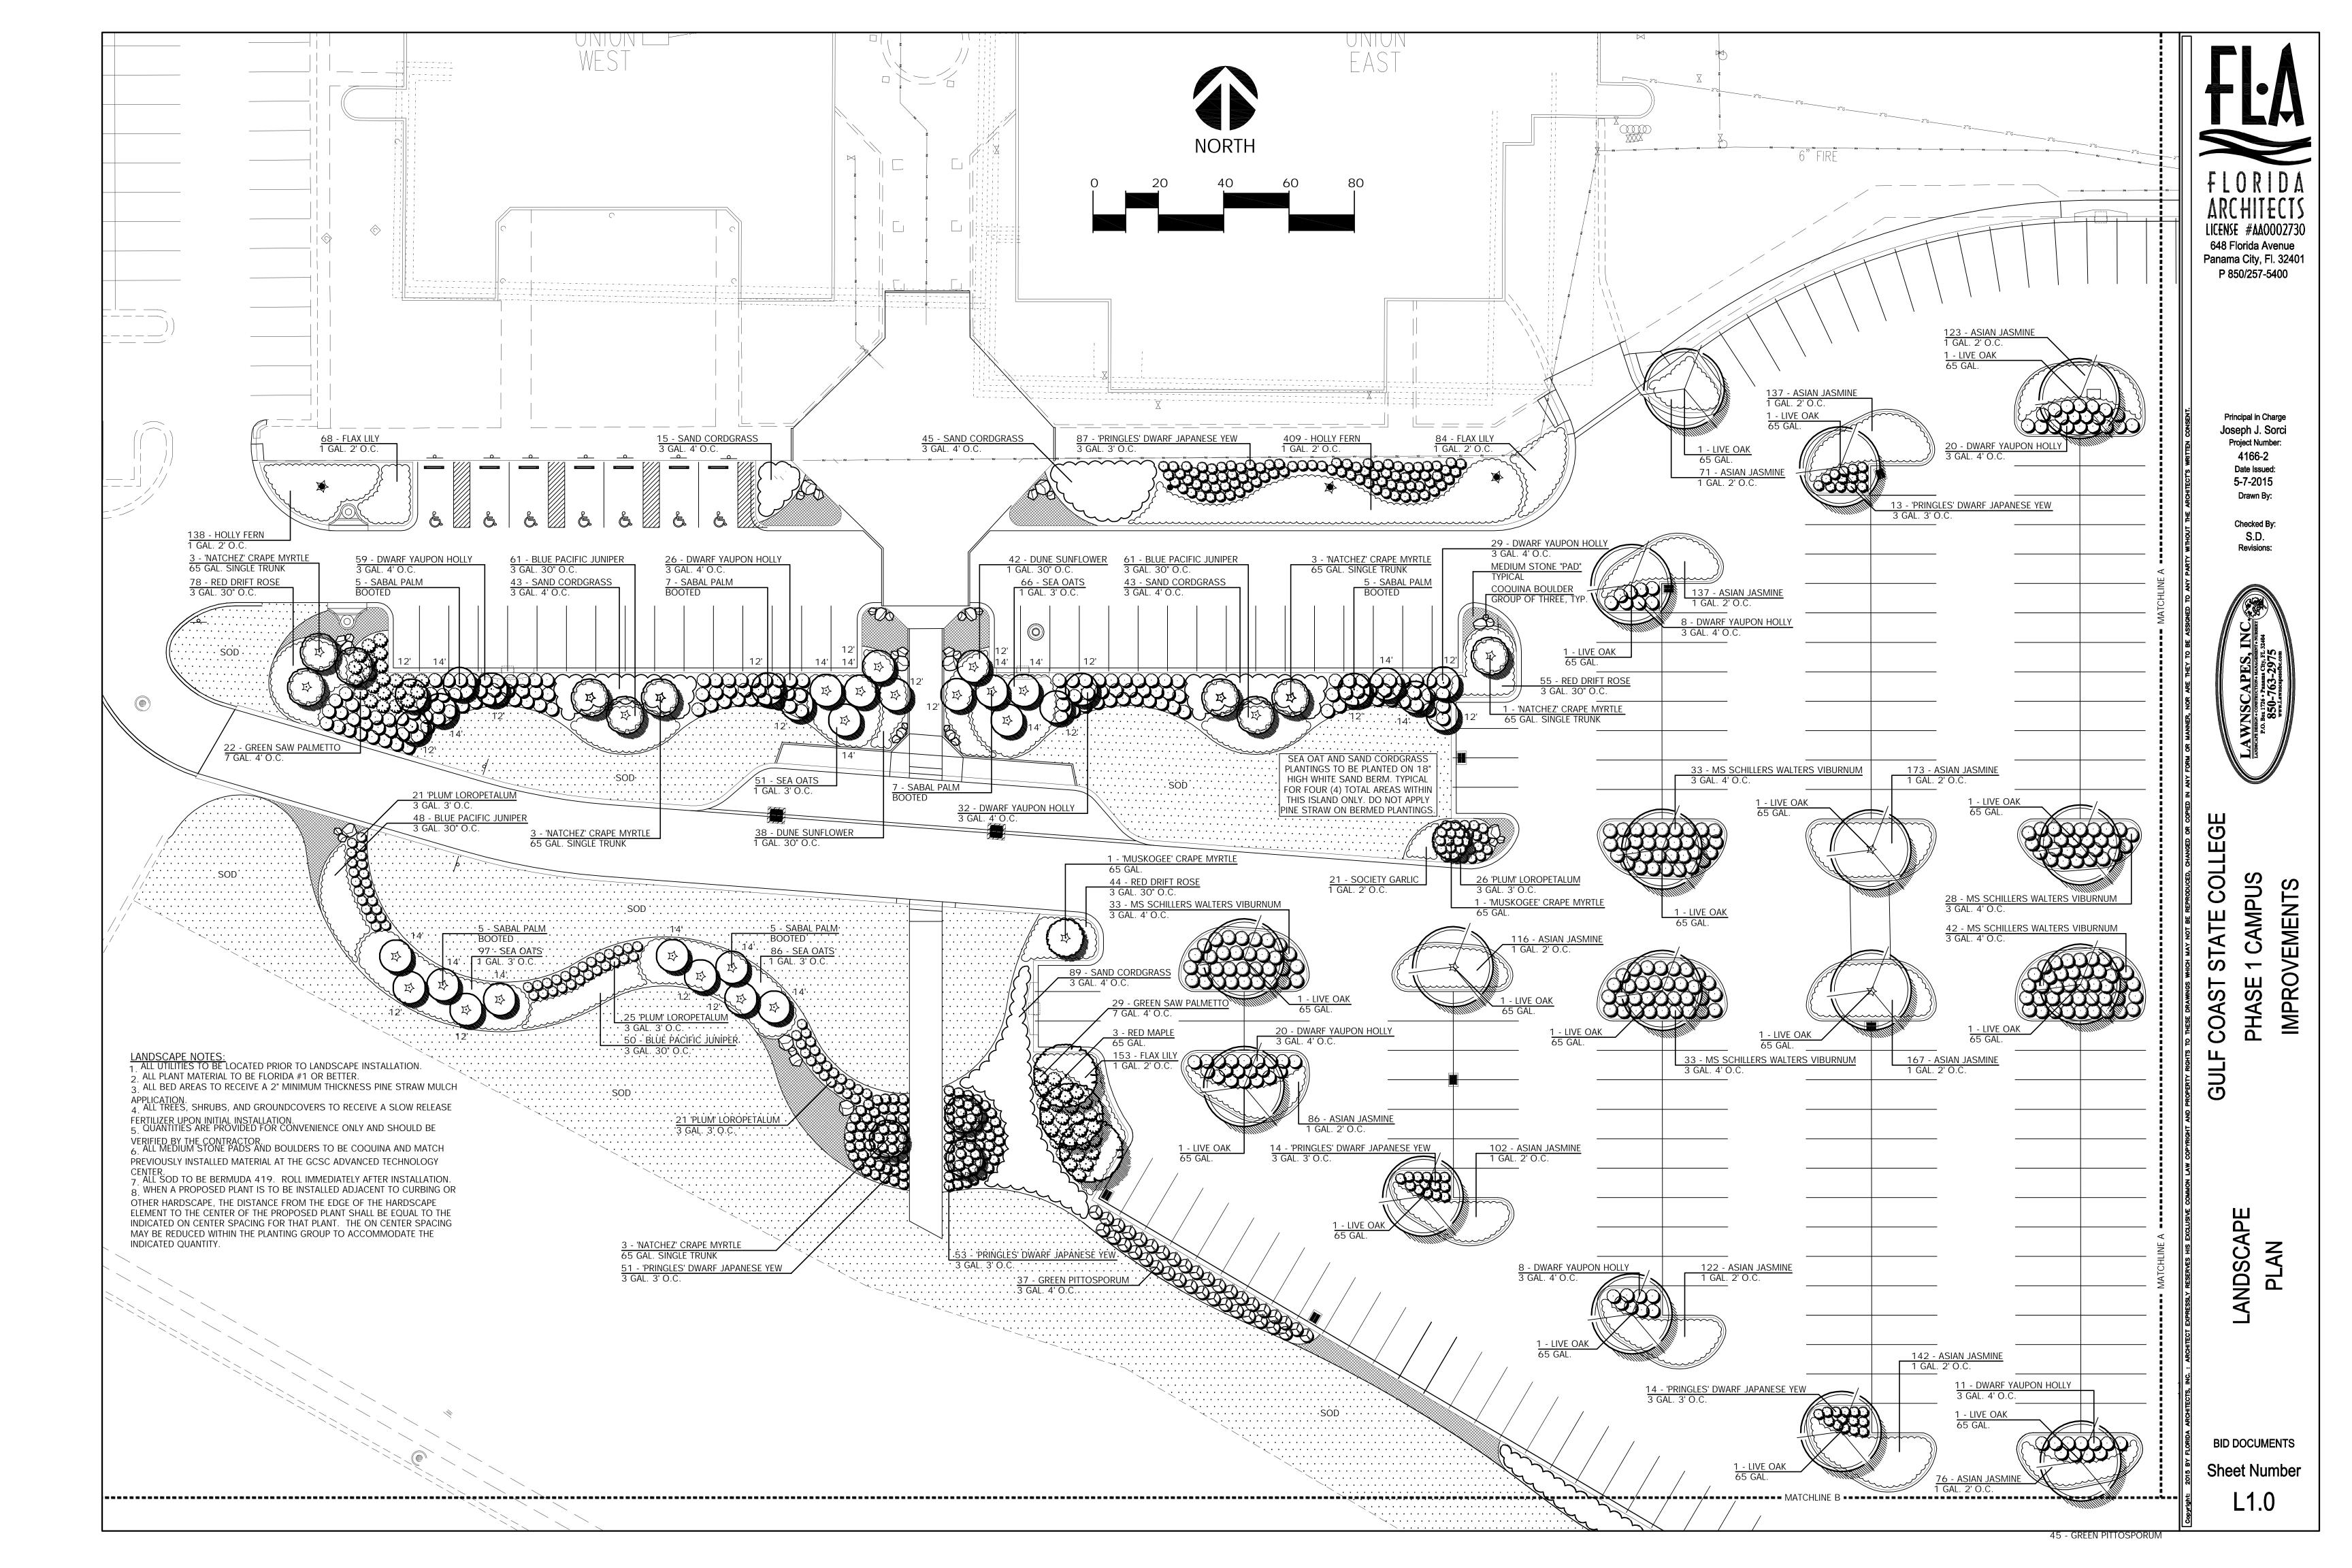

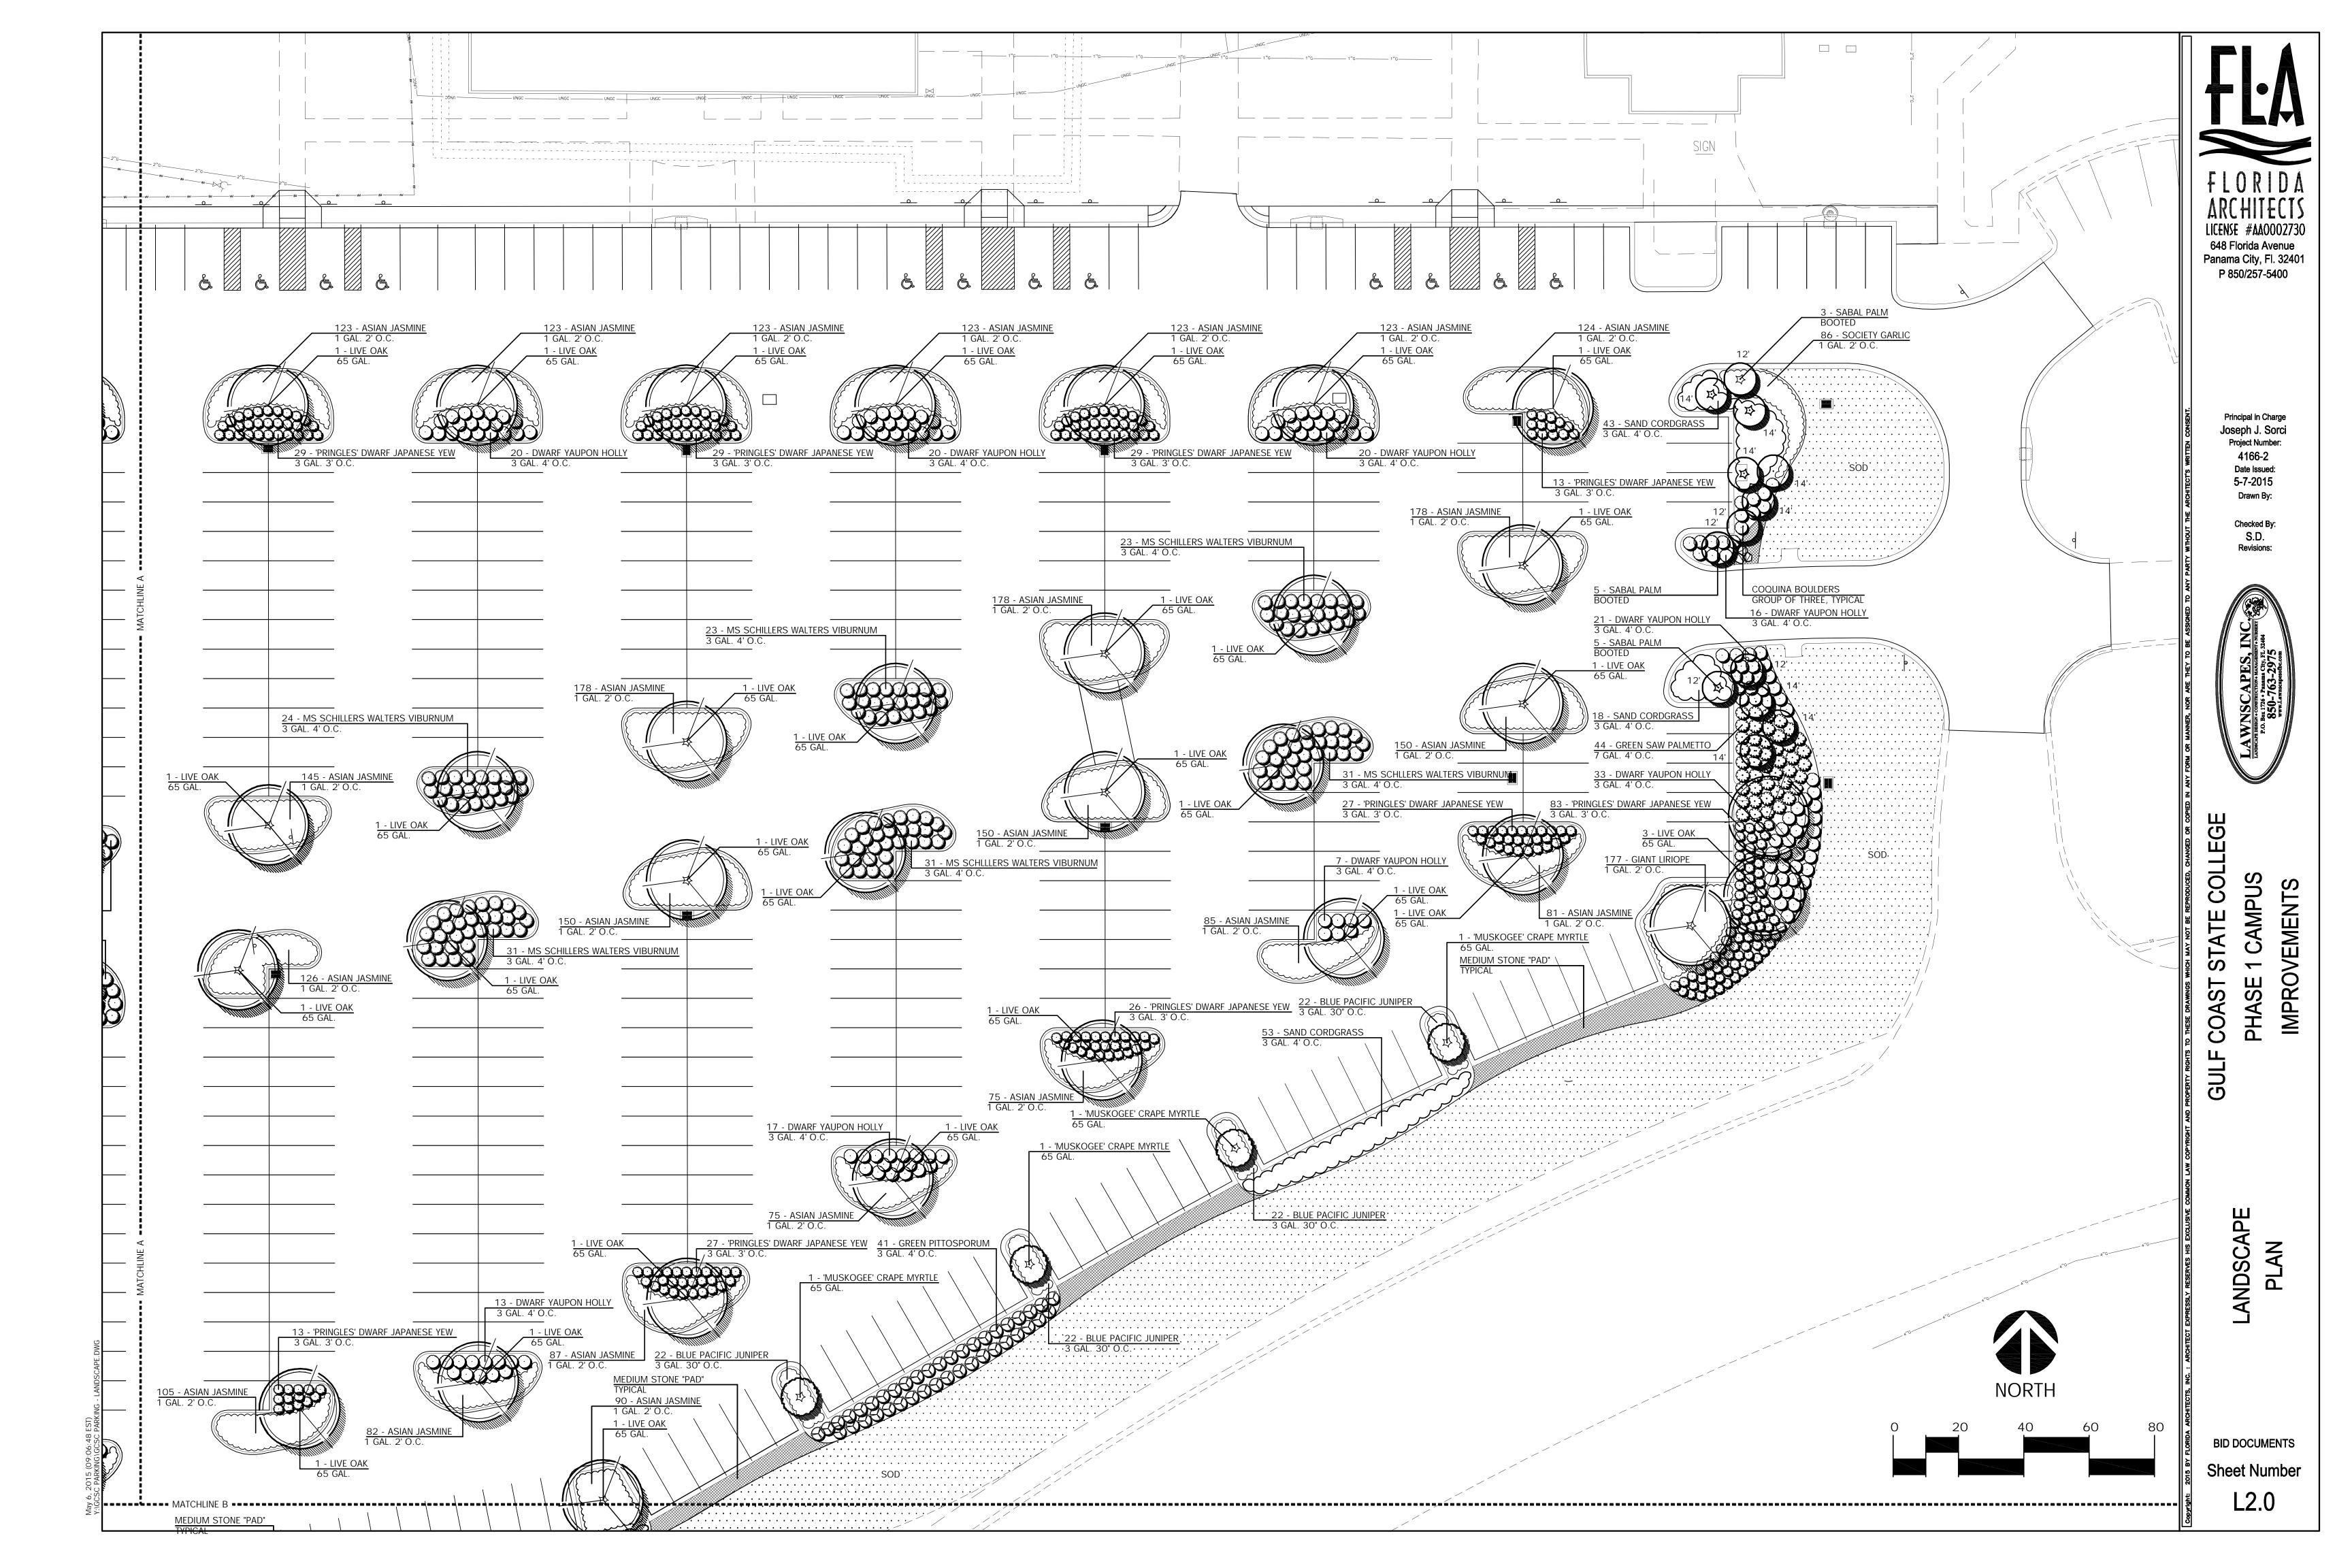

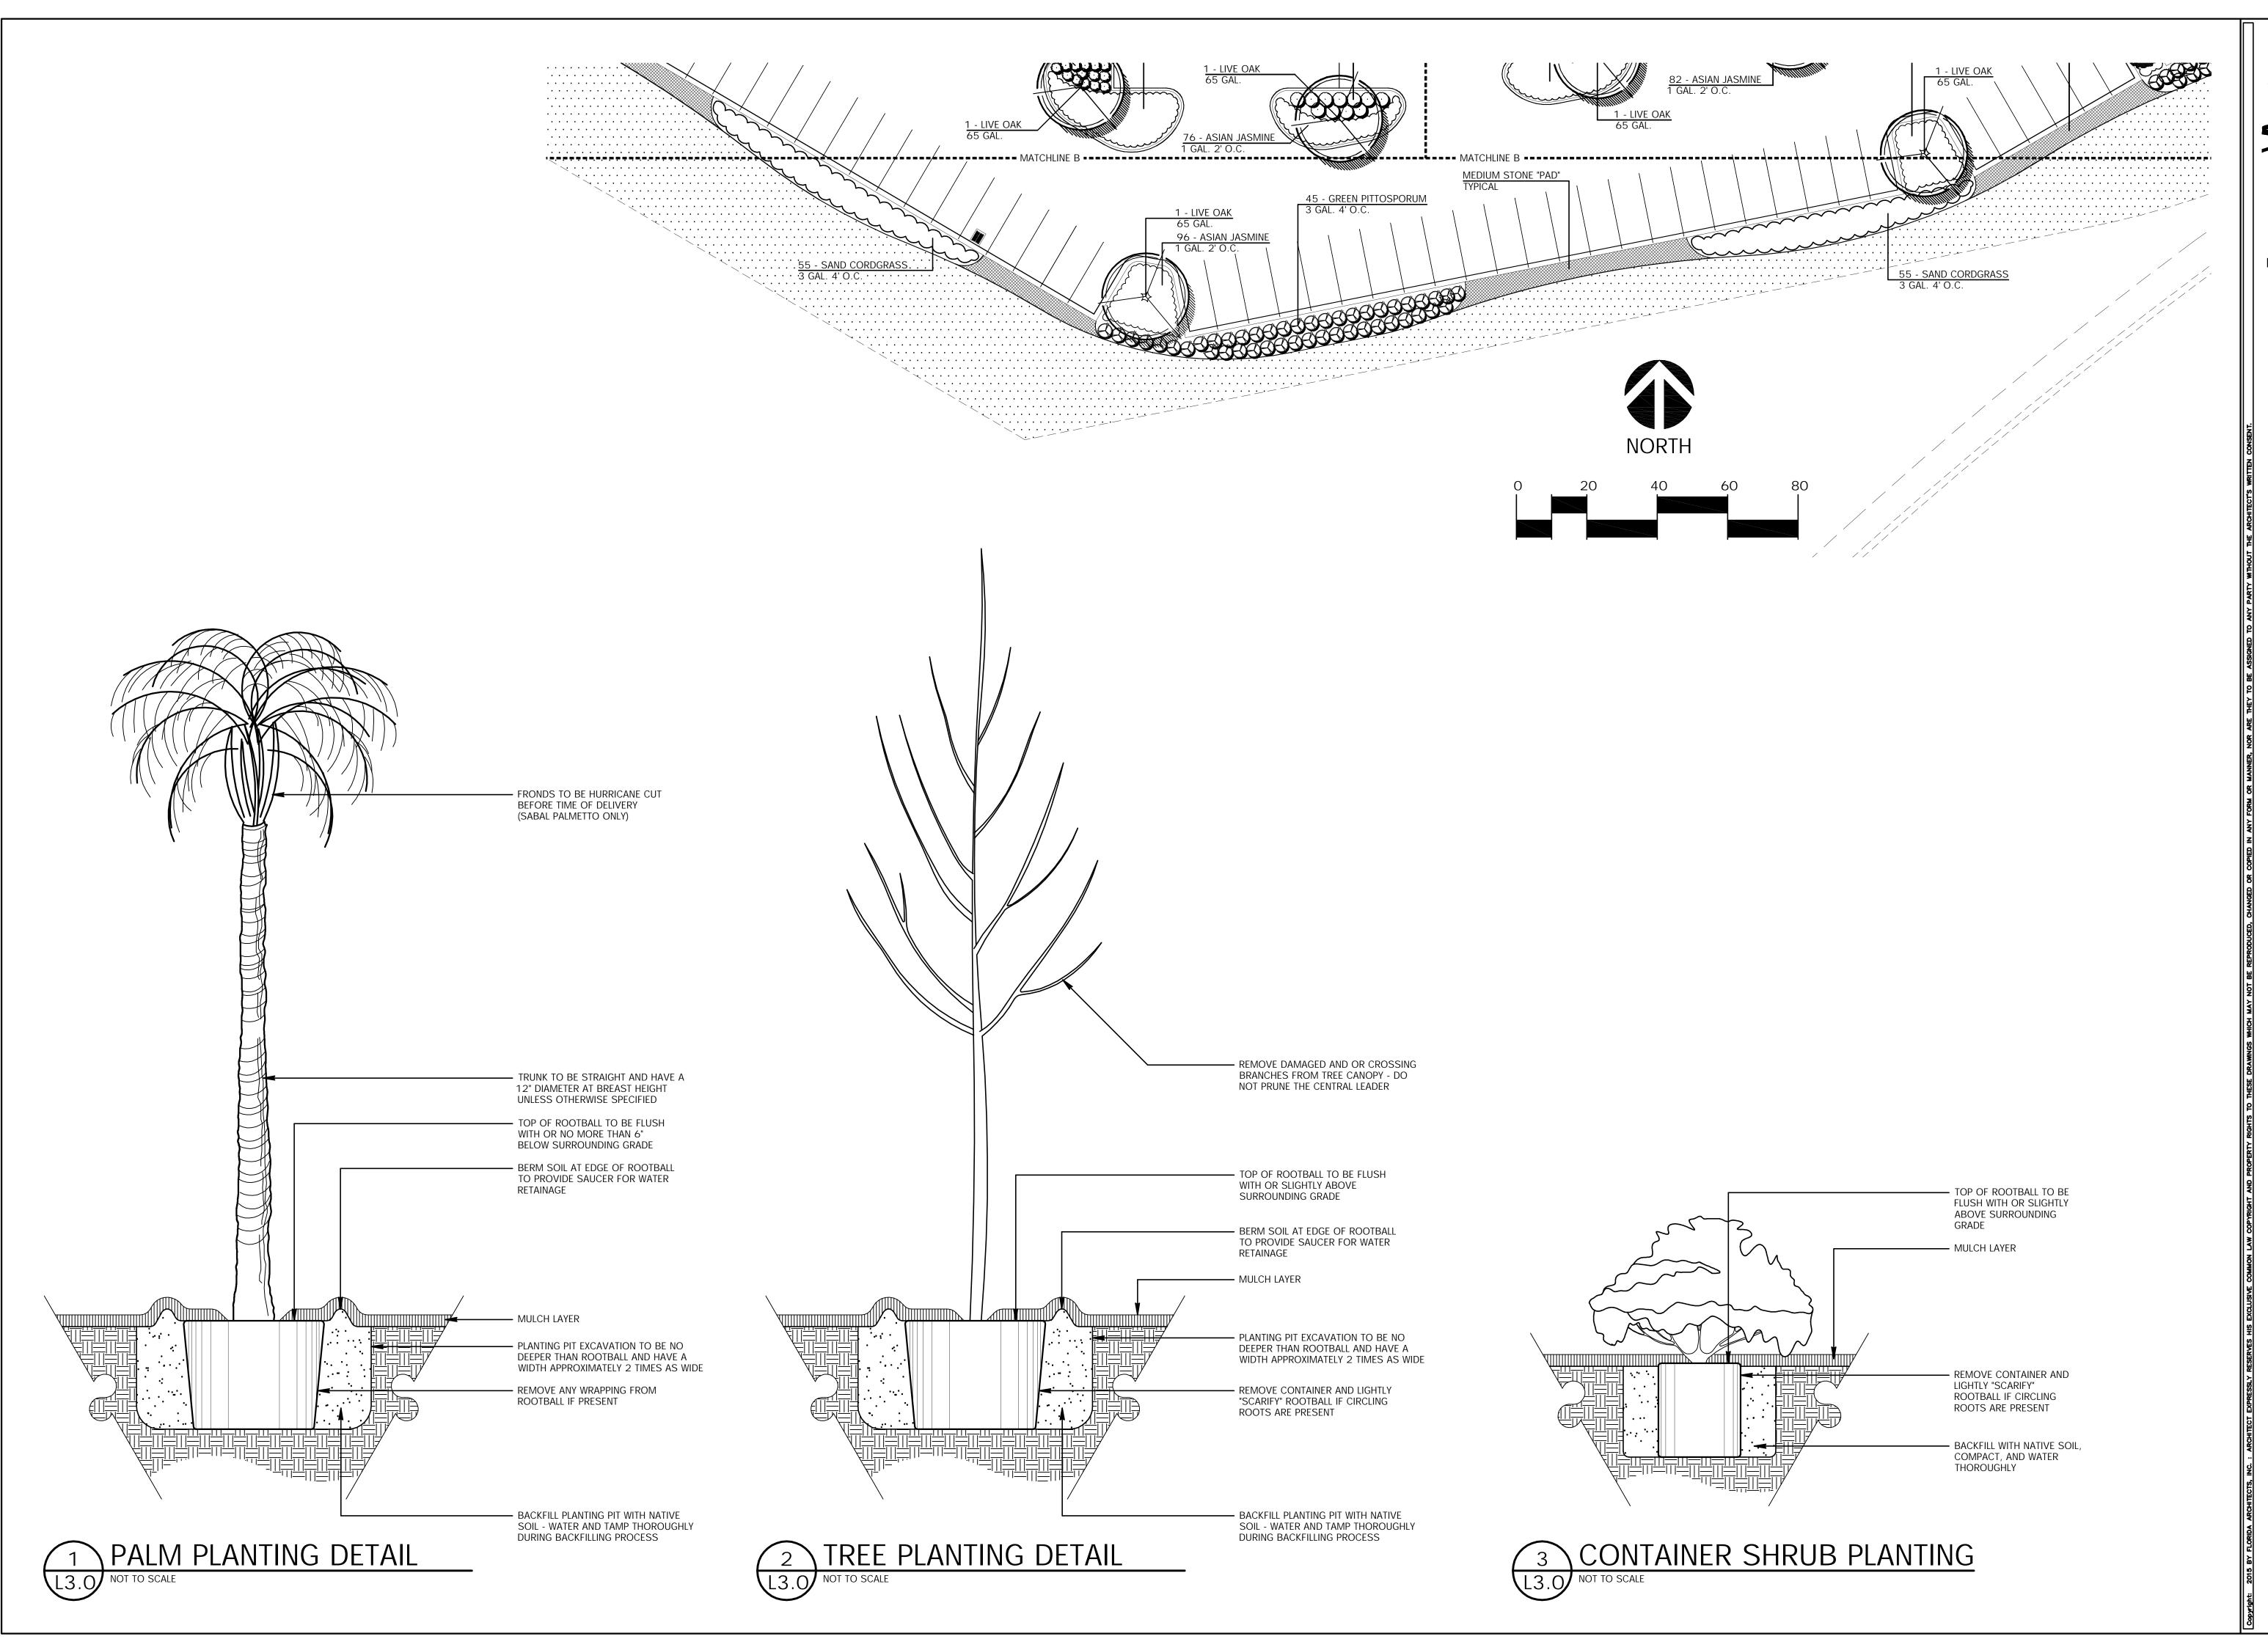

FLORIDA
ARCHITECTS
LICENSE #AAOO02730 648 Florida Avenue Panama City, Fl. 32401 P 850/257-5400

> Principal in Charge Joseph J. Sorci Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By:

> > Checked Bv: S.D. Revisions:





COLLEGE CAMPUS COAST **PHASE** GULF


-ANDSCAPE

BID DOCUMENTS **Sheet Number**


L3.0

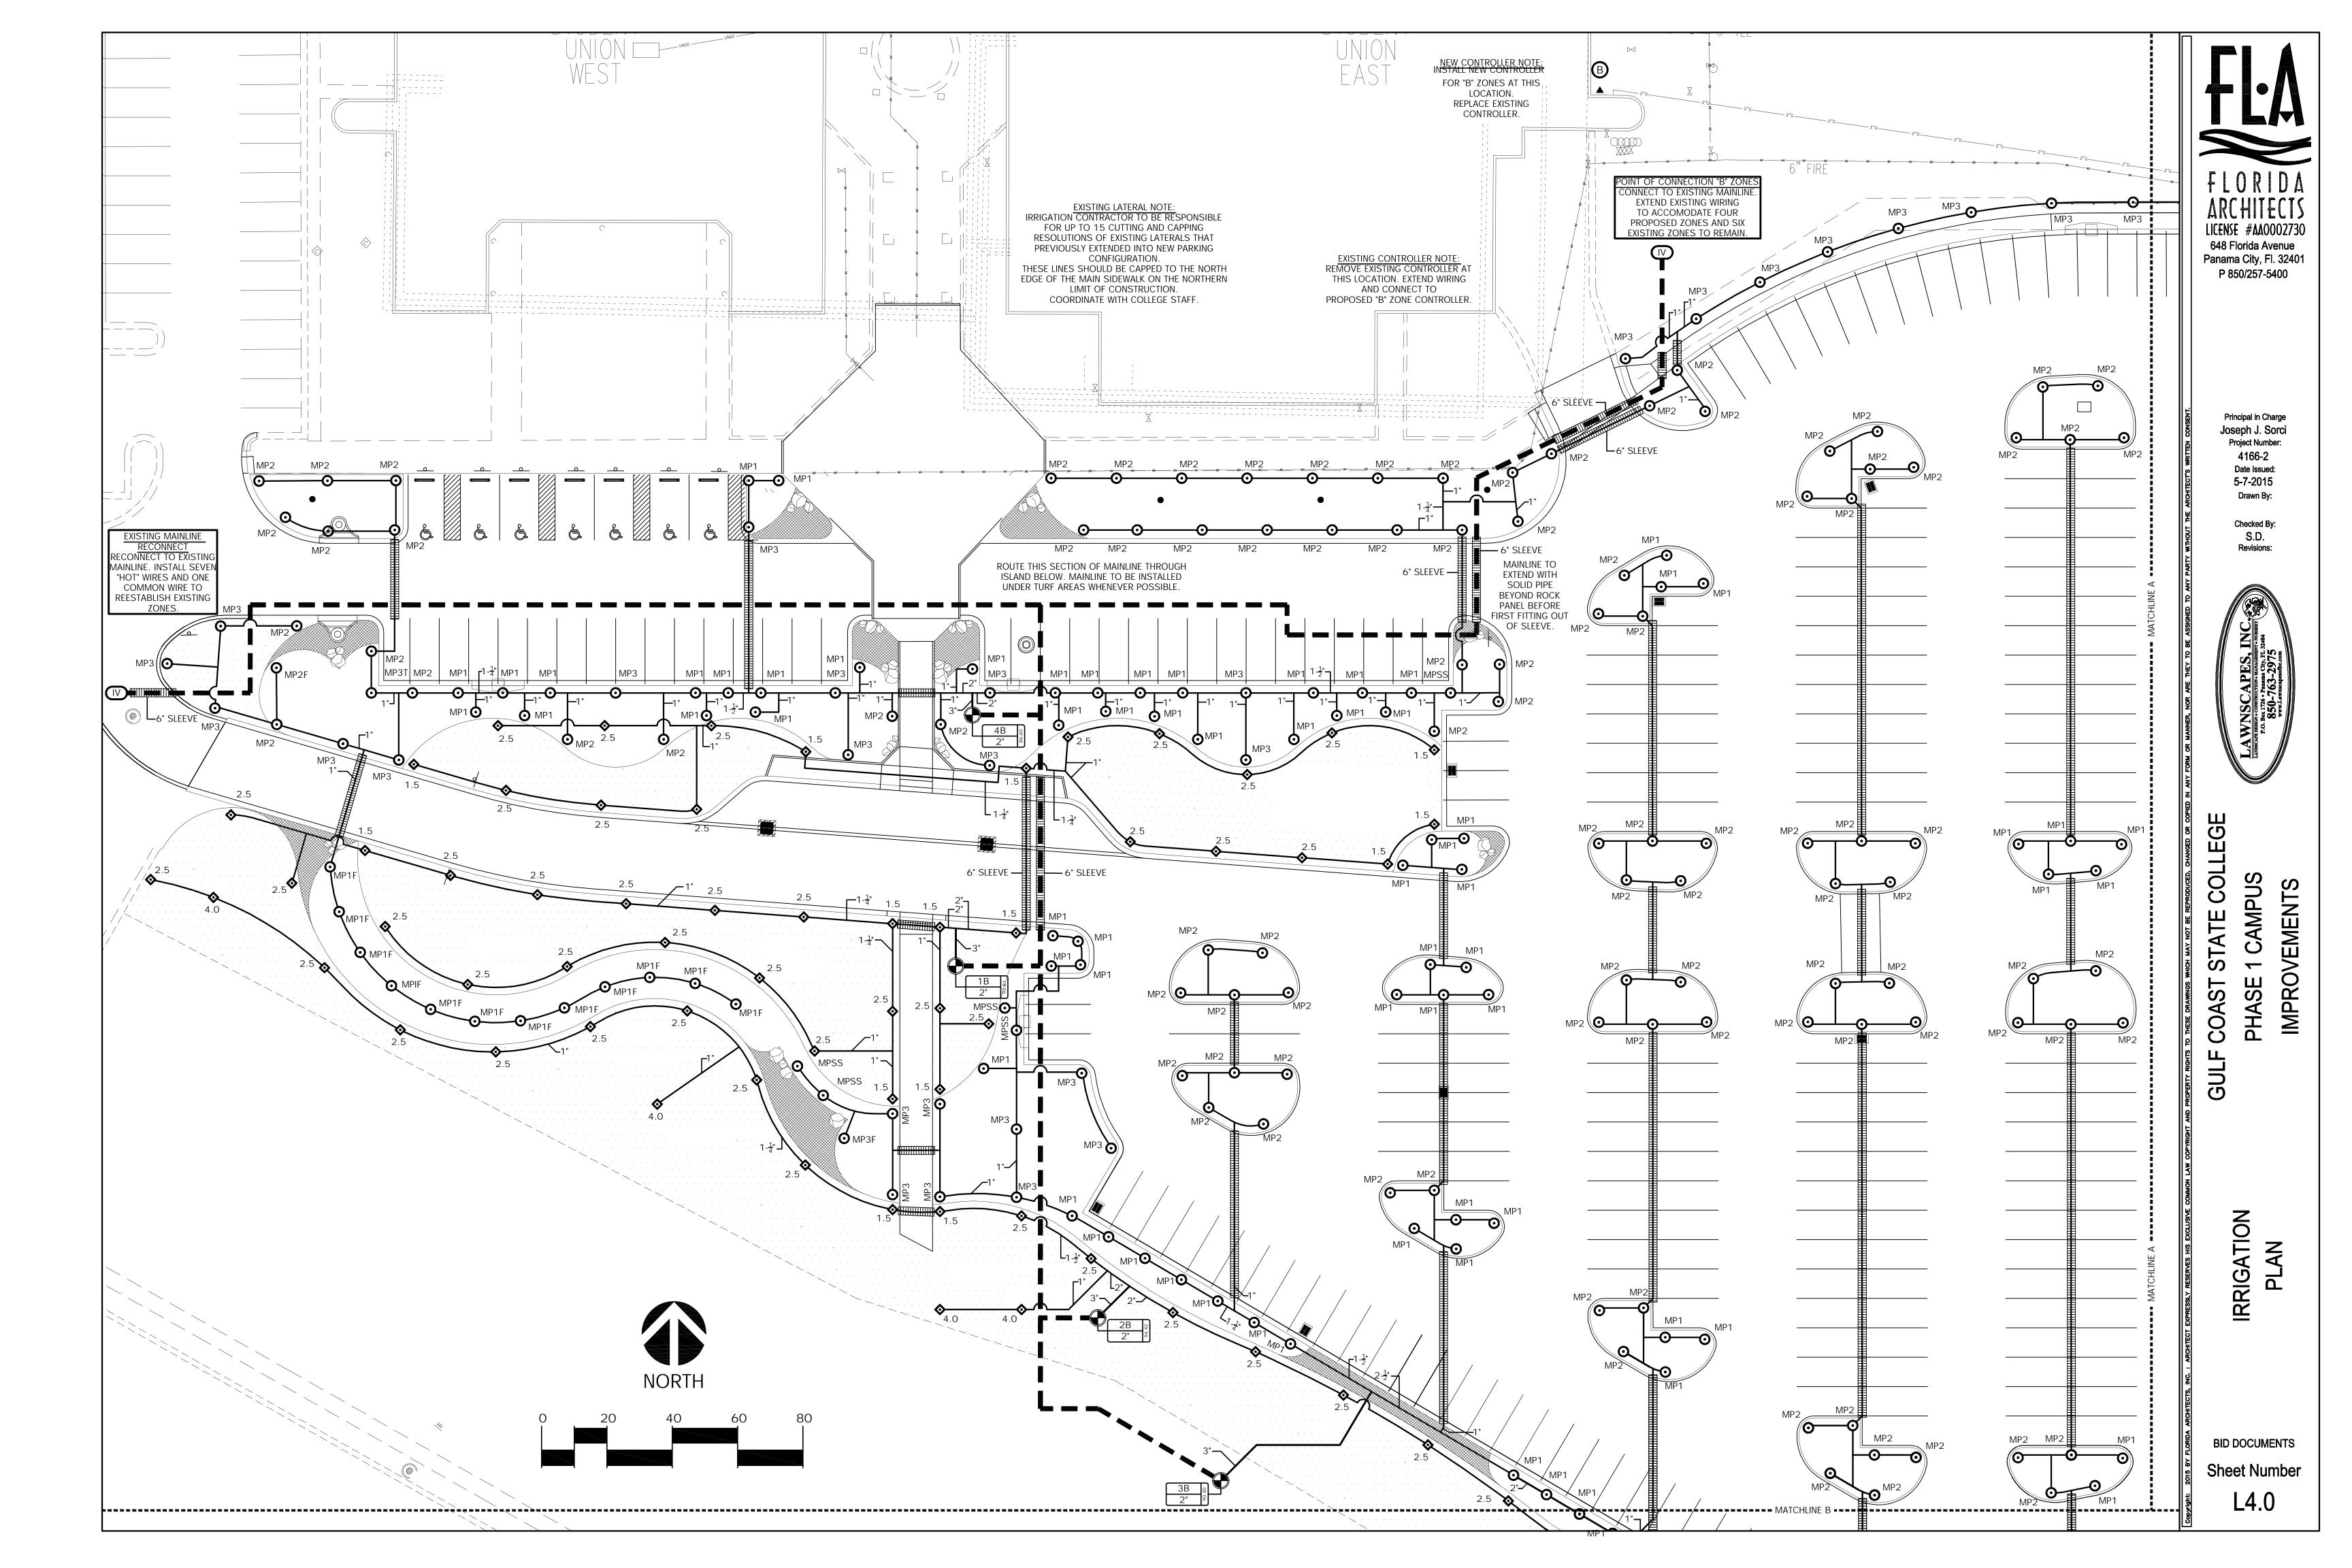

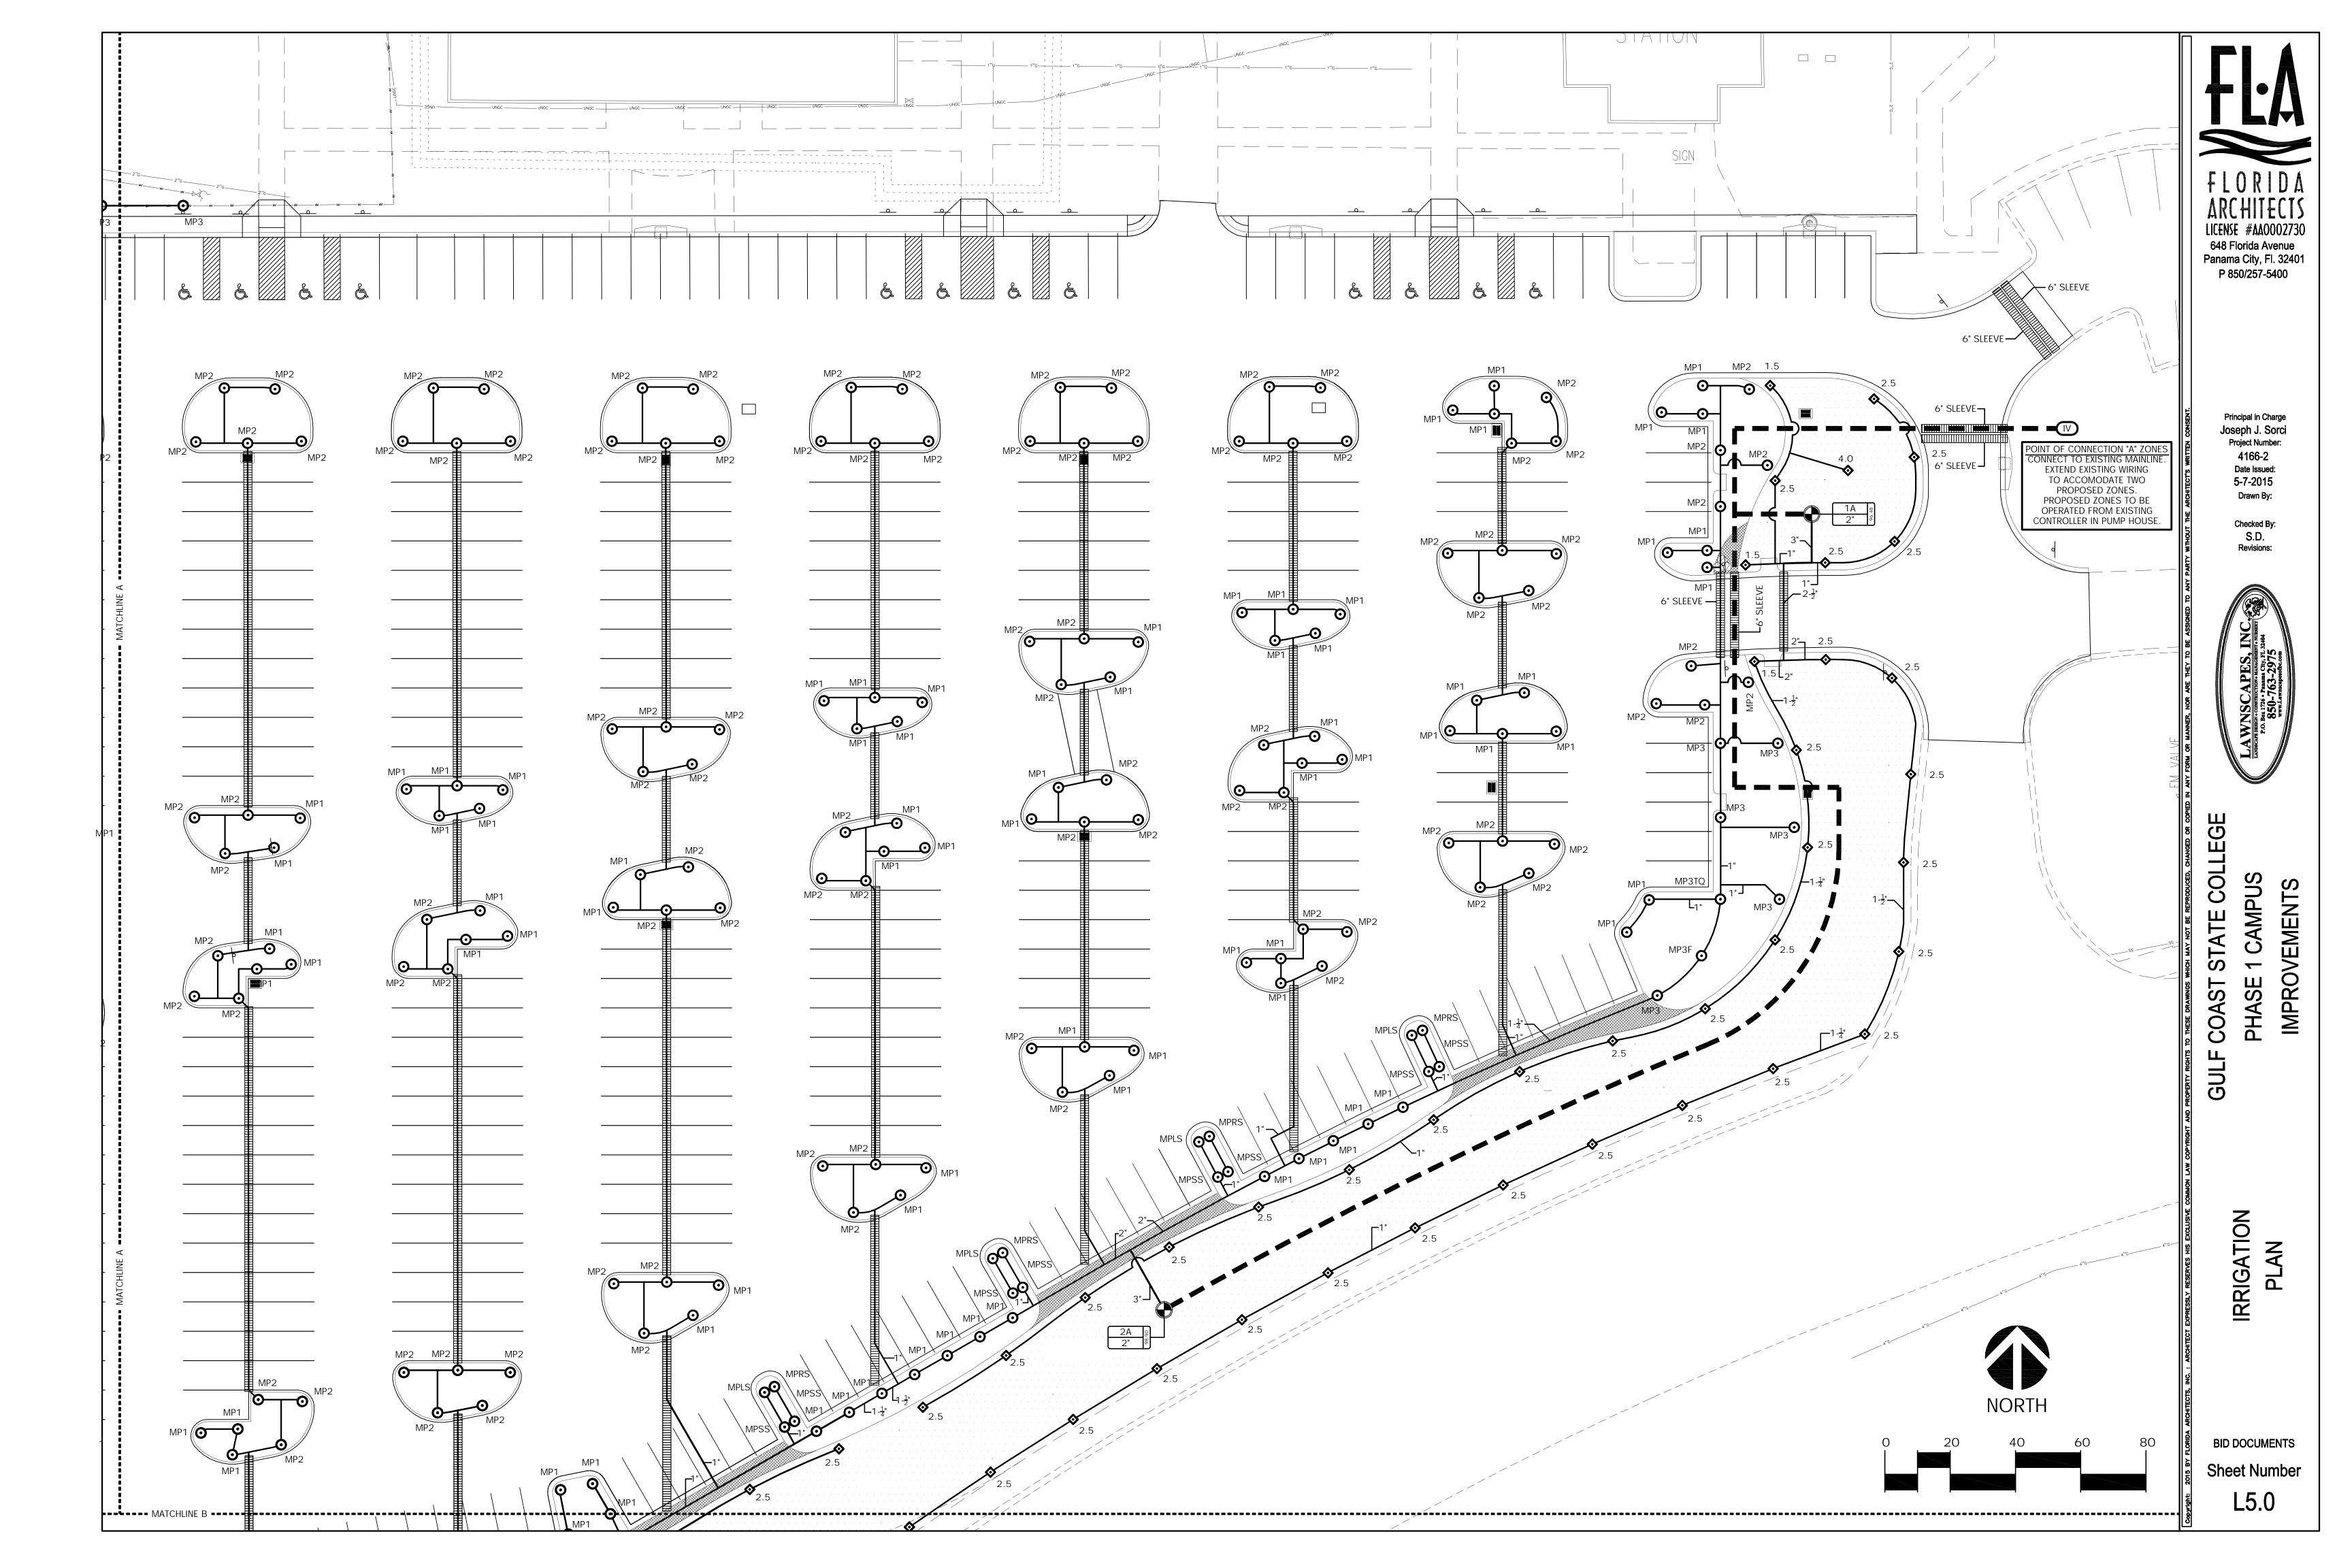

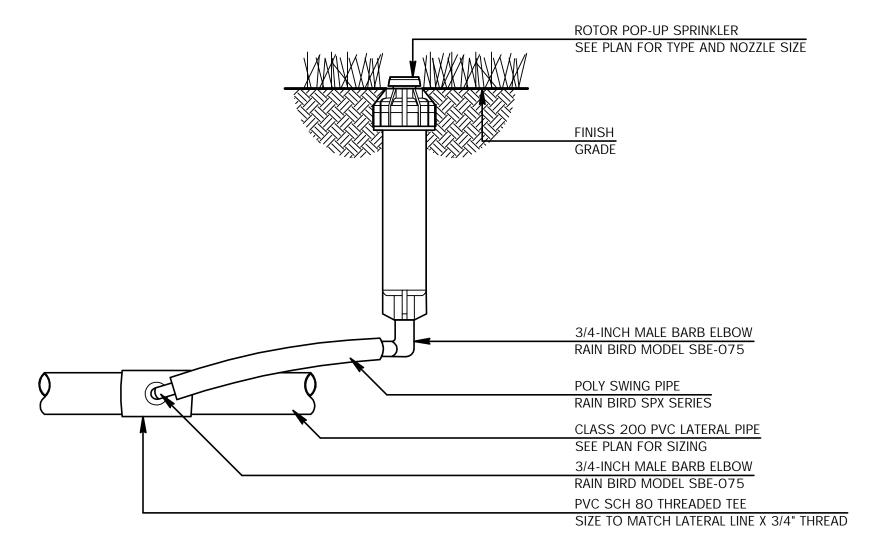

1 POP-UP ROTOR INSTALLATION 16 O NOT TO SCALE

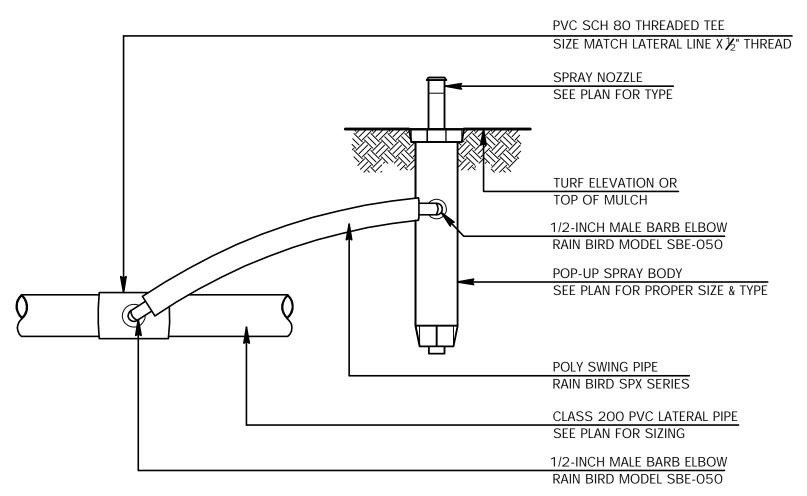

2 SPRAYHEAD INSTALLATION
L6.0 NOT TO SCALE

1GENERALITHES GOTEO NO NOTES BEFORE COMMENCEMENT OF CONSTRUCTION. APPLY NECESSARY PROTECTIVE MEASURES TO REDUCE POSSIBILITY OF DAMAGE TO EXISTING UTILITIES DURING CONSTRUCTION.

2. ALL CONTROL WIRE TO BE 14 GAUGE INSTALL ONE (1) RED WIRE TO EACH CONTROL VALVE, ONE (1) COMMON WHITE TO LOOP CONTINUOUSLY THROUGHOUT THE WIRE PATH, AND ONE (1) EXTRA BLUE WIRE TO RUN PARALLEL WITH COMMON.

3. ALL LATERAL LINES TO MAINTAIN A 8" MINIMUM DEPTH. ALL MAINLINE TO MAINTAIN A MINIMUM 12" DEPTH.
4. ALL SPRAYS AND ROTORS TO BE MOUNTED FLUSH WITH FINAL GRADE.
5. ALL WATERING ARCS TO BE ADJUSTED TO PREVENT OVERSPRAY ONTO ADJACENT BUILDINGS OR

HARDSCAPE.

6. DO NOT VERTICALLY STACK MULTIPLE PIPES IN A SINGLE TRENCH. ALL PIPING IN SHARED TRENCHES TO MAINTAIN A 3" MINIMUM SPACING BETWEEN PIPES.

SYSTEM DESIGN NOTES:

"A" ZONES
WATER SOURCE: EXISTING PUMP
DESIGN VOLUME: 100 GPM
DESIGN PRESSURE: 60 PSI

"B" ZONES WATER SOURCE: EXISTING PUMP DESIGN VOLUME: 100 GPM DESIGN PRESSURE: 60 PSI <u>PIPING LEGEND</u>

3" - CLASS 200 MAINLINE

CLASS 200 LATERAL (SIZE AS NOTED)

4" SCH. 40 SLEEVE (UNLESS OTHERWISE NOTED)

ZONE # CONTROL VALVE SIZE DENTIFICATION TAG



IRRIGATION SCHEDULE

QUANTITY	SYMBOL	SIZE / DESC.	DESCRIPTION	MANUFACTURER
		T	T	-
167	0	MP1	MP-1000-90 ON 1812 BODY	HUNTER
12	0	MP1F	MP-1000-360 ON 1812 BODY	HUNTER
202	0	MP2	MP-2000-90 ON 1812 BODY	HUNTER
1	0	MP2F	MP-2000-360 ON 1812 BODY	HUNTER
37	0	MP3	MP-3000-90 ON 1812 BODY	HUNTER
2	0	MP3T	MP-3000-210 ON 1812 BODY	HUNTER
2	0	MP3F	MP-3000-360 ON 1812 BODY	HUNTER
4	0	MPLS	MPLCS515 ON 1812 BODY	HUNTER
4	0	MPRS	MPRCS515 ON 1812 BODY	HUNTER
13	0	MPSS	MPS530 ON 1812 BODY	HUNTER
17	♦	1.5	5004-PC W/ 1.5 NOZZLE	RAINBIRD
94	♦	2.5	5004-PC W/ 2.5 NOZZLE	RAINBIRD
5	♦	4.0	5004-PC W/4.0 NOZZLE	RAINBIRD
6		2"	2" CONTROL VALVE 200-PGA	RAINBIRD
1	B	-	18 STATION CONTROLLER IC-1800-M	RAINBIRD
1	A	-	RAIN SENSOR MINI-CLIK	HUNTER
3	IV	-	3" BRASS GATE VALVE	SPEARS

F L O R I D A
ARCHITECTS
LICENSE #AA0002730
648 Florida Avenue
Panama City, Fl. 32401
P 850/257-5400

Principal in Charge
Joseph J. Sorci
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:

Checked By: S.D.



GULF COAST STATE COLLEGE
PHASE 1 CAMPUS
IMPROVEMENTS

IRRIGATION PLAN

BID DOCUMENTS

Sheet Number

L6.0

ELECTRICAL GENERAL NOTES

- 1. ENTIRE ELECTRICAL INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ACCEPTED EDITION OF THE NATIONAL ELECTRICAL CODE AND ALL LOCAL CODES.
- 2. ALL ELECTRICAL WORK AND MATERIALS USED IN THIS PROJECT SHALL BE NEW, UNDERWRITERS' LABORITORIES (UL) LISTED AND LABELED. AND SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR UNLESS NOTED OTHERWISE.
- 3. WHERE CONFLICTS OCCUR ON ELECTRICAL DRAWINGS BETWEEN DRAWINGS, SPECIFICATIONS AND CODES, THE MOST STRINGENT REQUIREMENT THAT APPLIES SHALL BE ADHERED TO.
- 4. NEW POLE SHALL BE FURNISHED WITH A SURGE PROTECTION DEVICE INSTALLED IN THE HANDHOLE NEAR THE BASE OF THE POLE.
- 5. ALL WIRING SHALL BE COPPER AND INSTALLED IN CONDUIT.
- 6. THE ELECTRICAL CONTRACTOR SHALL COORDINATE ALL WORK WITH THE CIVIL AND LANDSCAPE DRAWINGS. UTILIZE COMMON TRENCHES FOR INSTALLATION OF CONDUITS WHERE POSSIBLE. PRIOR TO INSTALLATION OF CONDUIT, THE ELECTRICAL CONTRACTOR WILL BE REQUIRED TO PLAN ALL CONDUIT ROUTING WITH THE OTHER CONTRACTORS PERFORMING SITE WORK. SUBMIT A RECORD OF THIS COORDINATION TO THE ARCHITECT PRIOR TO STARTING SITE WORK. IF ONE CONTRACTOR IS PERFORMING ALL CONDUIT SITE WORK, THEN A QUALIFIED ELECTRICIAN WILL BE REQUIRED TO BE ON SITE APPROVING THE CONDUIT INSTALLATION/ROUTING PRIOR TO COVERING THE CONDUITS.

ALL CONDUIT UNDERGROUND WORK SHALL COMPLY WITH THE GENERAL CONDITIONS BELOW:

COMPOSITION - THE CONDUITS SHALL BE CORROSION RESISTANT AND SHALL BE MADE OF EPC-80-PVC (SCHEDULE 80) IAW NEMA TC-2. THE CONDUITS SHALL BE APPROPRIATELY LABELED INDICATING THE COMPOSITION MATERIAL. CONDUITS SHALL HAVE A SLEEVE OR BELL END TYPE COUPLING AND SHALL BE WATERTIGHT WHEN ASSEMBLED. INSTALLATION — INSTALLATION OF UNDERGROUND CONDUITS SHALL BE A MINIMUM OF 24" BELOW GRADE. INSTALL IN COMMONS TRENCH WHERE SHOWN ON THE CIVIL PLANS. IN MAINTENANCE HOLES WITH KNOCKOUTS, CONDUITS SHALL START AT THE BOTTOM KNOCKOUT, ALLOWING FOR UPWARD EXPANSION IN THE MAINTENANCE HOLES. THE CONTRACTOR SHALL PROVIDE OTHER PROTECTIVE MEASURES, CONCRETE CAP, ETC., IN THOSE AREAS WHERE THE MINIMUM GROUND COVER CANNOT BE ACHIEVED.

BENDS AND SEALING.

THE SUM OF BENDS IN ALL DIRECTIONS SHALL NOT EXCEED A TOTAL OF 180 DEGREES. CONDUITS SHALL HAVE BELL ENDS AND ENTER A MAINTENANCE HOLES PERPENDICULAR TO THE SURFACE OF THE WALL THROUGH WHICH IT IS ENTERING. ALL CONDUITS ENTERING MAINTENANCE HOLES MUST BE SEALED. UNIVERSAL CONDUIT PLUGS OR REMOVABLE PUTTY SEALANTS MAY BE USED. UPON COMPLETION OF CONDUIT SECTIONS, A TEST MANDREL 1/4" (6.4MM) SMALLER THAN THE INSIDE DIAMETER OF THE CONDUIT SHALL BE PULLED THROUGH TWO DIAGONALLY OPPOSITE CONDUITS TO ENSURE PROPER ALIGNMENT. IN ADDITION, ALL CONDUITS SHALL BE CLEARED OF LOOSE MATERIALS SUCH AS CONCRETE, MUD. DIRT. STONES, ETC.

PULL ROPE

ALL VACANT CONDUITS SHALL BE PROVIDED WITH A WATERPROOF CORROSION RESISTANT MULE TAPE FOR FUTURE CABLE INSTALLATION. THE PULL ROPE /MULE TAPE SHALL EXTEND INTO THE MAINTENANCE HOLE AND BE SECURED TO THE CABLE RACK OR PULLING IRON, ETC.

SPACERS AND TRACER WIRE

ALONG THE LENGTH OF THE CONDUIT RUN, IF THE CONDUITS ARE INSTALLED BY TRENCHING, SPACERS SHALL BE PLACED AT AN INTERVAL OF FOUR (4) SPACERS PER 20 FEET AND CABLE WARNING TAPE SHALL BE BURIED ONE (1) FOOT BELOW THE SURFACE AND SHALL FOLLOW THE DUCT ROUTE. THE TAPE SHALL BE A MINIMUM OF THREE INCHES WIDE AND ORANGE IN COLOR WITH THE APPROPRIATE WARNING MESSAGE. AT LEAST ONE CONDUIT SHALL HAVE TRACER WIRE OR BE OTHERWISE LOCATABLE FROM THE SURFACE.

UTILITY SEPARATION

COMMUNICATIONS CONDUITS AND CABLE SHALL MAINTAIN A MINIMUM SEPARATION OF 12 INCHES FROM ALL TRADES.

LIGHTING FIXTURE SCHEDULE							
MARK	MANUFACTURER AND CATALOG No.	LAMPS No. TYPE	MOUNTING	REMARKS	EQUALS		
PI	LITHONIA DSX2 LED 100C 700 40K T3M MVOLT RPA SF (FINISH)	LED	POLE ARM MOUNT	SINGLE-PIECE DIE-CAST ALUMINUM HOUSING, POWDER COAT FINISH, 4000K, UNIVERSAL	GARDCO #ECF-1-3-215LA-641A-NW-UNV		
	POLE: RTA 30 8E	LLD	33' ABOVE GRADE	VOLTAGE, PROVIDE WITH SNAP LP-250-11, ROUND TAPERED ALUMINUM POLE	POLE: VALMONT #R290845805-D1		
	LITHONIA DSX2 LED 100C 700 40K T4M MVOLT RPA SF (FINISH)		POLE ARM MOUNT	SINGLE-PIECE DIE-CAST ALUMINUM HOUSING, POWDER COAT FINISH, 4000K, UNIVERSAL	<i>"</i>		
■ P17	POLE: RTA 30 8E	LED	33' ABOVE GRADE	VOLTAGE, PROVIDE TWO FIXTURES MOUNTED AT 180°, PROVIDE WITH SNAP LP-250-11,	POLE: VALMONT #R290845805-D2		
	FULE. RIA JU GE		JO ADOVE GIVADE	ROUND TAPERED ALUMINUM POLE.			

^{*} ALL FINISHES AND FIXTURE COLOR TEMPERATURE SHALL BE DIRECTED BY ARCHITECT/OWNER PRIOR TO ORDERING FIXTURES

LICENSE #AA0002730 648 Florida Avenue

> Panama City, Fl. 32401 P 850/257-5400

> > Principal in Charge David M Bagwell Project Number: 4166-2 Date Issued: 5-7-2015

> > > Drawn By: D.C. Checked By: D.B. Revisions:

B BAGWELL ENGINEERING

216 E. Government St. Pensacola, FL 32502 Phone: (850) 462-8040 FL Authorization No. 30167 FL PE No. 59251 Job Number: 15-019

GE Ш COL


AMPUS S COAST SE PHA

GEND

GULI

BID DOCUMENTS

^{**} EACH FIXTURE REQUIRES 0-10 VOLT DIMMING CAPABILITY

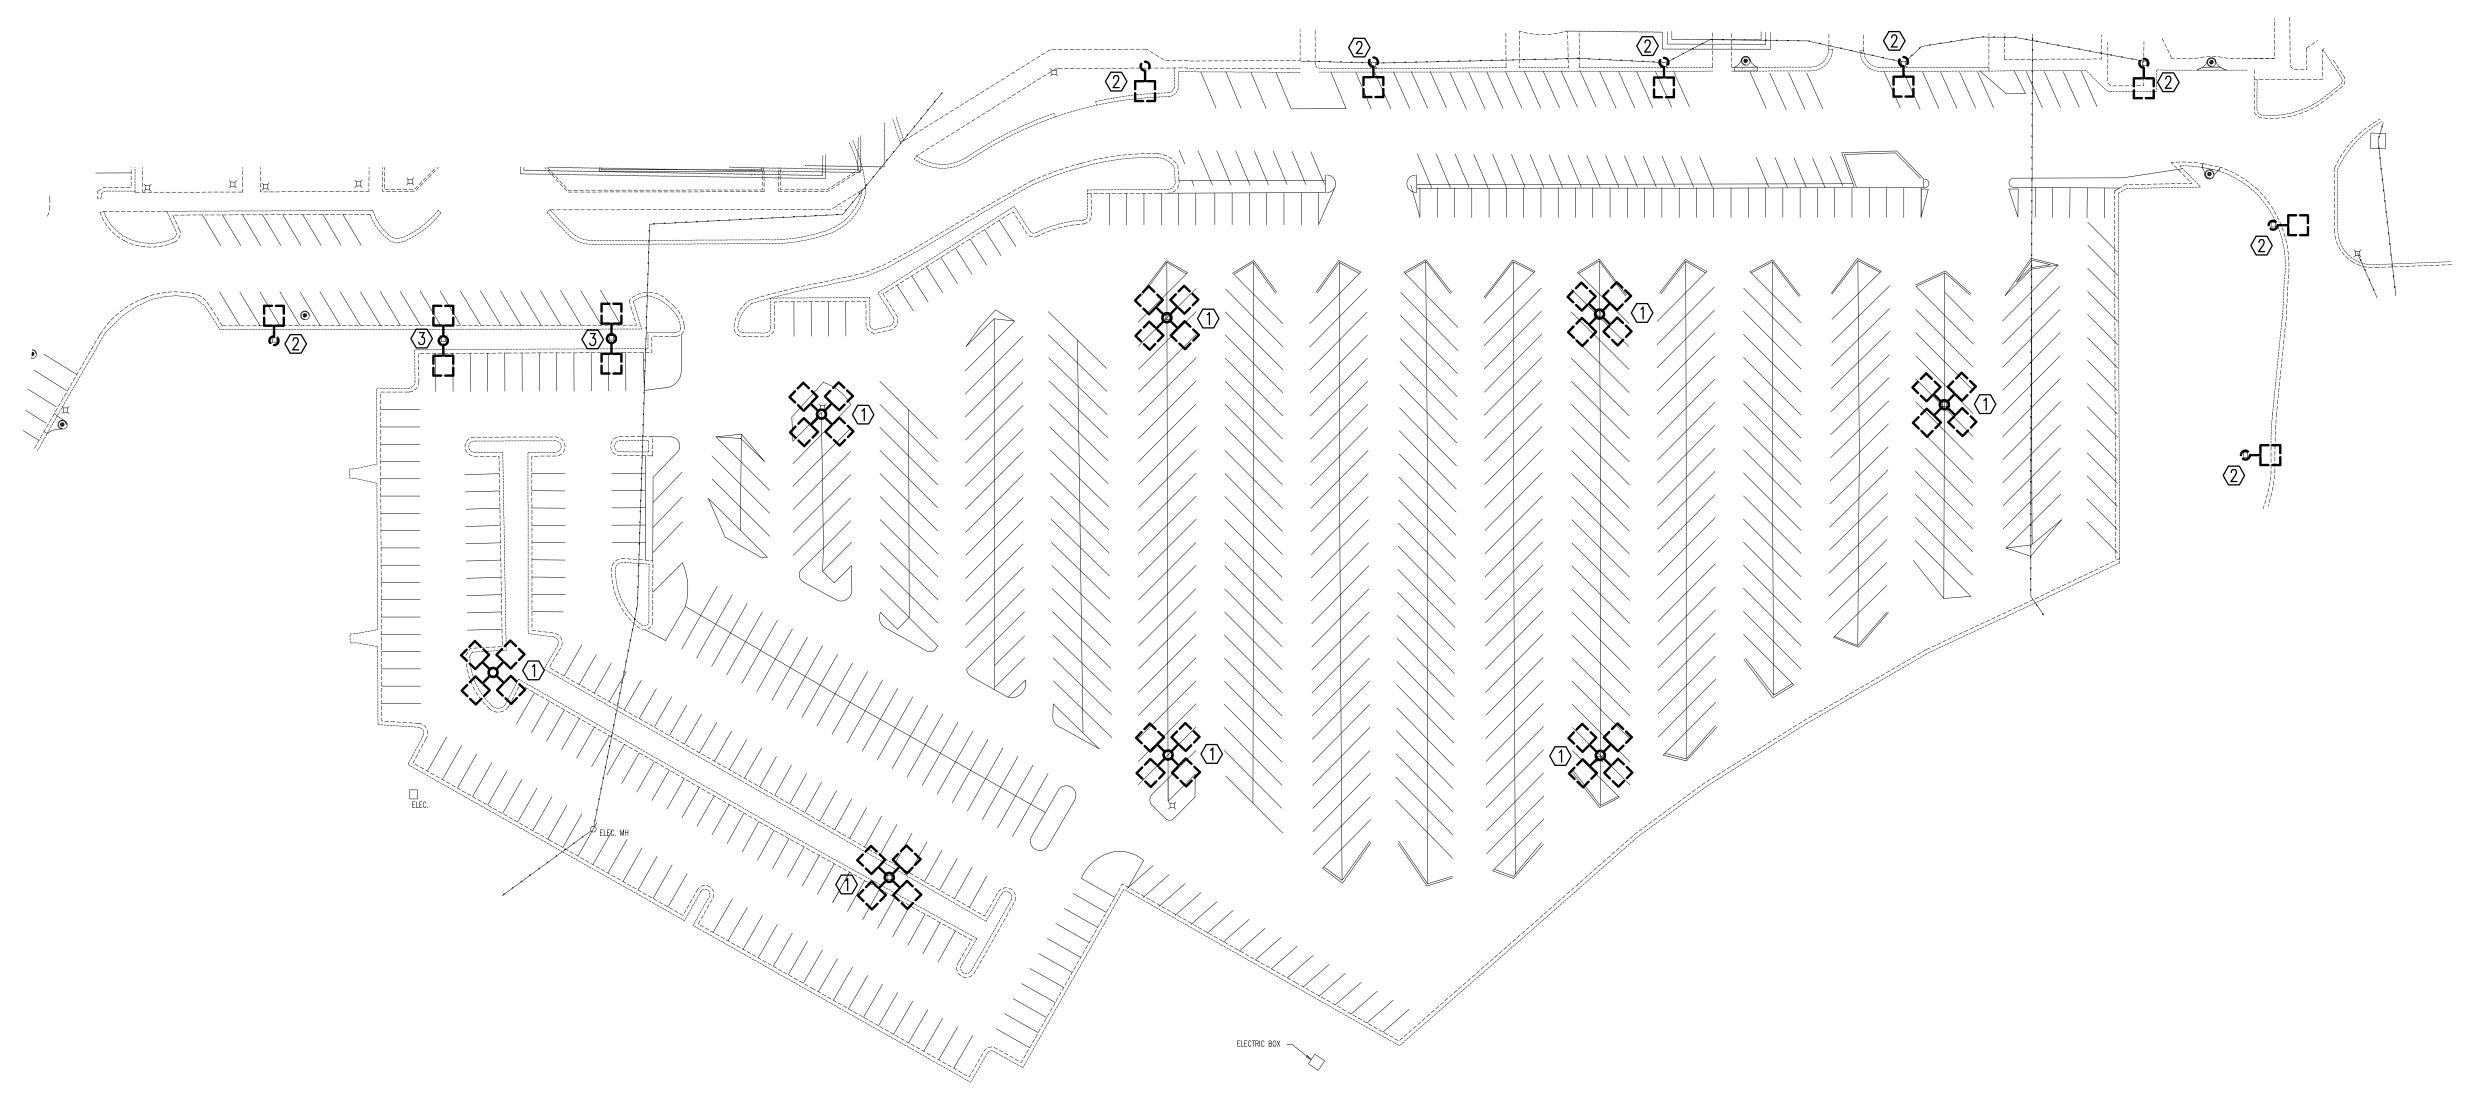

KEYNOTES:

REMOVE EXISTING QUAD HEAD LIGHTING FIXTURE. REMOVE EXISTING CONCRETE BASE. REMOVE EXISTING CONDUCTORS BACK TO SOURCE. EXISTING CONDUITS SHALL BE CUT BELOW GRADE AND CAPPED AND ABANDONED IN PLACE.

REMOVE EXISTING SINGLE HEAD LIGHTING FIXTURE. REMOVE EXISTING CONCRETE BASE. INFILL AND PATCH TO MATCH EXISTING. REMOVE EXISTING CONDUCTORS BACK TO SOURCE. EXISTING CONDUITS SHALL BE CUT BELOW GRADE AND CAPPED AND ABANDONED IN PLACE.

REMOVE EXISTING DUAL HEAD LIGHTING FIXTURE. REMOVE EXISTING CONCRETE BASE. INFILL AND PATCH TO MATCH EXISTING. REMOVE EXISTING CONDUCTORS BACK TO SOURCE. EXISTING CONDUITS SHALL BE CUT BELOW GRADE AND CAPPED AND ABANDONED IN PLACE.

 $\frac{\text{PARKING LOT LIGHTING DEMOLITION PLAN}}{\text{SCALE: 1"} = 50'}$

FLORIDA
ARCHITECTS
LICENSE #AA0002730
648 Florida Avenue
Panama City, Fl. 32401
P 850/257-5400

Principal in Charge
David M Bagwell
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
D.C.
Checked By:

D.B. Revisions:

GWELL ENGINEERING 216 E. Government St. Pensacola, FL 32502

BAGWELL ENGINEERING
216 E. Government St.
Pensacola, FL 32502
Phone: (850) 462-8040
FL Authorization No. 30167
FL PE No. 59251
Job Number: 15-019

GULF COAST STATE COLLEGE
PHASE 1 CAMPUS
IMPROVEMENTS

ELECTRICAL DEMOLITION PLAN


BID DOCUMENTS

Sheet Number

E2




TO THE HANDHOLES AND NEAR BUILDINGS WILL REQUIRE HAND DIGGING.

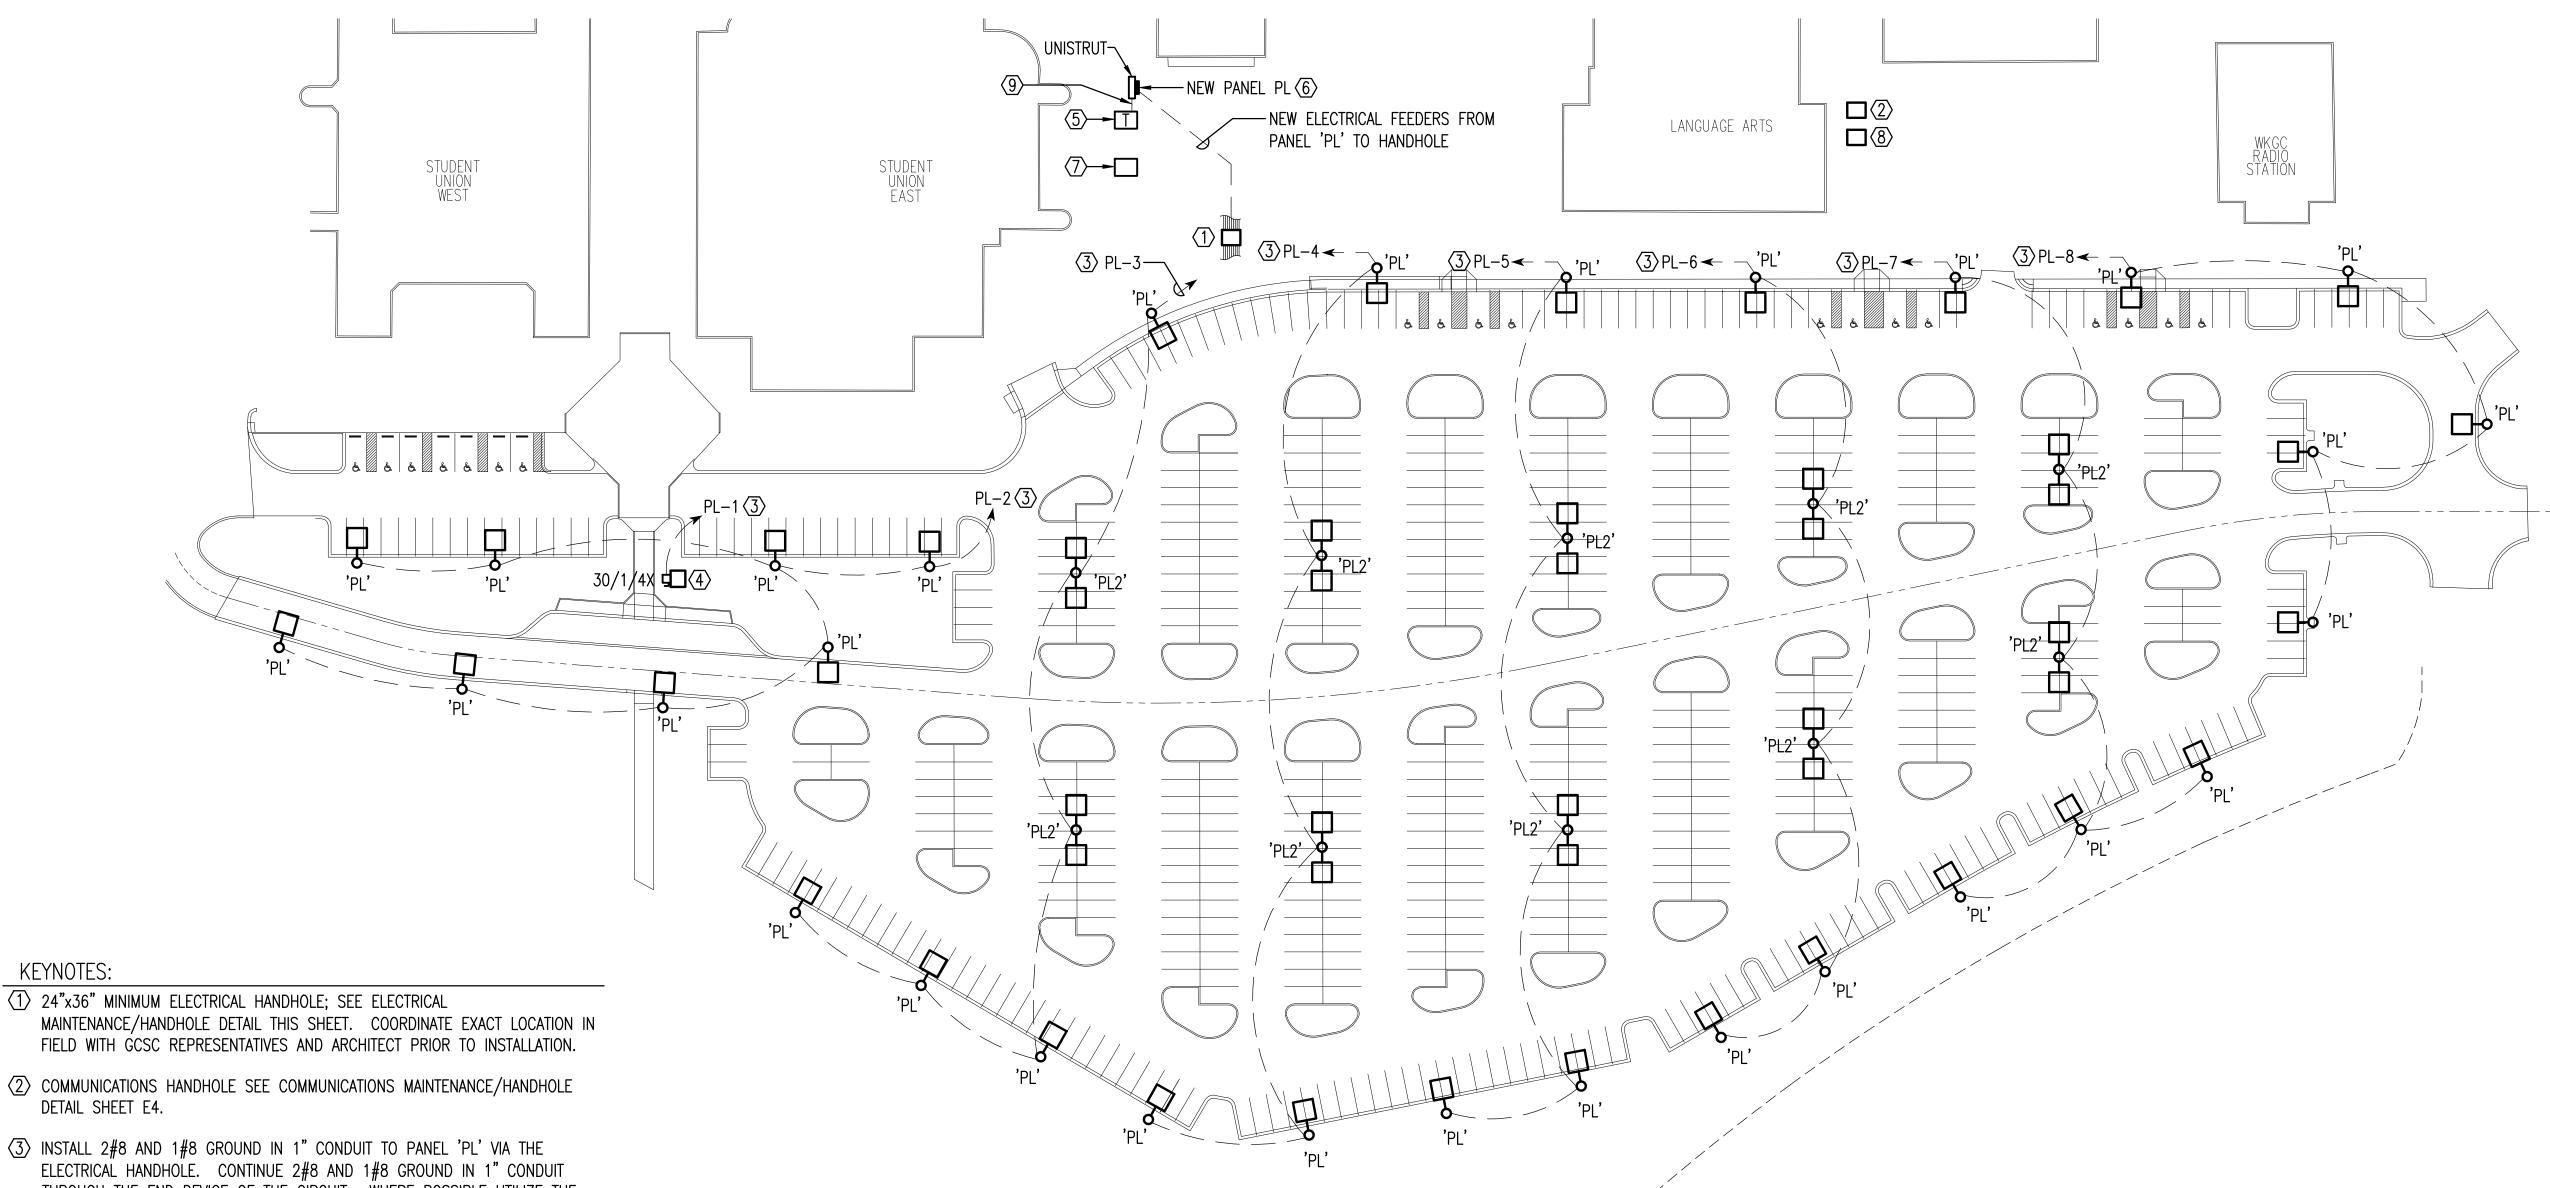

KEYNOTES:

- MAINTENANCE/HANDHOLE DETAIL THIS SHEET. COORDINATE EXACT LOCATION IN FIELD WITH GCSC REPRESENTATIVES AND ARCHITECT PRIOR TO INSTALLATION.
- (2) COMMUNICATIONS HANDHOLE SEE COMMUNICATIONS MAINTENANCE/HANDHOLE DETAIL SHEET E4.
- (3) INSTALL 2#8 AND 1#8 GROUND IN 1" CONDUIT TO PANEL 'PL' VIA THE ELECTRICAL HANDHOLE. CONTINUE 2#8 AND 1#8 GROUND IN 1" CONDUIT THROUGH THE END DEVICE OF THE CIRCUIT. WHERE POSSIBLE UTILIZE THE COMMON UTILITY TRENCH FOR ALL INSTALLATIONS THROUGH THE EXISTING PARKING AREA.
- 4 NEW ILLUMINATED SIGN/MAP LOCATION. COORDINATE EXACT LOCATION IN FIELD PRIOR TO INSTALLING CIRCUIT. INSTALL A 30/1/4X DISCONNECT AND CONNECT TO A NEW 277-120 VOLT TRANSFORMER IN WEATHERPROOF ENCLOSURE PRIOR TO CONNECTING CIRCUIT TO SIGN/MAP. CONNECT TO SIGN/MAP PER THE MANUFACTURERS REQUIREMENTS. COORDINATE THE LOCATIONS OF DISCONNECTS AND WEATHERPROOF ENCLOSURES WITH THE ARCHITECT PRIOR TO INSTALLING TO ENSURE AN AESTHETIC PRESENTATION.
- (5) EXISTING PAD MOUNT 277/480V, 3 PHASE TRANSFORMER TO REMAIN.
- 6 NEW 60 AMP 277V/3 PHASE PANEL 'PL' IN NEMA 4X ENCLOSURE. PANEL SHALL BE MOUNTED ON UNISTRUT. SEE PANEL MOUNTING DETAIL SHEET E6. LEVEL GRADE PRIOR TO INSTALLING PAD.
- (7) EXISTING ELECTRICAL JUNCTION CABINET TO REMAIN.
- (8) ELECTRICAL HANDHOLE FOR FUTURE CCTV 120 VOLT POWER. REFER TO SHEET E4 FOR ADDITIONAL INFORMATION. NO CONDUIT SHOWN ON THIS SHEET SHALL BE ROUTED TO THIS HANDHOLE. COORDINATE EXACT LOCATION IN FIELD WITH GCSC REPRESENTATIVES AND ARCHITECT PRIOR TO INSTALLATION.
- (9) NEW ELECTRICAL SECONDARY. REFER TO POWER RISER DIAGRAM SHEET E7 FOR WIRE AND CONDUIT SIZE.

NEW WORK PARKING LOT LIGHTING ELECTRICAL PLAN,

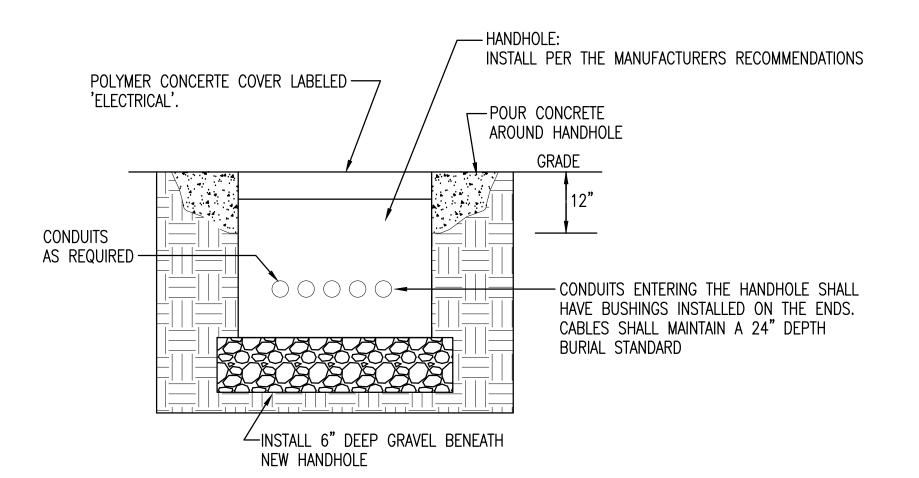

ELECTRICAL MAINTENANCE/HANDHOLE DETAIL NOT TO SCALE

HANDHOLE REQUIREMENTS:

MAINTENANCE HOLES ARE REQUIRED TO MEET ANSI/SCTE 77 TIER 15. MAINTENANCE HOLES SHALL BE PRECAST CONCRETE. COVER SHALL MEET ENVIRONMENTAL CONDITIONS. EQUIP THE MAINTENANCE HOLE WITH CORROSION RESISTANT PULLING IRONS

POLE FOUNDATION NOTE:

THE POLE FOUNDATION SHALL BE SQUARE ABOVE GRADE BUT ROTATED 45 DEGREES IN A "DIAMOND" SHAPE IN THE MIDDLE OF THE PARKING SPACE. COORDINATE EXACT ORIENTATION WITH THE ARCHITECT PRIOR TO THE FIRST FOUNDATION INSTALLATION.

CIRCUITING NOTE:

THE CIRCUITING SHOWN IS DIAGRAMMATIC. CONDUIT AND WIRE SHALL BE INSTALLED IN COMMON TRENCHES WITH OTHER UTILITIES. COORDINATE WITH THE CIVIL PLAN FOR TRENCH DETAILS.

LICENSE #AAOOO2730

648 Florida Avenue Panama City, Fl. 32401 P 850/257-5400

> Principal in Charge David M Bagwell Project Number: 4166-2 Date Issued: 5-7-2015 Drawn By: D.C. Checked By: D.B.

> > Revisions:




BAGWELL ENGINEERING Pensacola, FL 32502 Phone: (850) 462-8040 FL Authorization No. 30167 FL PE No. 59251 Job Number: 15-019

EGE COLL AMPUS **PHASE** COAST

GULF

BID DOCUMENTS

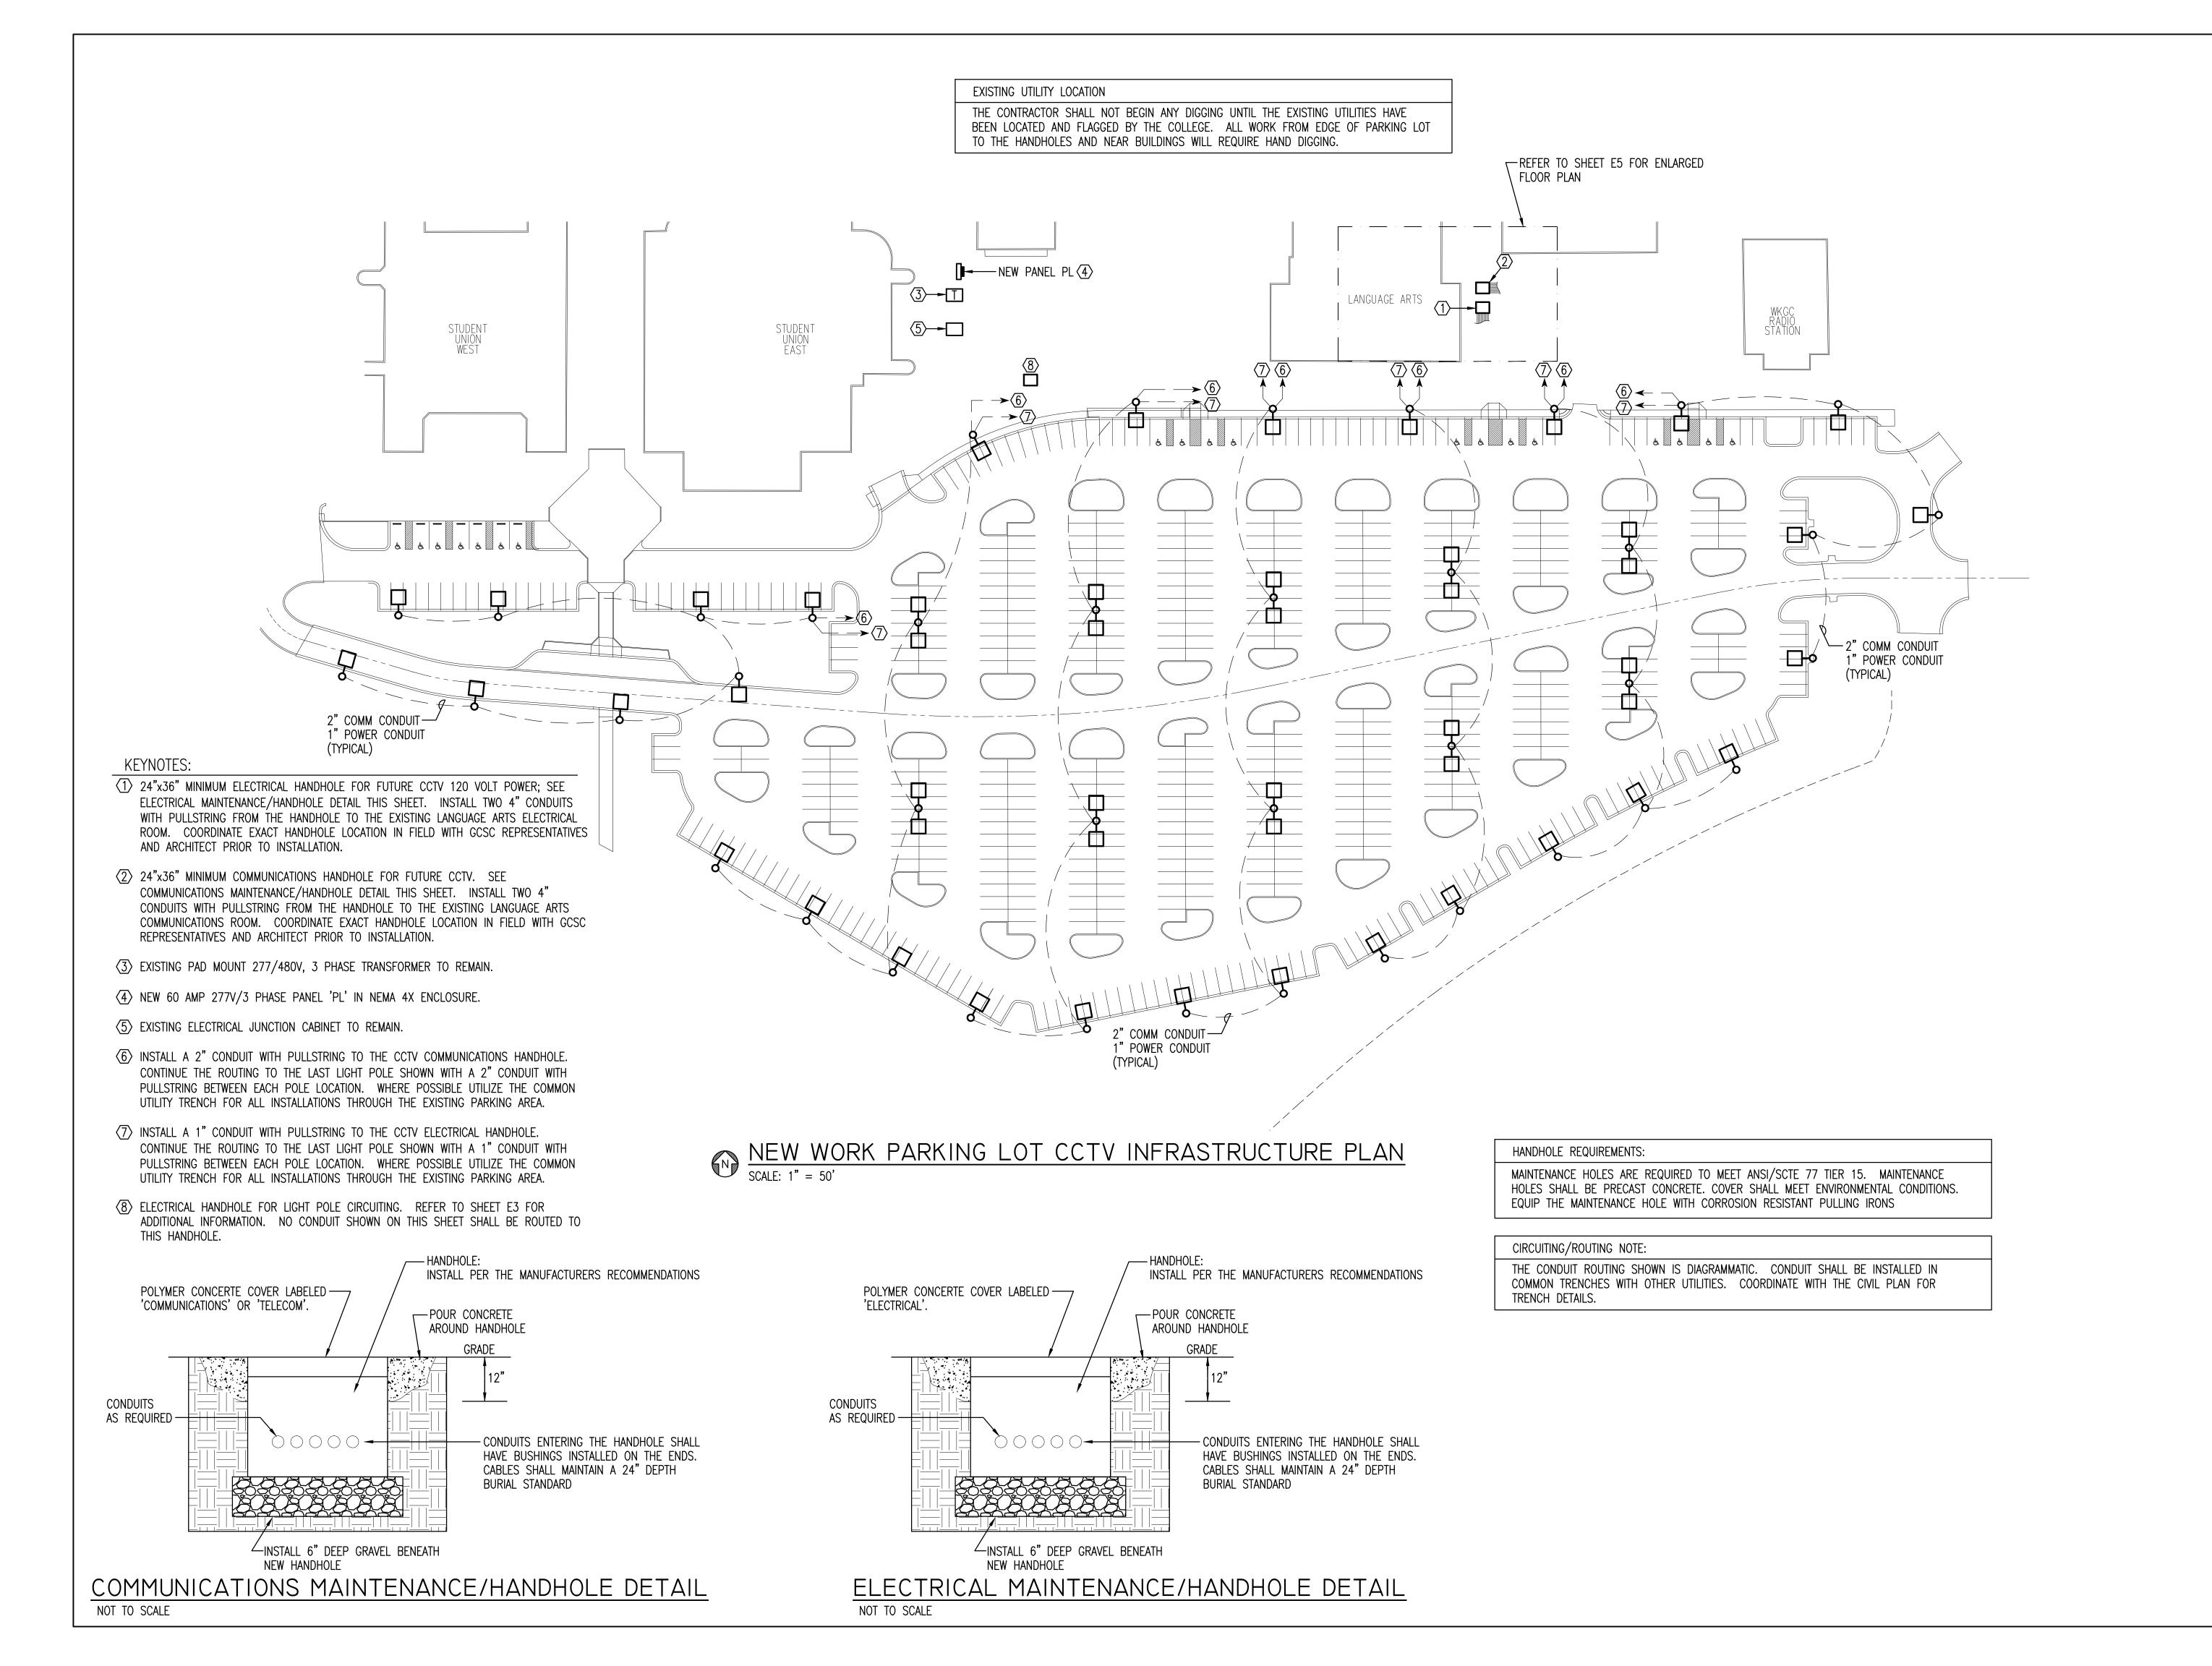

FLORIDA
ARCHITECTS
LICENSE #AA0002730
648 Florida Avenue

Panama City, Fl. 32401 P 850/257-5400

Principal in Charge
David M Bagwell
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
D.C.

Checked By:
D.B.
Revisions:

BAGWELL ENGINEER


AGWELL ENGINEERING 216 E. Government St. Pensacola, FL 32502 Phone: (850) 462-8040 FL Authorization No. 30167 FL PE No. 59251 Job Number: 15-019

E COLLEGE APUS


GULF COAST STATE COL
PHASE 1 CAMPUS

NEW WORK CCTV INFRASTRUCTURE PLAN

BID DOCUMENTS

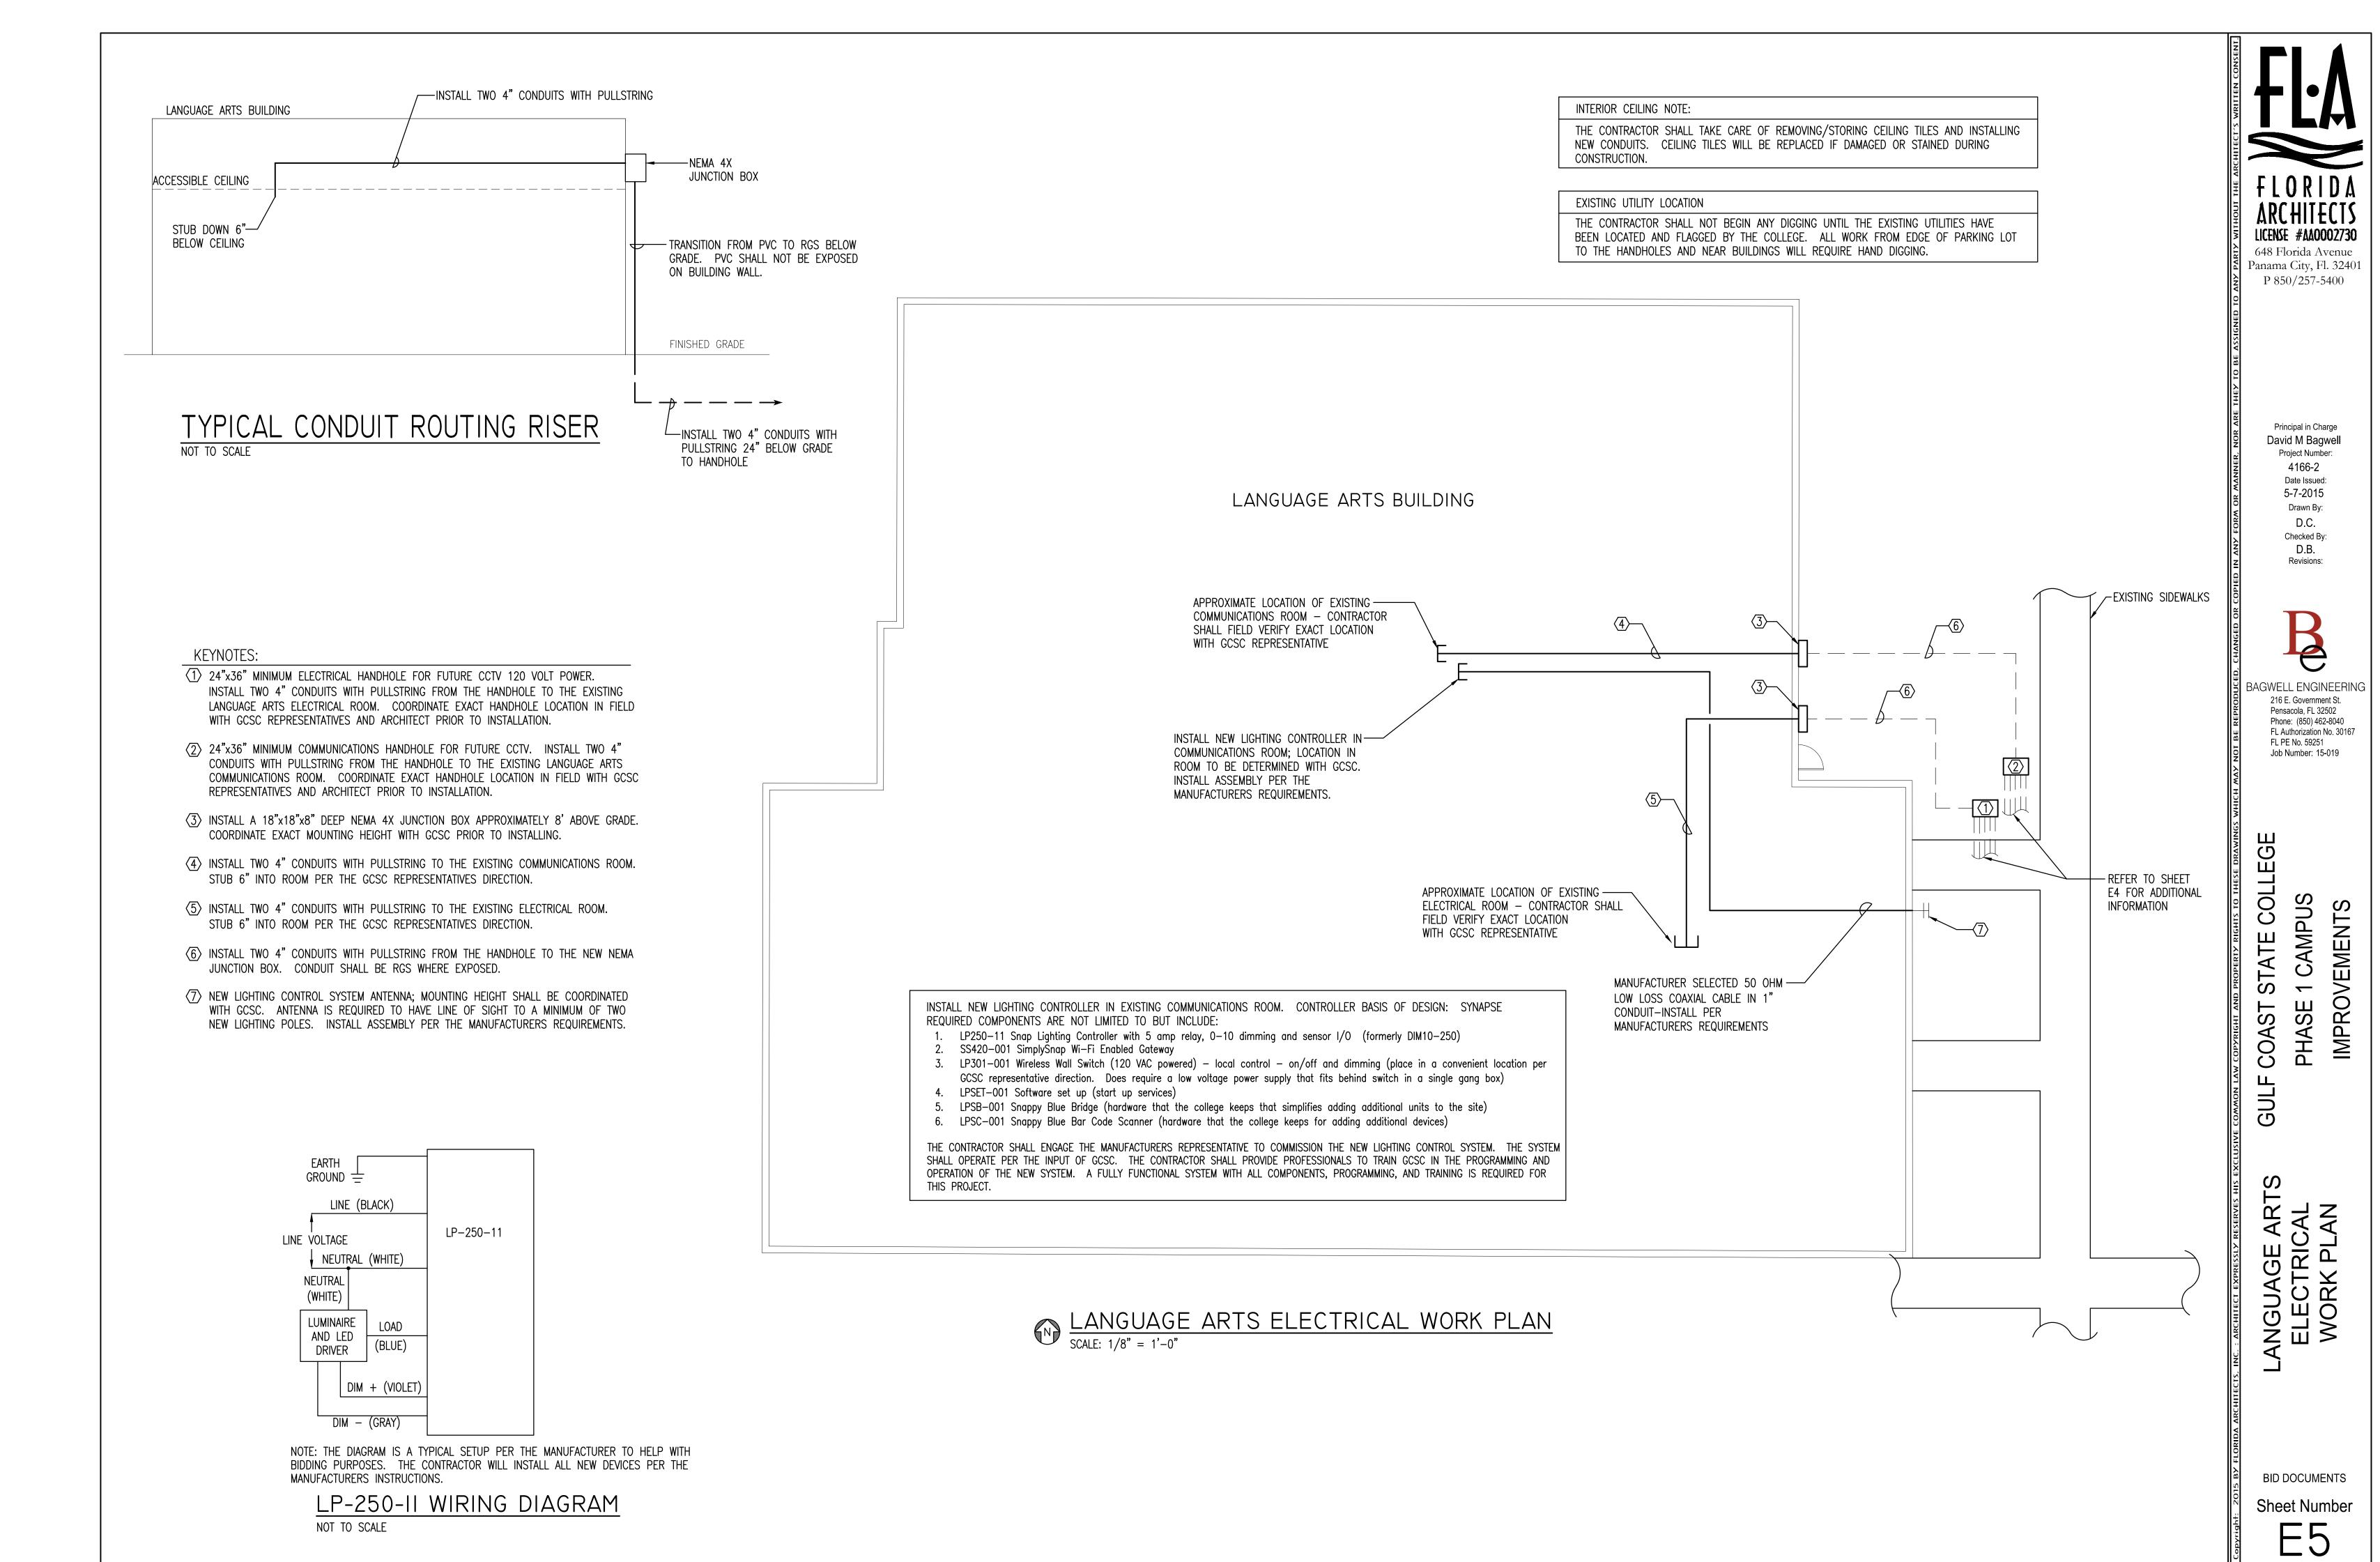


ELECTRICAL POLE BASE FOR FIXTURES 'PL', 'PL2', NOT TO SCALE

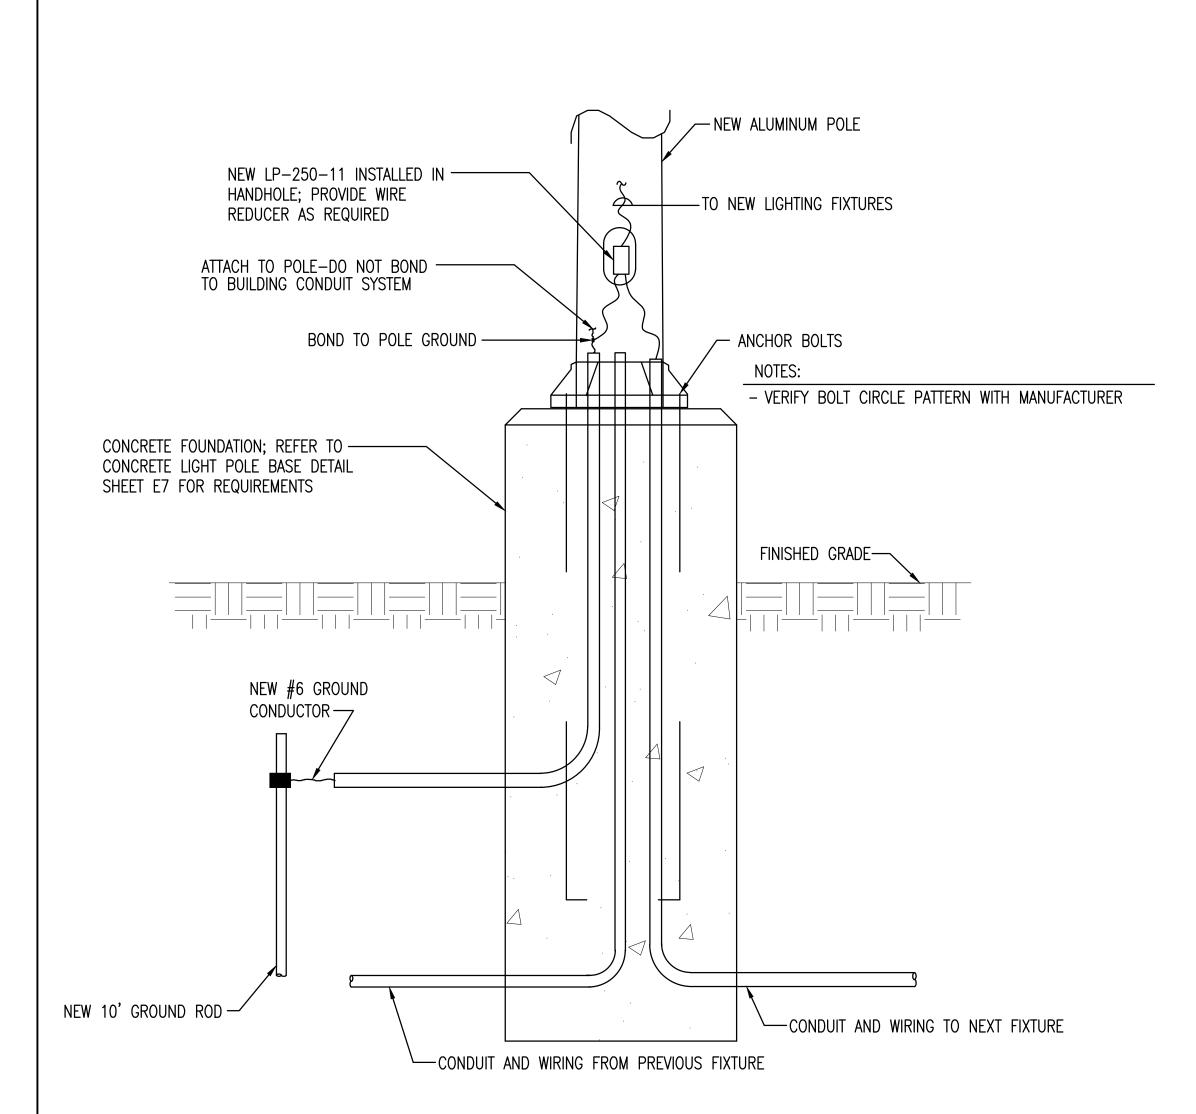


POLE INSTALLATION DETAIL

NOT TO SCALE

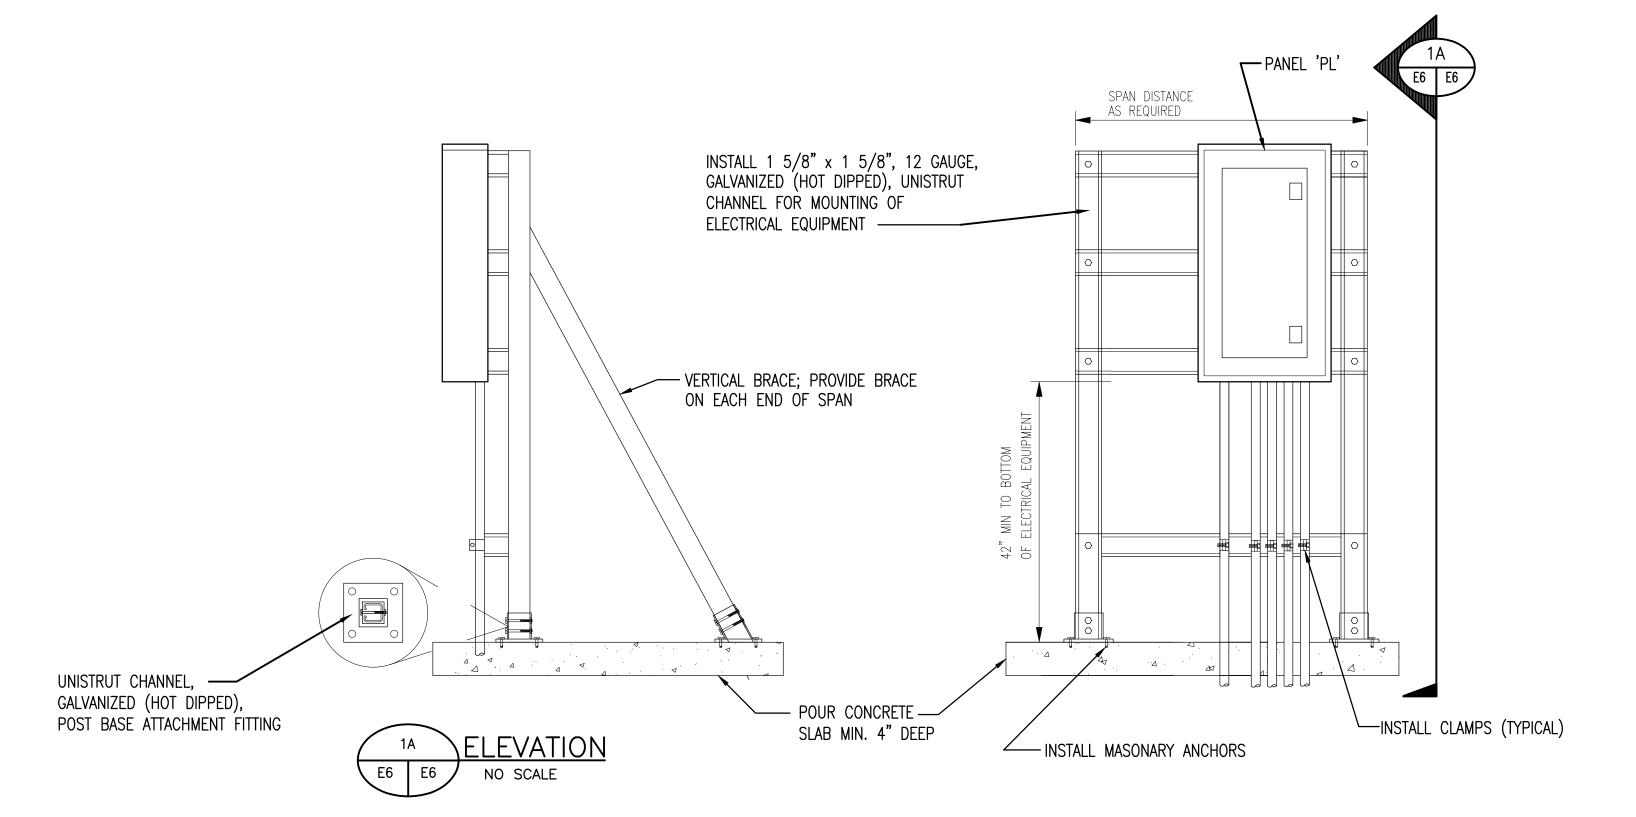

PANEL MOUNTING DETAIL

NOT TO SCALE

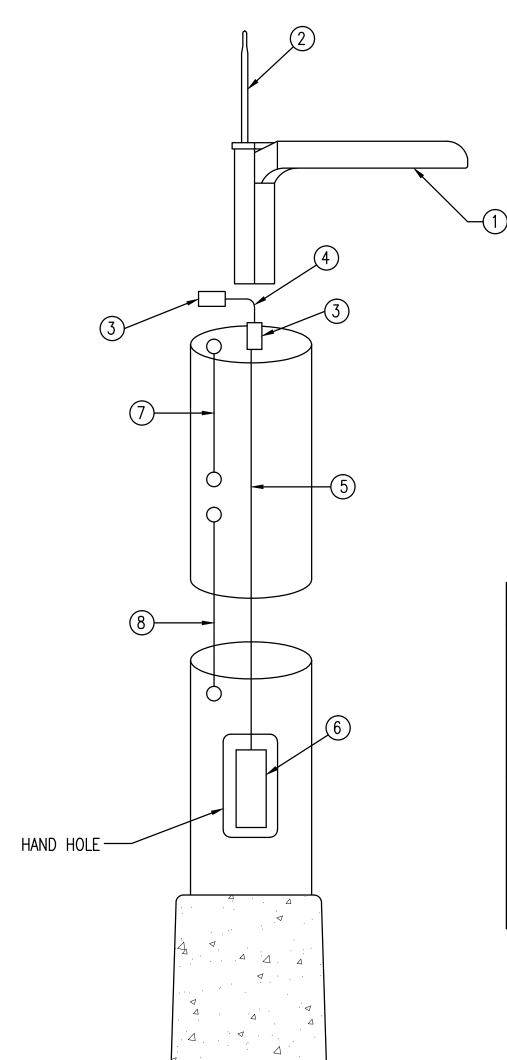

ITEM #	PART #	DESCRIPTION
1	LITHONIA DSX2 LED	LITHONIA DSX2 LED FIXTURE; SEE LIGHTING FIXTURE SCHEDULE FOR EXACT FIXTURE
2	HG2405RD-RSP	5 dBi RP-SMA ANTENNA L-COM
3	AXA-RSJRSJB	BULKHEAD JACK - RP-SMA FEMALE TO RP-SMA FEMALE L-COM
4	CA-RSPRSPCN19	19" PIGTAIL CABLE - RP-SMA MALE TO RP-SMALE L-COM
5	CA-RSPRSJA030	30 FOOT LOW LOSS RF CABLE L-COM ITEM
6	LP-250-11	250-11 LIGHT CONTROLLER SYNAPSE
7	DWYH08020	20 FOOT WIRE GRABBER - DUAL HOOKS - ARLINGTON
8	DWYH08010	10 FOOT WIRE GRABBER - DUAL HOOKS - ARLINGTON

LP-250-II MOUNTING IN HAND HOLE WITH 30 FOOT POLE

NOT TO SCALE

FLORIDA
ARCHITECTS
LICENSE #AA0002730
648 Florida Avenue

Panama City, Fl. 32401 P 850/257-5400

Principal in Charge
David M Bagwell
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
D.C.
Checked By:
D.B.

Revisions:


BAGWELL ENGINEERING 216 E. Government St.

216 E. Government St.
Pensacola, FL 32502
Phone: (850) 462-8040
FL Authorization No. 30167
FL PE No. 59251
Job Number: 15-019

GULF COAST STATE COLLEGE
PHASE 1 CAMPUS

TRICAL DETAILS


BID DOCUMENTS

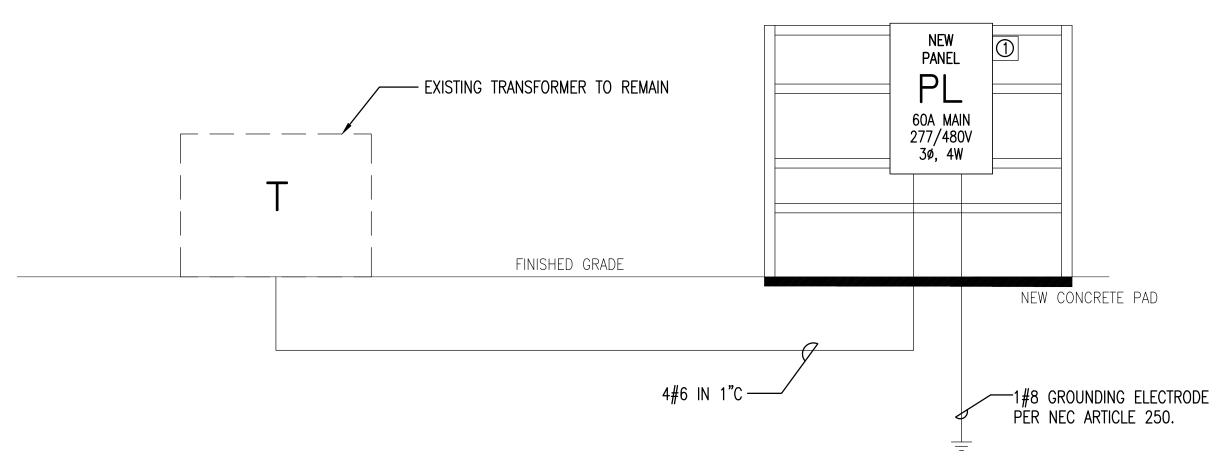

POWER RISER DIAGRAM NOT TO SCALE

POWER RISER KEYNOTES:

① SURGE SUPPRESSOR; EQUAL TO SURGE SUPPRESSION INC. #SKB3Y2D3
INSTALL PER MANUFACTURER'S RECOMMENDATIONS; SURGE SUPPRESSOR SHALL
BE NEMA 3R RATED.

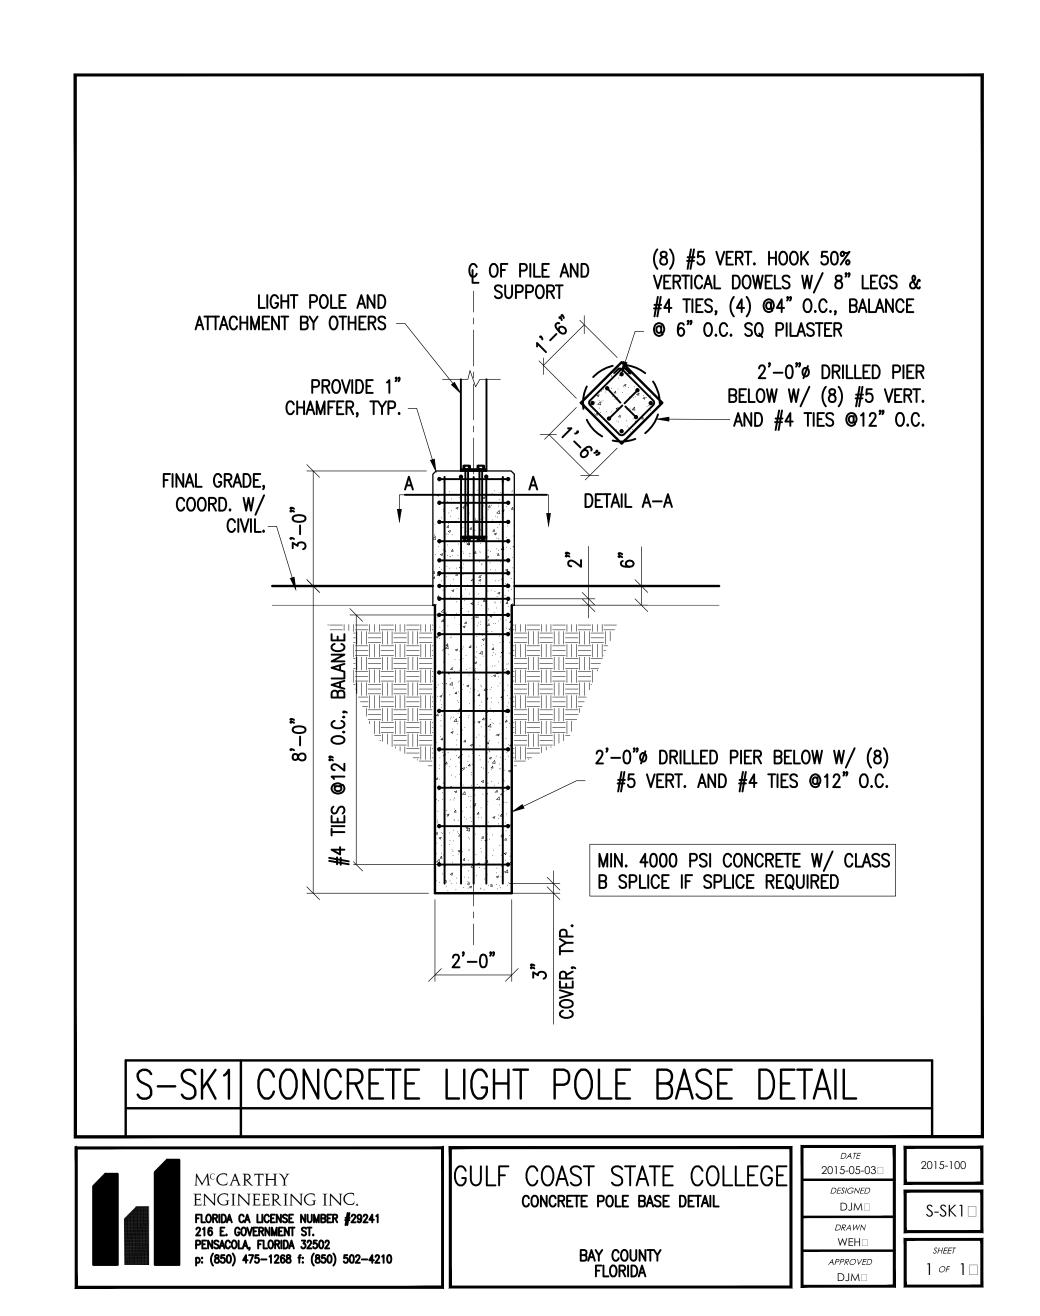

	1			ı			L F			T		T	-
CKT	LOAD DECODIDITION	BREAKER		KVA/PHASE		4SE	KVA/PHASE		BREAKER		LOAD DESCRIPTION	CKT	
CKI	LOAD DESCRIPTION	POLE	AMP	Α	В	С	Α	В	С	AMP	POLE	LOAD DESCRIPTION	CN
1	ILLUMINATED MAP	1	20	.1			1.16			20	1	PARKING LOT LIGHTS	2
3	PARKING LOT LIGHTS	1	20		2.55			1.62		20	1	PARKING LOT LIGHTS	4
5	PARKING LOT LIGHTS	1	20			1.62			1.62	20	1	PARKING LOT LIGHTS	6
7	PARKING LOT LIGHTS	1	20	1.86			1.16			20	1	PARKING LOT LIGHTS	8
9	SPARE	1	20							20	1	SPARE	10
11	SPARE	1	20							20	1	SPARE	12
13	SPARE	1	20							20	1	SPARE	14
15	SPARE	1	20							20	1	SPARE	16
17	SPACE ONLY	1	-								1	SPACE ONLY	18
19	SPACE ONLY	1	-								1	SPACE ONLY	20
21	SPACE ONLY	1	-								1	SPACE ONLY	22
23	SPACE ONLY	1	-								1	SPACE ONLY	24
25	SPACE ONLY	1								A	A	A	26
27	SPACE ONLY	1	-							30	3	SURGE SUPPRESSOR	28
29	SPACE ONLY	1	-							V	V	\	30

FLORIDA ARCHITECTS
ARCHITECTS

LICENSE #AA0002730648 Florida Avenue
Panama City, Fl. 32401
P 850/257-5400

Principal in Charge
David M Bagwell
Project Number:
4166-2
Date Issued:
5-7-2015
Drawn By:
D.C.
Checked By:
D.B.

Revisions:

BAGWELL ENGINEERING
216 E. Government St.

GWELL ENGINEERIN 216 E. Government St. Pensacola, FL 32502 Phone: (850) 462-8040 FL Authorization No. 30167 FL PE No. 59251 Job Number: 15-019

COAST STATE COLLEGE
PHASE 1 CAMPUS
IMPROVEMENTS

ELECTRICAL RISER
AND CONCRETE
POLE FOUNDATION
DETAIL

BID DOCUMENTS