

ADDENDUM NO. THREE (3)

The Construction Drawings and/or Project Manual for the above project are amended in the following particulars and in these particulars only. All provisions of the original drawings and/or specifications shall remain in force, except as specifically modified or changed herein or by other Addenda issued by the Architect. This Addendum is hereby made part of the Contract Documents.

This Addendum addresses responses to comments and requests for information received to date.

PROJECT MANUAL/SPECIFICATIONS (PM):

Item No. PM1: Refer to Specification Section 133417, Press Box; **MODIFY** to allow the approved manufacturers to each provide their standard pre-engineered, pre-fabricated Press Box in lieu of customization. The Press Box shall meet the requirements of the Florida Building Code 2014.

DRAWINGS:

ARCHITECTURAL (A) Refer to attached updated Drawings:

Item No. 1A: Refer to Drawing Sheet A4.0, Door Schedule: **CHANGE** Door 2-106 to hollow metal door and frame as indicated on the attached updated drawing Sheet A4.0. Adjust elevation diagram height accordingly.

Item No. 2A: Refer to Drawing Sheet A8.10, Wall Types / Details: **REPLACE** Attached Revised Wall Types / Details sheet A8.10, Wall Types updated to **CHANGE** the sprayed insulation in the concrete masonry unit walls to 2-1/2" of sprayed insulation in the interior side stud cavity. This change also modifies Detail 1/A8.10 accordingly.

ELECTRICAL (E) Refer to attached updated Drawings:

Item No. 1E: Refer to Drawing Sheet E3, Lighting Fixture Schedule: **CHANGE** the Lighting Fixture Schedule as indicated on the attached revised Sheet E3.

OTHER QUESTIONS AND RESPONSES:

Q1: *I do not see a detail for the backstop--only a description--is there a drawing I overlooked?*
Response: The backstop detail is located within the structural plans – Refer to Sheet S-302.

Q2: *Is there a detail on the 4' x 20' slide gate or do you want me to design and submit?*
Response: Please design and submit.

Q3: *I see no detail on batting cages. I assume standard posts and netting?*
Response: Batting cages are being provided by the Owner, the contractor will be installing concrete slab/foundation only.

Q4: *Both dugouts call for 10' Fence, but detail show fence in front--maybe 4' with Wall Pro Netting?*
Response: The dugouts shall be protected by a 10-foot high barrier fence which consists of the Wall Pro Netting within a galvanized frame. Contractor shall contact manufacturer for detail since it is typically an all-inclusive sports package.

Q5: *I did not see any written specs for fence. I assume we use the drawing detail as our spec---our wire will be fused bonded?*
Response: See specification section 302830 for fencing specification. Please utilize DQ40.

End of Addendum No. 3

LIGHTING FIXTURE SCHEDULE

MARK	MANUFACTURER & CATALOG No.	LAMPS		MOUNTING	DESCRIPTION
		No.	TYPE		
D1	PHILIPS No. P6RDIONZIOUVB-P6FD8035VB-P6RDCC	-	10W LED 3500K	RECESSED	NOMINAL 6" RECESSED LED DOWNLIGHT WITH 1000 LUMEN OUTPUT AT 3500K, COMFORT CLEAR REFLECTOR WITH WHITE FLANGE, UNIVERSAL VOLTAGE DRIVER, NET LOCATION LISTED.
E	PHILIPS No. CXXL3RW	-	LED	UNIVERSAL	NOMINAL LED EXIT LIGHT FIXTURE WITH UNIVERSAL MOUNTING, UNIVERSAL FACES, WHITE THERMOPLASTIC HOUSING WITH EMERGENCY BATTERY BACKUP WITH SELF TEST FEATURE.
EM	BEGHELLI No. XLP-LED2-AT-HO	-	LED	WALL MOUNT 8'-0" A.F.F.	NOMINAL LED EMERGENCY FIXTURE, DAMP LOCATION LISTED WITH EMERGENCY BATTERY BACKUP AND SELF TEST FEATURE. MEETS EGRESS 6' PATH REQUIREMENTS WITH 20' SPACING.
G1	PHILIPS No. ITG22L835-4-F5-19F-UNV-DIM-FMAI4	-	22W LED 3500K	RECESSED	NOMINAL 1X4 RECESSED LENSED LED TROFFER WITH 0.156" THICK ACRYLIC LENS, STANDARD DRIVER, 2000 LUMEN OUTPUT. PROVIDE WITH HARD CEILING ADAPTER KIT WHERE NECESSARY.
G2	PHILIPS No. ITG32L835-4-F5-19F-UNV-DIM-FMAI4	-	31W LED 3500K	RECESSED	SIMILAR TO FIXTURE MARK G1 EXCEPT 3000 LUMEN OUTPUT.
G3	PHILIPS No. 2TG32L835-4-F5-19F-UNV-DIM	-	28W LED 3500K	RECESSED	NOMINAL 2X4 RECESSED LENSED LED TROFFER WITH 0.156" THICK ACRYLIC LENS, STANDARD DRIVER, 2000 LUMEN OUTPUT. PROVIDE WITH HARD CEILING ADAPTER KIT WHERE NECESSARY.
M1	HE WILLIAMS No. 75L-4-L38/835-AI2I25-WG-7511-LED-DRV-UNV	-	41W LED 3500K	SURFACE MOUNT	NOMINAL 4' LED SURFACE OR PENDANT MOUNT FIXTURE WITH 3000 LUMEN OUTPUT AT 3500K, UNIVERSAL VOLTAGE DRIVER, AND WIRE GUARD.
M2	HE WILLIAMS No. 75L-4-L65/835-AI2I25-WG-7511-LED-DRV-UNV	-	56W LED 3500K	SURFACE MOUNT	SIMILAR TO FIXTURE MARK "M1" EXCEPT 5000 LUMEN OUTPUT.
R1	HE WILLIAMS No. AT2-24-L55/835-D-L45-DIM-UNV	-	48W LED 3500K	RECESSED	ARCHITECTURAL 2' X 4' LED VOLUMETRIC TROFFER WITH HINGED DOOR FRAME, FROSTED ACRYLIC LENS, 5000 LUMEN OUTPUT AT 3500K, UNIVERSAL VOLTAGE DRIVER.
S1	PHILIPS No. ISML32L835-4-FAI9F-UNV-DIM	-	30W LED 3500K	RECESSED	NOMINAL 1X4 SURFACE MOUNT LENSED LED TROFFER WITH 0.156" THICK ACRYLIC LENS, STANDARD DRIVER, 2000 LUMEN OUTPUT.
SM1	LUMINAIRE No. VPF82-25-4000K-120-2TT-OP-XX-NET	-	25W LED 40K	SURFACE MOUNT	VANDAL RESISTANT 1X2 LED SURFACE MOUNTED FIXTURE WITH OPAL ACRYLIC LENS, 2500 LUMEN OUTPUT AT 3500K, UNIVERSAL VOLTAGE DRIVER. VERIFY FINISH WITH OWNER.
WBI	LUMINAIRE No. VPF82-25-3500K-120-2TT-OP-XX	-	25W LED 3500K	WALL MOUNT 8'-0" A.F.F. OR ABOVE MIRROR	SIMILAR TO FIXTURE MARK SM1 EXCEPT WALL MOUNT
WPI	GARDCO No. 111L-16-350-NX-62-3-UNV-XX	-	18W LED 4000K	WALL MOUNT 10'-0" A.F.F.	LED WALL MOUNT LED LOT FIXTURE TYPE 3 DISTRIBUTION, 3000 LUMEN OUTPUT AT 4000K, UNIVERSAL VOLTAGE DRIVER, VERIFY FINISH WITH OWNER/ARCHITECT.
WPI2	GARDCO No. 111L-16-350-NX-62-3-UNV-PCB-XX	-	18W LED 4000K	WALL MOUNT 10'-0" A.F.F.	SIMILAR TO FIXTURE MARK WPI EXCEPT WITH INTEGRAL PHOTOCELL.
*PLE	GARDCO No. ECF-1-3-215KA-64IA-NX-2TT-XX-LF-PCRT POLE: VALMONT No. R290860106T4-DI-XX	-	215W LED 4000K	POLE MOUNT 30'-0" A.F.F.	OWNER FURNISHED CONTRACTOR INSTALLED. LED POLE MOUNT LIGHT FIXTURE TYPE 3 DISTRIBUTION AND WATTSTOPPER No. NNTL-III-IP WIRELESS CONTROLS.
PA	GARDCO No. ECF-5-32L-530-NX-62-AR-2-UNV-TLRD7-FI-RPA-XX POLE: VALMONT No. R150830504T4-DI-XX	-	55W LED 4000K	POLE MOUNT 15'-0" A.F.F.	LED POLE MOUNT PEDESTRIAN LIGHT FIXTURE, TYPE T1 DISTRIBUTION, 6864 LUMEN AT 4000K. VERIFY FINISH WITH OWNER. PROVIDE WITH WATTSTOPPER No. NNTL-III-IP CONTROLLER.
PB	GARDCO No. ECF-5-32L-530-NX-62-AR-5-UNV-TLRD7-FI-RPA-XX POLE: VALMONT No. R150830504T4-DI-XX	-	55W LED 4000K	POLE MOUNT 15'-0" A.F.F.	SIMILAR TO FIXTURE MARK PA EXCEPT TYPE 5 DISTRIBUTION AND 7414 LUMEN OUTPUT.
FL	GARDCO No. G5FM 48L IA NW GI YK RSP UNV DD XX 5G-G5FM MF4-(F)	-	213W LED 4000K	POLE MOUNT 3'-0" A.F.F.	NOMINAL LED FLOOD LIGHT FIXTURE WITH DIE CAST ALUMINUM HOUSING, VANDAL GUARD VISOR, IP66 RATED, WITH 17000 LUMEN OUTPUT AT 4000K TEMP. VERIFY 50' CORD LENGTH.
C1	LUMENPULSE No. LBL 2TT 40K NF LSL XX NO SY XX PM4-1	-	50W LED 4000K	POLE MOUNT 1'-0" BELOW SHADE ATTACH.	NOMINAL LED FLOOD LIGHT FIXTURE WITH DIE CAST ALUMINUM HOUSING, CLEAR TEMPERED GLASS, IP66 RATED WITH 2600 LUMEN OUTPUT AT 4000K TEMP. VERIFY 50' CORD LENGTH.
G2	ECOSENSE No. L50-1-48-12-40-80-MULT-25X45	-	48W LED 4000K	ROOF MOUNT ON PRESS BOX SEE DETAIL	NOMINAL LINEAR LED FLOOD LIGHT FIXTURE WITH EXTRUDED ALUMINUM HOUSING, INTEGRAL CONNECTORS, IP66 RATED WITH 3700 LUMEN OUTPUT AT 4000K TEMP. VERIFY CABLES LENGTHS.

* EXISTING LIGHT FIXTURE FURNISHED BY OWNER, CONTRACTOR INSTALLED.

General Notes:


LIGHTING CONTROLS SHALL MEET FLORIDA BUILDING CODE 2014 REQUIREMENTS. CONTRACTOR SHALL PROVIDE PROGRAMMING AS DIRECTED BY OWNER. CONTRACTOR SHALL SET UP A PRE-CONSTRUCTION COMMISSIONING MEETING TO ENSURE ALL DEVICES INSTALLED WILL MEET THE NEEDS OF THE OWNER, FINALIZE DIGITAL SWITCH PROGRAMMING BUTTONS, AND FINALIZE TIME CLOCK SCHEDULING.

LIGHTING CONTROL PROGRAM SCHEDULE


RELAY No.	CIRCUIT	DESCRIPTION	GROUP SWITCH CARD		REMARKS
			CHANNEL	FUNCTION	
1	LA-5	FLAG POLE LIGHTING	"a"	ON - OFF	PUSH BUTTON CONTROL AND TIME CLOCK FOR SPECIAL EVENTS.
2	LA-6	CANOPY LIGHTING	"b"	ON - OFF	PUSH BUTTON CONTROL AND TIME CLOCK FOR SPECIAL EVENTS.
3	LA-2	EXTERIOR WALL PACK LIGHTING	"c"	ON - OFF	PHOTOCELL ON AT DUSK, TIME PROGRAM OFF; DAY LIGHT SENSOR OVERRIDE
4	-	-	-	ON - OFF	
5	-	-	-	ON - OFF	
6	-	-	-	ON - OFF	
7	-	-	-	ON - OFF	
8	PA-9	OFFICE RECEPTACLES	-	ON - OFF	

Key Notes: LIGHTING CONTROL PANEL DETAIL


- 1 LIGHTING CONTROL PANEL & RELAY PANEL WITH TIME CLOCK AND PHOTO CELL CONTROL. WATTSTOPPER No. LMCP8-115/2TT-8HDR-2TT-LENC8S.
- 2 HDR RELAY
- 3 RELAY DRIVER BOARD
- 4 RELAY OVERRIDE BUTTON
- 5 DLM NETWORK CONNECTIONS
- 6 BACNET MS/TP CONNECTION
- 7 GROUP 1-8 BUTTONS
- 8 DB9 CABLE
- 9 LOW VOLTAGE CONTROL WIRES TO KEYPAD
- 10 LOW VOLTAGE CONTROL WIRES TO PHOTOCELL LOCATED ON ROOF
- 11 CONDUIT AND CONDUCTORS TO LIGHTING FIXTURES
- 12 2 #12, 1 #12 GND IN 3/4" CONDUIT FROM 20A/1P BREAKER IN PANEL FOR 2TT VOLT CONTROL POWER
- 13 DIGITAL KEYPAD
- 14 LIGHTING BRANCH CIRCUIT CONDUCTORS IN CONDUIT
- 15 PANEL "LA" - 480/2TT VOLT, 3 PHASE, 4 WIRE

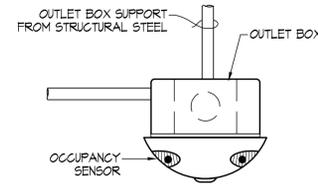

**CEILING MOUNT OCCUPANCY
SENSOR MOUNTING DETAIL**
NOT TO SCALE

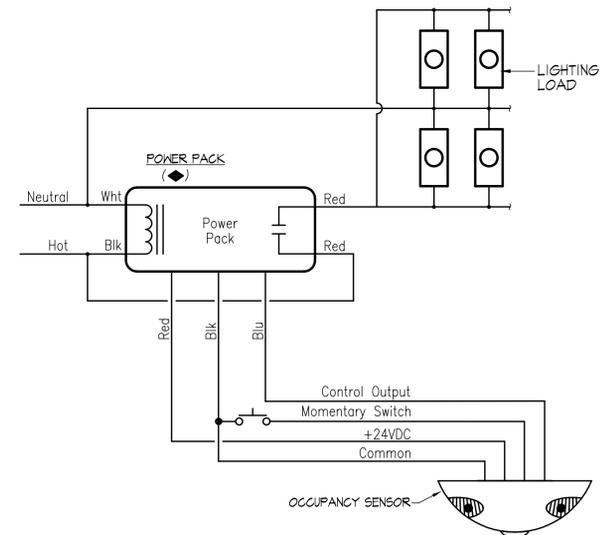

**TYPICAL LINE VOLTAGE LIGHTING CONTROL DIAGRAM
OCCUPANCY SENSOR NO LOCAL SWITCHING**
NOT TO SCALE

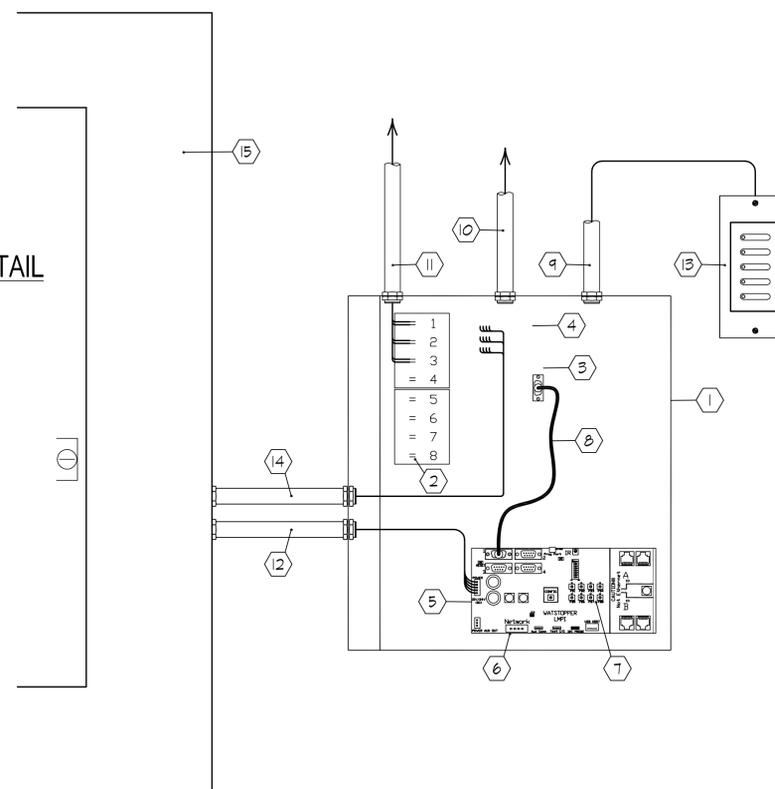

LIGHTING CONTROL PANEL DETAIL "C" - TYPICAL
NOT TO SCALE

CONSULTANTS:



**FLORIDA
ARCHITECTS**
LICENSE #AA0002730




CLIENT:

**GULF COAST STATE
COLLEGE**

5230 US-98
PANAMA CITY,
FLORIDA 32401
850.169.1551
gulfcost.edu

PROJECT:

**GCSC SOFTBALL
COMPLEX**



RELEASE:

CONSTRUCTION DOCUMENTS

SCALE:
As Indicated

DATE:
05/04/2017

DRAWN:
T. A. BOLTON

CHECKED:
M. J. REID

NO.

REVISION:

DATE:

1

ADDENDUM No. 1

6-1-17

3

ADDENDUM No. 3

6-9-17

SHEET TITLE:

**LIGHTING FIXTURE
SCHEDULE**

PROJECT NO.

4226

SHEET

E3

REVISIONS TO BE MADE BY THE ENGINEER OR ARCHITECT. NO REVISIONS TO BE MADE BY THE CONTRACTOR. ANY REVISIONS TO BE MADE BY THE CONTRACTOR SHALL BE MADE BY THE ENGINEER OR ARCHITECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE ENGINEER OR ARCHITECT.